




NOTES:

1. t=THICKNESS OF SIDEWALK
2. SIDEWALK THICKNESS 150 mm EXCEPT ACROSS COMMERCIAL INDUSTRIAL AND HIGH DENSITY RESIDENTIAL DRIVEWAY WHERE IT SHALL BE 180 mm

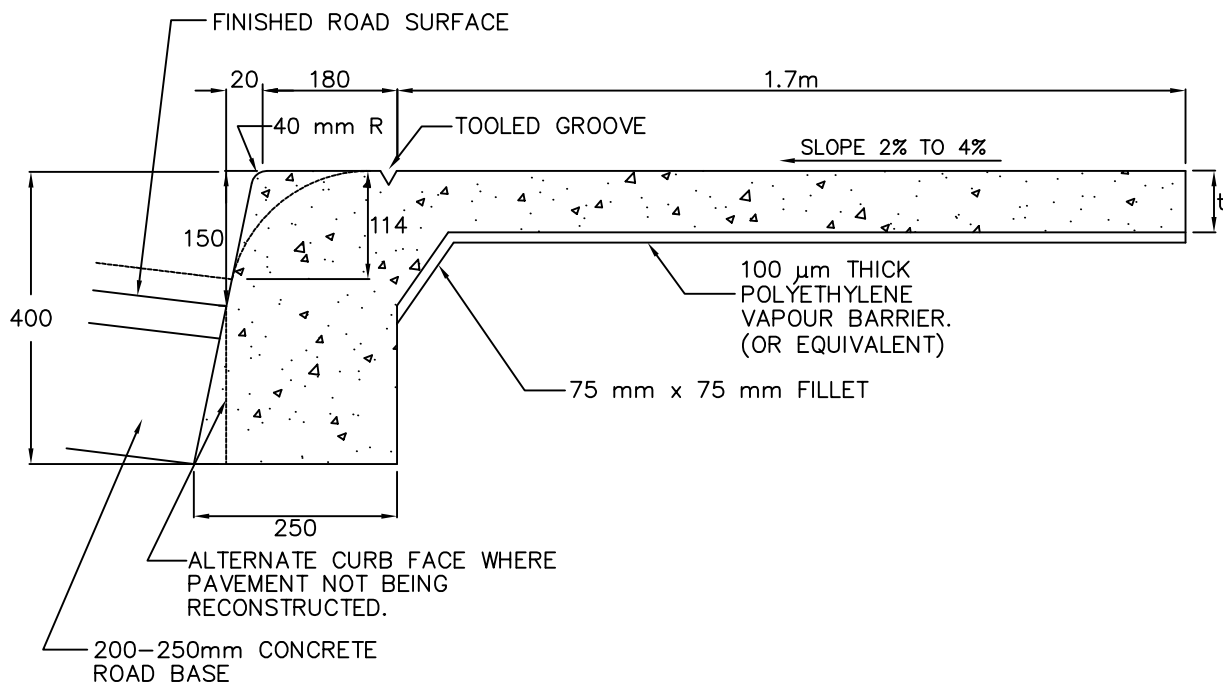

TECHNICAL SERVICES
Engineering Services - Works Facilities & Structures

SCALE:	N.T.S.	COMBINED CONCRETE CURB AND SIDEWALK	DRAWING NUMBER:
DATE:	NOVEMBER, 2006		T-310.010-4
DRAFTING:	V. DIDIANO		SHEET: 1