


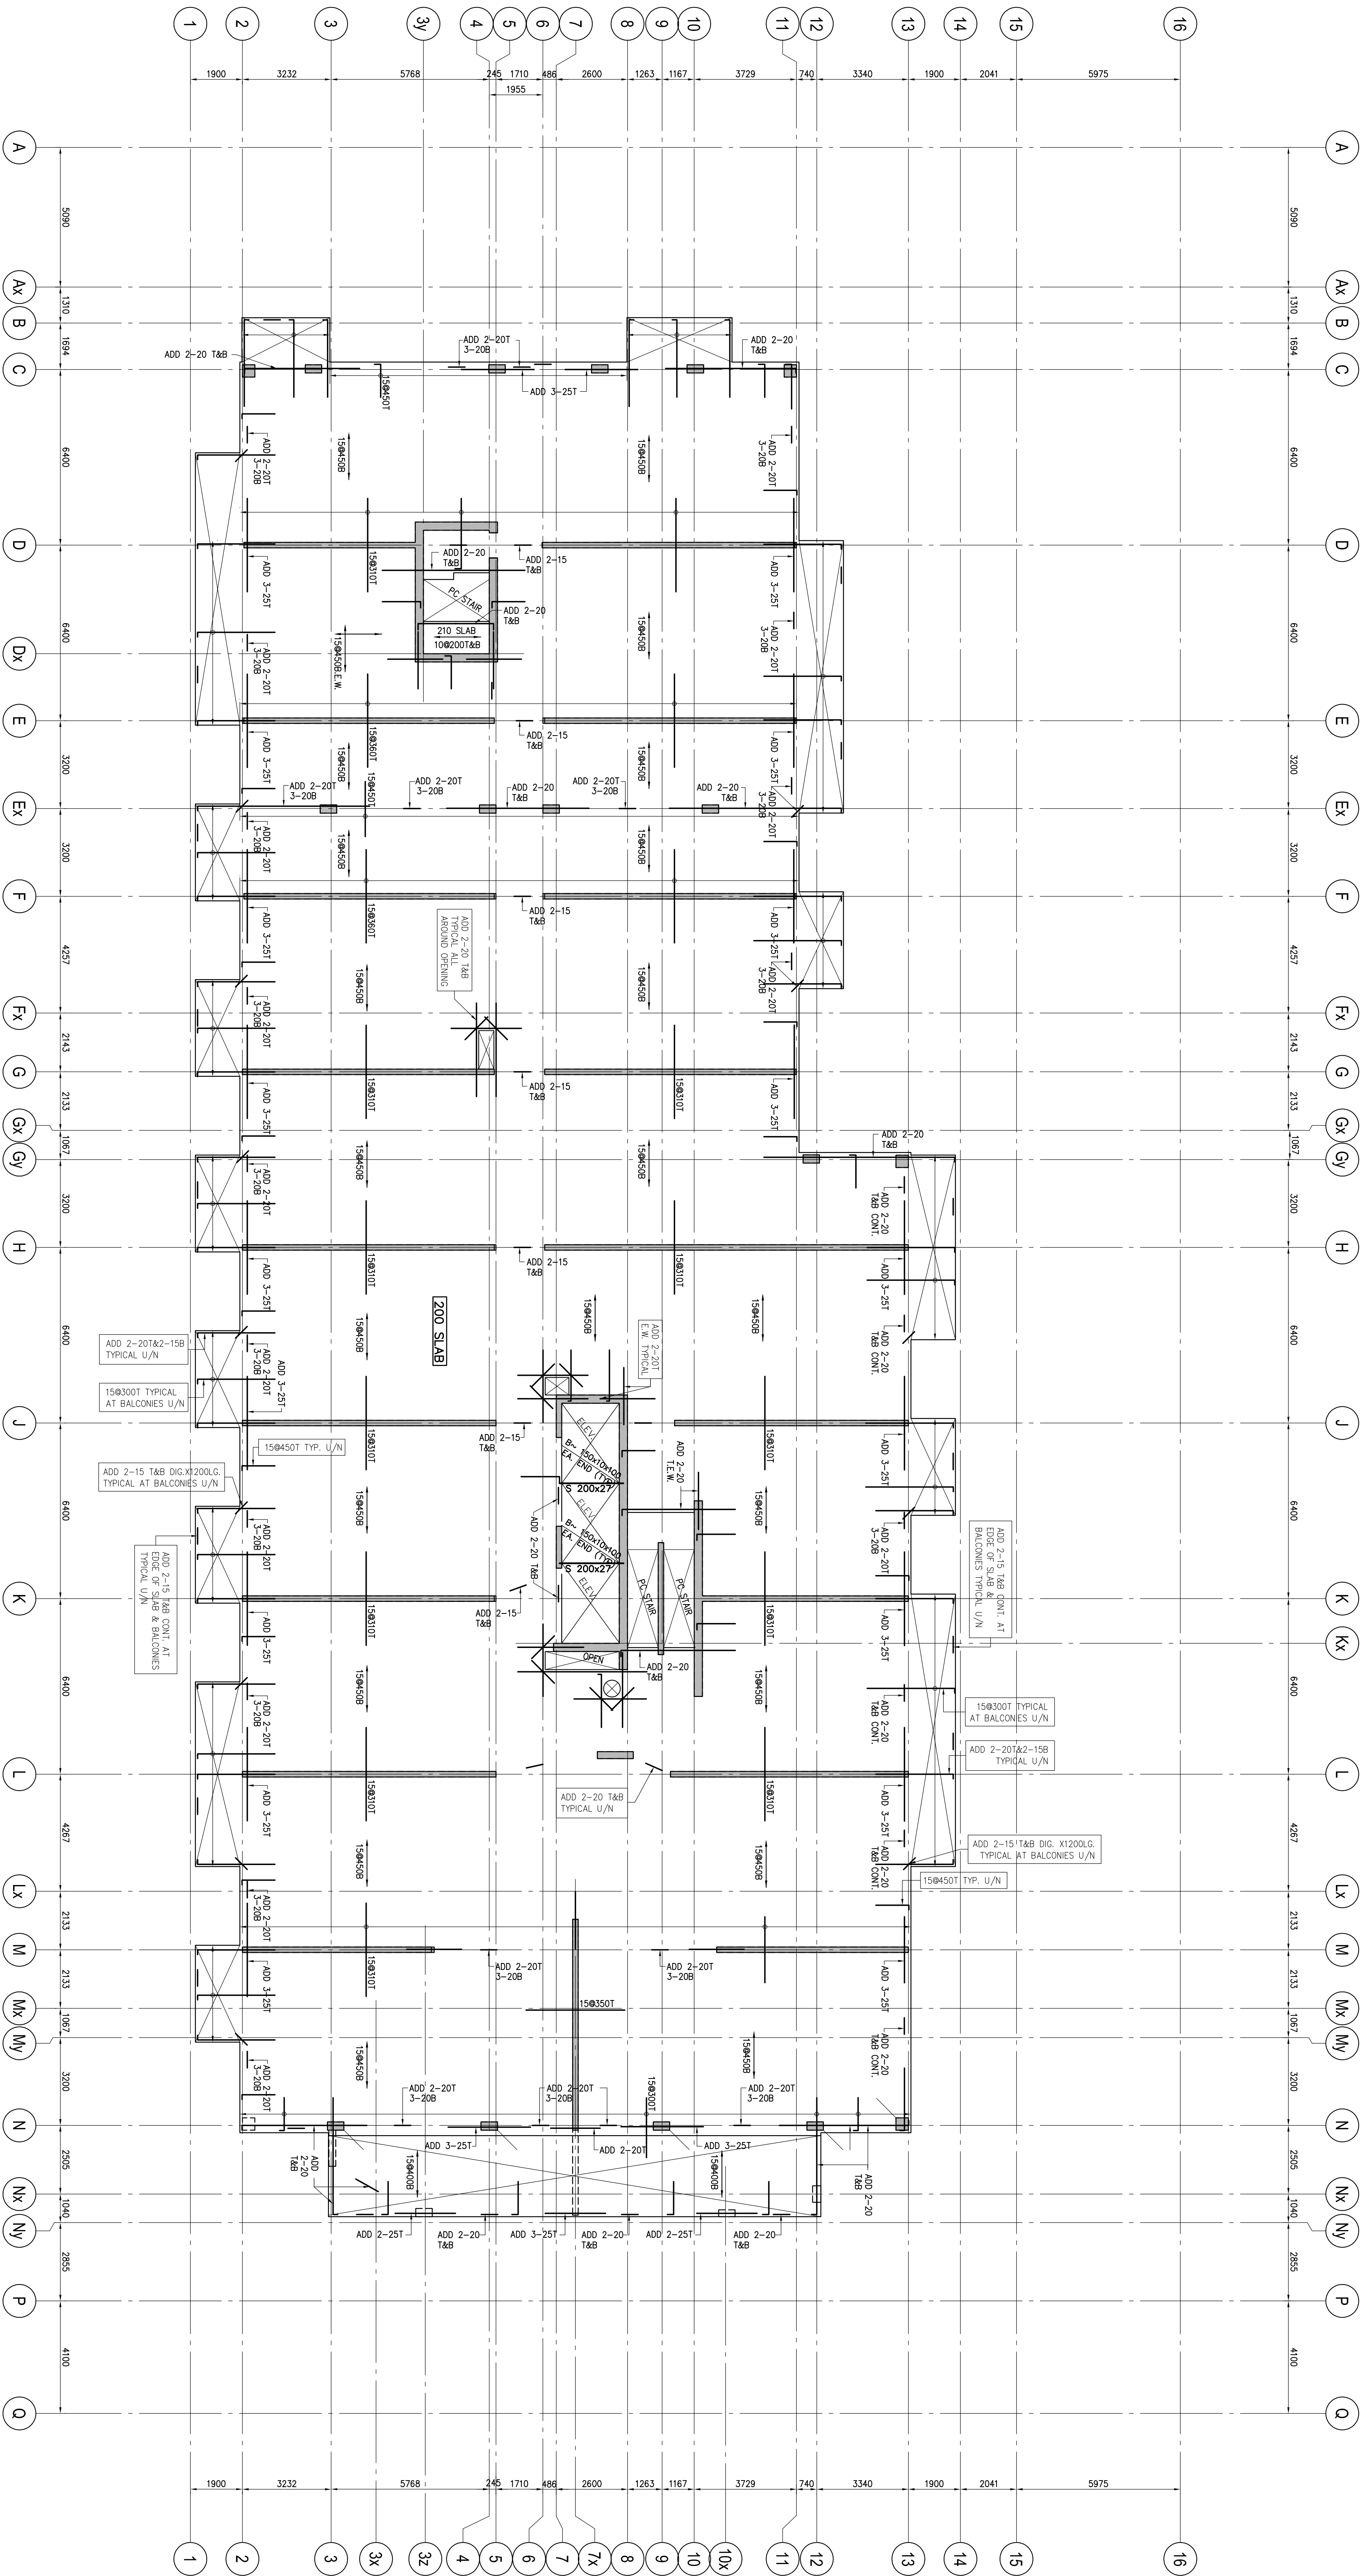

7TH FLOOR FRAMING PLAN

SCALE 1 : 100

1. TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS CROSSED AND NOTED ON PLAN.
2. CONCRETE STRENGTH AT 28 DAYS SHALL BE:
FOR WALLS AND COLUMNS SEE SCHEDULE
FOR INTERIOR SLABS 25 MPa
FOR BEAMS 35 MPa
CONCRETE EXPOSED TO ELEMENTS SHALL BE 35 MPa WITH 6% TO 8% DRYING AG.
3. FLOOR SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS :

	S.L.D.	L.L.
STAIRS & BALCONIES	0.50 KPa	4.80 KPa
LOCKERS & STORAGE	1.30 KPa	4.80 KPa
RESIDENTIAL	1.30 KPa	1.9 KPa
TOILETS	1.30 KPa	2.40 KPa
TERMMES	5.0 KPa	4.80 KPa


* 

DIRECTION OF REINFORCING OF THE SLAB
UNLESS DRAWN ON THE PLAN


T&B & B.T.

4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
5. TEMPERATURE REINFORCING FOR : 200 SLAB IS 10M250.
6. NO OPENINGS LARGER THAN 300mm x 300mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE TYPICAL DETAILS ON DRAWINGS S-001 TO S-006.
8. SEE GENERAL NOTES ON DRAWINGS S-001.
9. REFER TO ARCH. DRAWINGS FOR SLOPES OF SLAB.
10. FOR COLUMN & WALL SCHEDULE SEE DRAWINGS S-001 TO S-006.
11. CORRELATE BEAM DEPTH AT DOOR OPENINGS WITH ARCH. DRAWINGS.
12. EXTEND TOP REINFORCING TO END OF BALCONIES/OPENINGS.
13. TOP BARS TERMINATING AT EDGE OF SLAB TO HAVE 180° HOOK.

FIRST FLOOR ELEV. 83.00m				
NO.	REMARKS	DATE	BY	CHECKED
1.	REVISION	2014-03-07		
2.	REVISION	2014-03-07		
3.	REVISION	2014-03-07		
4.	REVISION	2014-03-07		
5.	REVISION	2014-03-07		
6.	REVISION	2014-03-07		
7.	REVISION	2014-03-07		
8.	REVISION	2014-03-07		
9.	REVISION	2014-03-07		
10.	REVISION	2014-03-07		
11.	REVISION	2014-03-07		
12.	REVISION	2014-03-07		
13.	REVISION	2014-03-07		
14.	REVISION	2014-03-07		
15.	REVISION	2014-03-07		
16.	REVISION	2014-03-07		

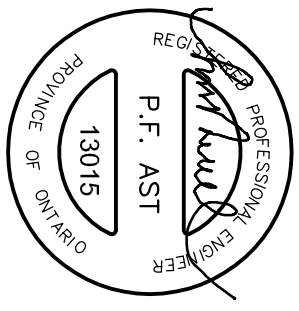

Joblonsky, Asi and Partners ENGINEERS
1001 BAYVIEW AVE. SUITE 200
SCARBOROUGH, ONTARIO M1B 2Y1
TEL: 416-443-2771
FAX: 416-443-2772
E-MAIL: info@jap.ca



ALEXANDRA PARK - BLOCK 11
TORONTO, ONTARIO

DATE: 2014-03-07
DRAWN BY: H.W.
CHECKED BY: H.W.
DATE: 2014-03-07