


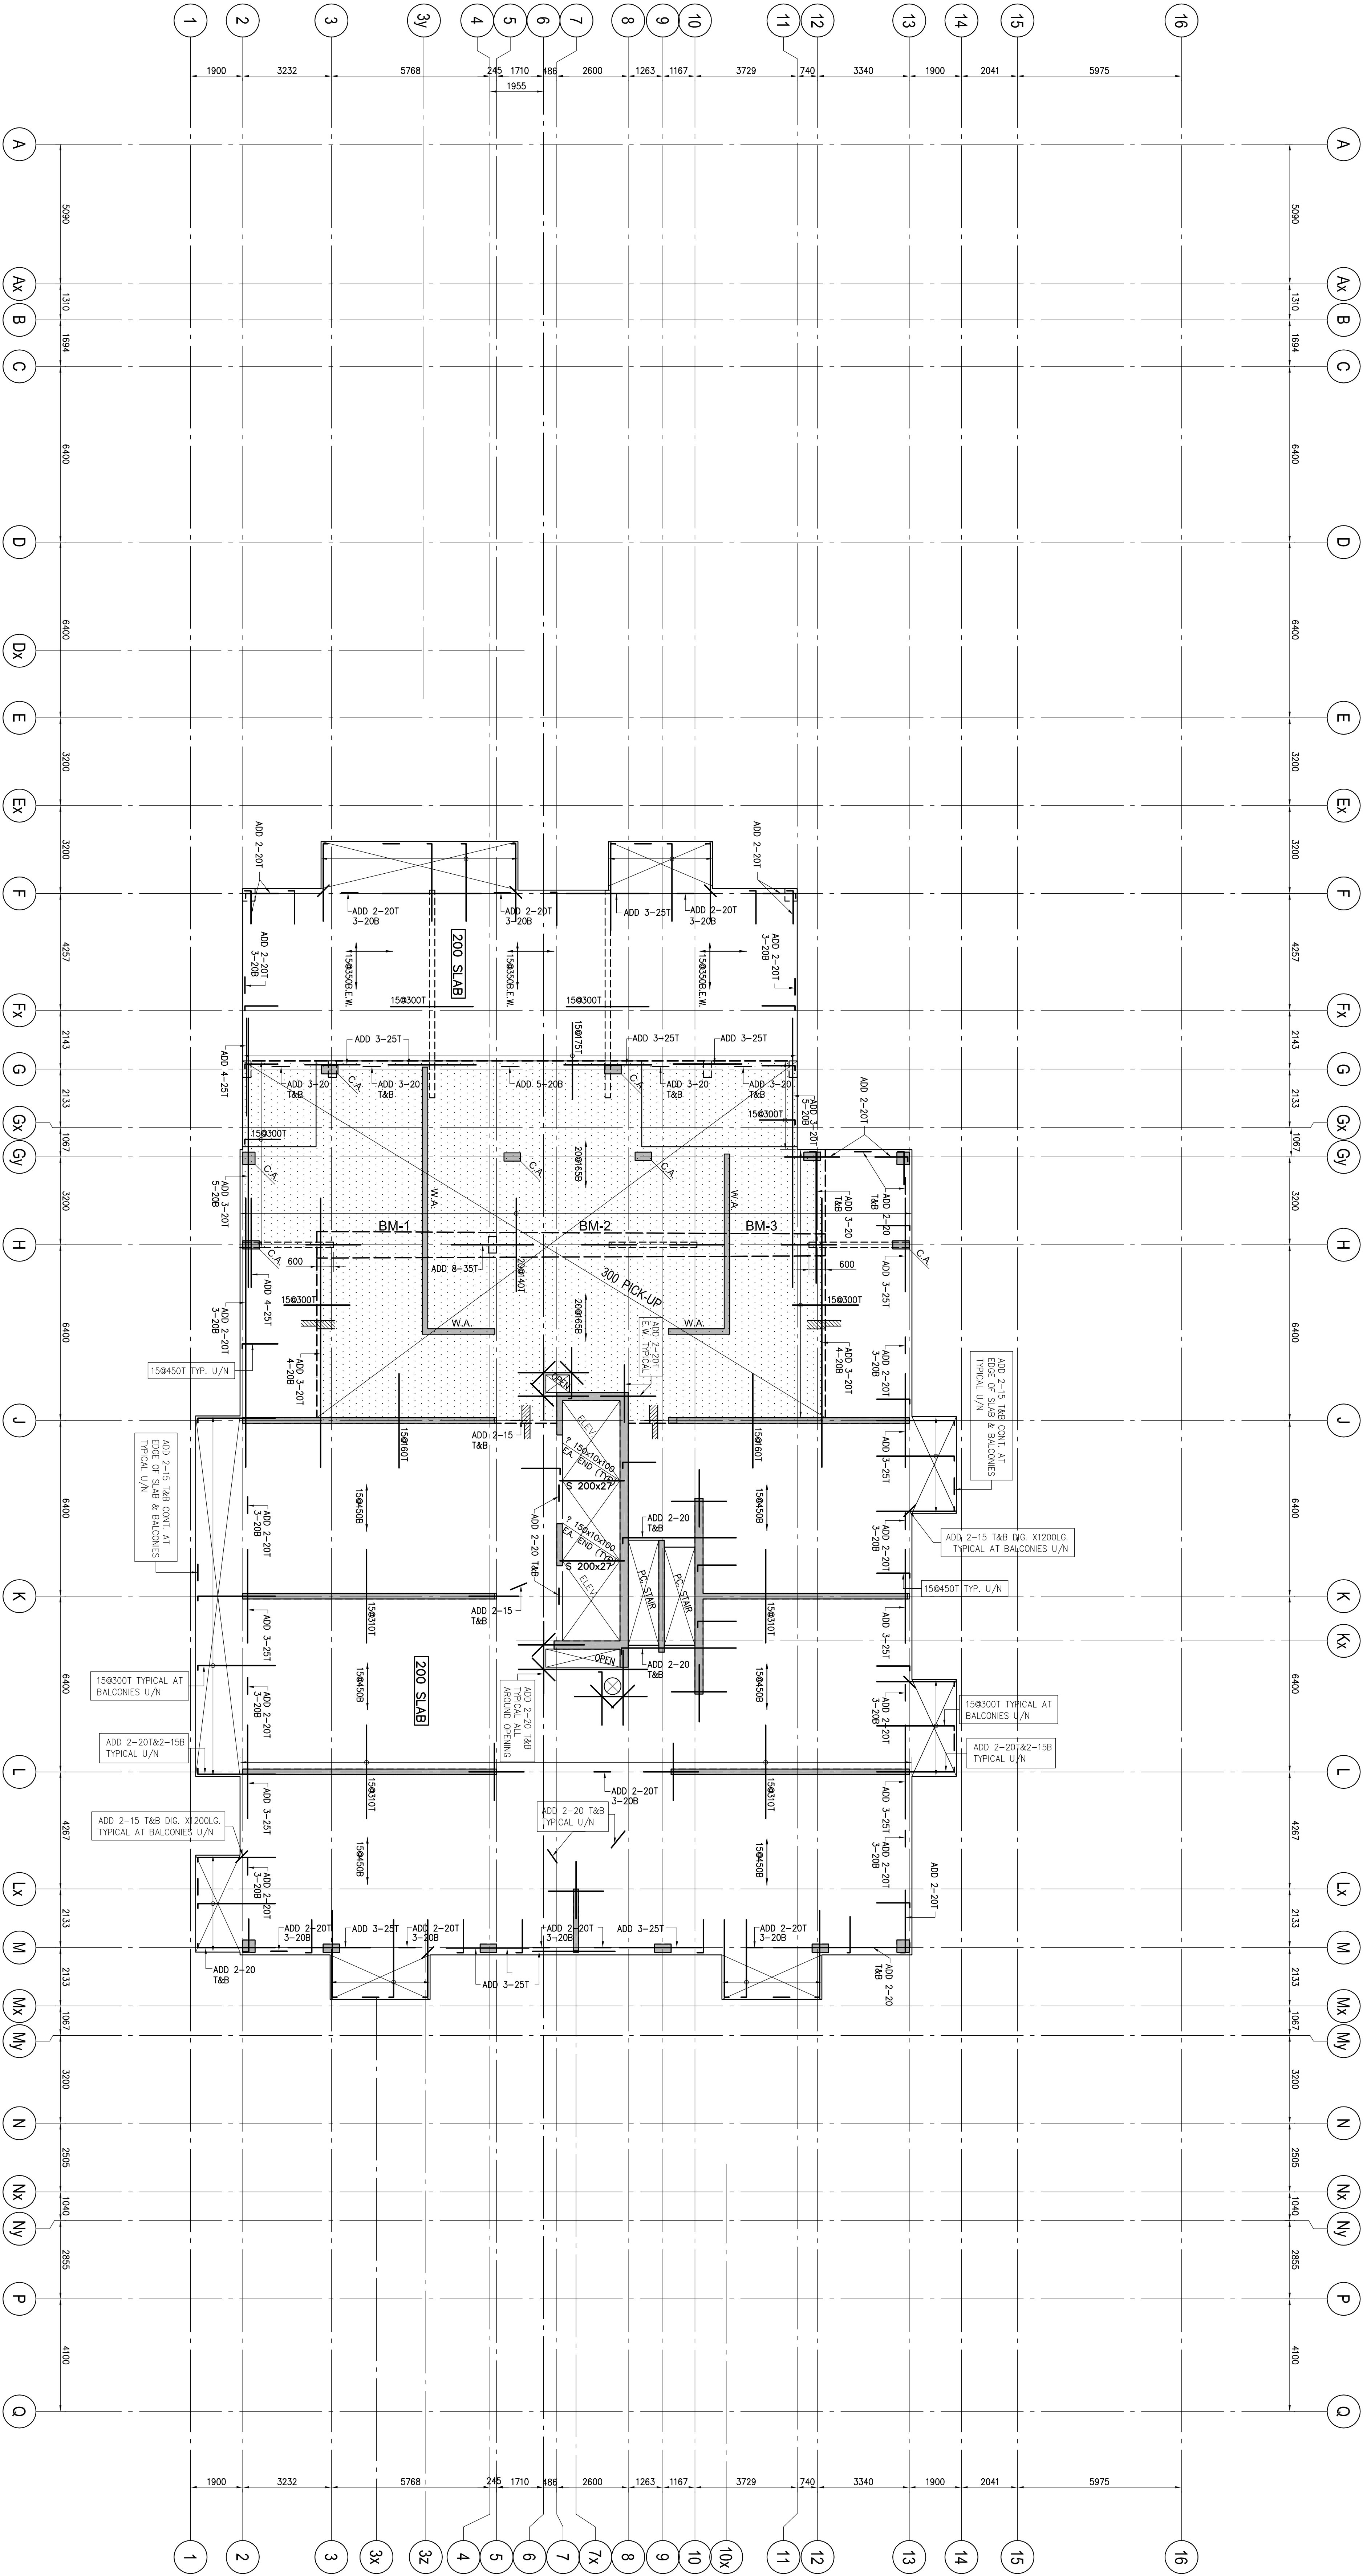


12TH FLOOR FRAMING PLAN

SCALE 1 : 100

1. TOP OF SLAB IS AT ELEVATION AS SHOWN ON ARCH. DRAWINGS EXCEPT AS NOTED ON PLAN.
2. CONCRETE STRENGTH AT 28 DAYS SHALL BE: FOR EXTERIOR SLABS 35 MPa FOR INTERIOR SLABS 25 MPa FOR BEAMS 35 MPa
3. FLOOR SLABS ARE DESIGNED FOR FOLLOWING LOADING CONDITIONS :

	S.D.	L.L.
STAIRS & BALCONIES	0.50 kPa	4.80 kPa
LOCKERS & STORAGE	1.50 kPa	4.80 kPa
RESIDENTIAL	1.50 kPa	1.9 kPa
TOILETS	1.50 kPa	2.40 kPa
TERRACES	5.0 kPa	4.80 kPa




4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
5. TEMPERATURE REINFORCING FOR : 200 SLAB IS 100% 300 SLAB IS 100% 300 SLAB IS 100%
6. NO OPENINGS LARGER THAN 100mm x 100mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE TYPICAL DETAILS ON DRAWINGS S-201 TO S-206.
8. SEE GENERAL NOTES ON DRAWING S-201.
9. REFER TO ARCH. DRAWINGS FOR SLOPES OF SLAB.
10. FOR COLUMN & WALL SCHEDULE SEE DRAWINGS S-201 TO S-206.
11. COORDINATE BEAM DEPTH AT DOOR OPENINGS WITH ARCH. DRAWINGS.
12. EXTEND TEMP. REIN. TO END OF BALCONIES/OVERHANGS.
13. TOP BARS TERMINATING AT EDGE OF SLAB TO HAVE 180° HOOK.

DIRECTION OF REINFORCING OF THE SLAB
UNLESS SHOWN ON THE PLAN


TL & BL

12TH FLOOR BEAM SCHEDULE (f _c ' = 35MPa)						
MARK	WIDTH	DEPTH	REINFORCEMENT		STIRRUPS	REMARKS
			BOTTOM	TOP		
BM-1	800	600	7-35	5-20	15	ADD 1-15SET
BM-2	800	600	6-25	5-20	15	ADD 1-15SET
BM-3	800	600	7-35	5-20	15	ADD 1-15SET

FIRST FLOOR ELEV. 83.00m			
NO.	REVISION	DATE	BY
1.	ISSUED FOR PERMIT	2014-03-07	AS
2.	ISSUED FOR PERMIT	2014-03-07	AS
3.	ISSUED FOR PERMIT	2014-03-07	AS
4.	ISSUED FOR PERMIT	2014-03-07	AS
5.	ISSUED FOR PERMIT	2014-03-07	AS
6.	ISSUED FOR PERMIT	2014-03-07	AS
7.	ISSUED FOR PERMIT	2014-03-07	AS
8.	ISSUED FOR PERMIT	2014-03-07	AS
9.	ISSUED FOR PERMIT	2014-03-07	AS
10.	ISSUED FOR PERMIT	2014-03-07	AS
11.	ISSUED FOR PERMIT	2014-03-07	AS
12.	ISSUED FOR PERMIT	2014-03-07	AS
13.	ISSUED FOR PERMIT	2014-03-07	AS
14.	ISSUED FOR PERMIT	2014-03-07	AS
15.	ISSUED FOR PERMIT	2014-03-07	AS
16.	ISSUED FOR PERMIT	2014-03-07	AS
17.	ISSUED FOR PERMIT	2014-03-07	AS
18.	ISSUED FOR PERMIT	2014-03-07	AS
19.	ISSUED FOR PERMIT	2014-03-07	AS
20.	ISSUED FOR PERMIT	2014-03-07	AS

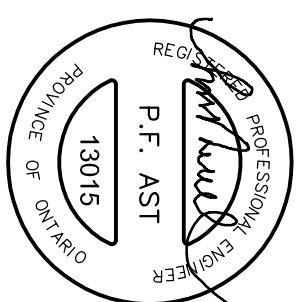

Joblonsky, Asl and others
ENGINEERS
1000 BAYVIEW AVE. SUITE 200
SCARBOROUGH, ONTARIO M1B 2Y1
TEL: 416-443-2701
FAX: 416-443-2701
E-mail: info@joblonsky.com



ALEXANDRA PARK - BLOCK 11
TORONTO, ONTARIO

DATE: 2014-03-07
SCALE: 1:100
DRAWN BY: H.W.
CHECKED BY: H.W.
DATE: 2014-03-07