

DIRECTION OF REINFORCING OF THE SLAB  
UNLESS DRAWN ON THE PLAN


4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 MPa.
5. TEMPERATURE REINFORCING FOR : 200 245 IS 108220.
6. NO OPENINGS LARGER THAN 300mm x 300mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE OTHER DETAILS ON DRAWINGS S-200 TO S-206.
8. SEE GENERAL NOTES ON DRAWING S-201.
9. REFER TO ARCH. DRAWINGS FOR SLOPES OF SLAB.
10. FOR COLUMN & WALL SPECIFIC SEE DRAWINGS S-201 TO S-206.
11. COORDINATE BEAM DEPTH AT DOOR OPENINGS WITH ARCH. DRAWINGS.
12. EXTEND TIE BAR TO END OF BALCONIES/DOORWAYS.
13. TOP BARS REMAINING AT EDGE OF SLAB TO HAVE 180° HOOK.

- |                     | S.I.D.   | L.L.     |
|---------------------|----------|----------|
| STAIRS & BALCONIES  | 0.50 kPa | 4.80 kPa |
| LOCKERS & STORAGE * | 1.30 kPa | 4.80 kPa |
| RESIDENTIAL         | 1.3 kPa  | 1.9 kPa  |
| TOILETS             | 1.30 kPa | 2.40 kPa |
| TERRACES            | 5.0 kPa  | 4.80 kPa |

|                     | S.I.D.   | L.L.     |
|---------------------|----------|----------|
| STAIRS & BALCONIES  | 0.50 kPa | 4.80 kPa |
| LOCKERS & STORAGE * | 1.30 kPa | 4.80 kPa |
| RESIDENTIAL         | 1.3 kPa  | 1.9 kPa  |
| TOILETS             | 1.30 kPa | 2.40 kPa |
| TERRACES            | 5.0 kPa  | 4.80 kPa |


4. MINIMUM YIELD STRESS FOR REINFORCING STEEL SHALL BE 400 Mpa.
5. TEMPERATURE RISES FOR REINFORCING STEEL SHALL BE 200 SLAB IS 100/250, 270 SLAB IS 100/320.
6. NO OPENINGS LARGER THAN 300mm x 300mm ARE ALLOWED IN SLAB OTHER THAN THOSE SHOWN ON DRAWINGS.
7. SEE "TYPICAL DETAILS ON DRAWINGS" S-001 TO S-006.
8. SEE GENERAL NOTES ON DRAWING S-001.
9. REFER TO ARCH. DRAWINGS FOR SLOPES OF SLAB.
10. FOR FLOOR & WALL SCHEDULE SEE DRAWINGS S-001 TO S-006.
11. COORDINATE BEAM DEPTH AT DOORS DRAWINGS WITH ARCH. DRAWINGS.
12. EXTENDED BEAM FROM END OF ALCONES/OVERHANGS.
13. TOP BARS REMAINING AT END OF SLAB TO HAVE 100 HOOK.

11. COORDINATE BEAM DEPTH AT DOOR OPENINGS WITH ARCH. DRAWINGS
12. EXTEND TEMP. REINF. TO END OF BALCONIES/OVERHANGS.
13. TOP BARS TERMINATING AT EDGE OF SLAB TO HAVE 180° HOOK.

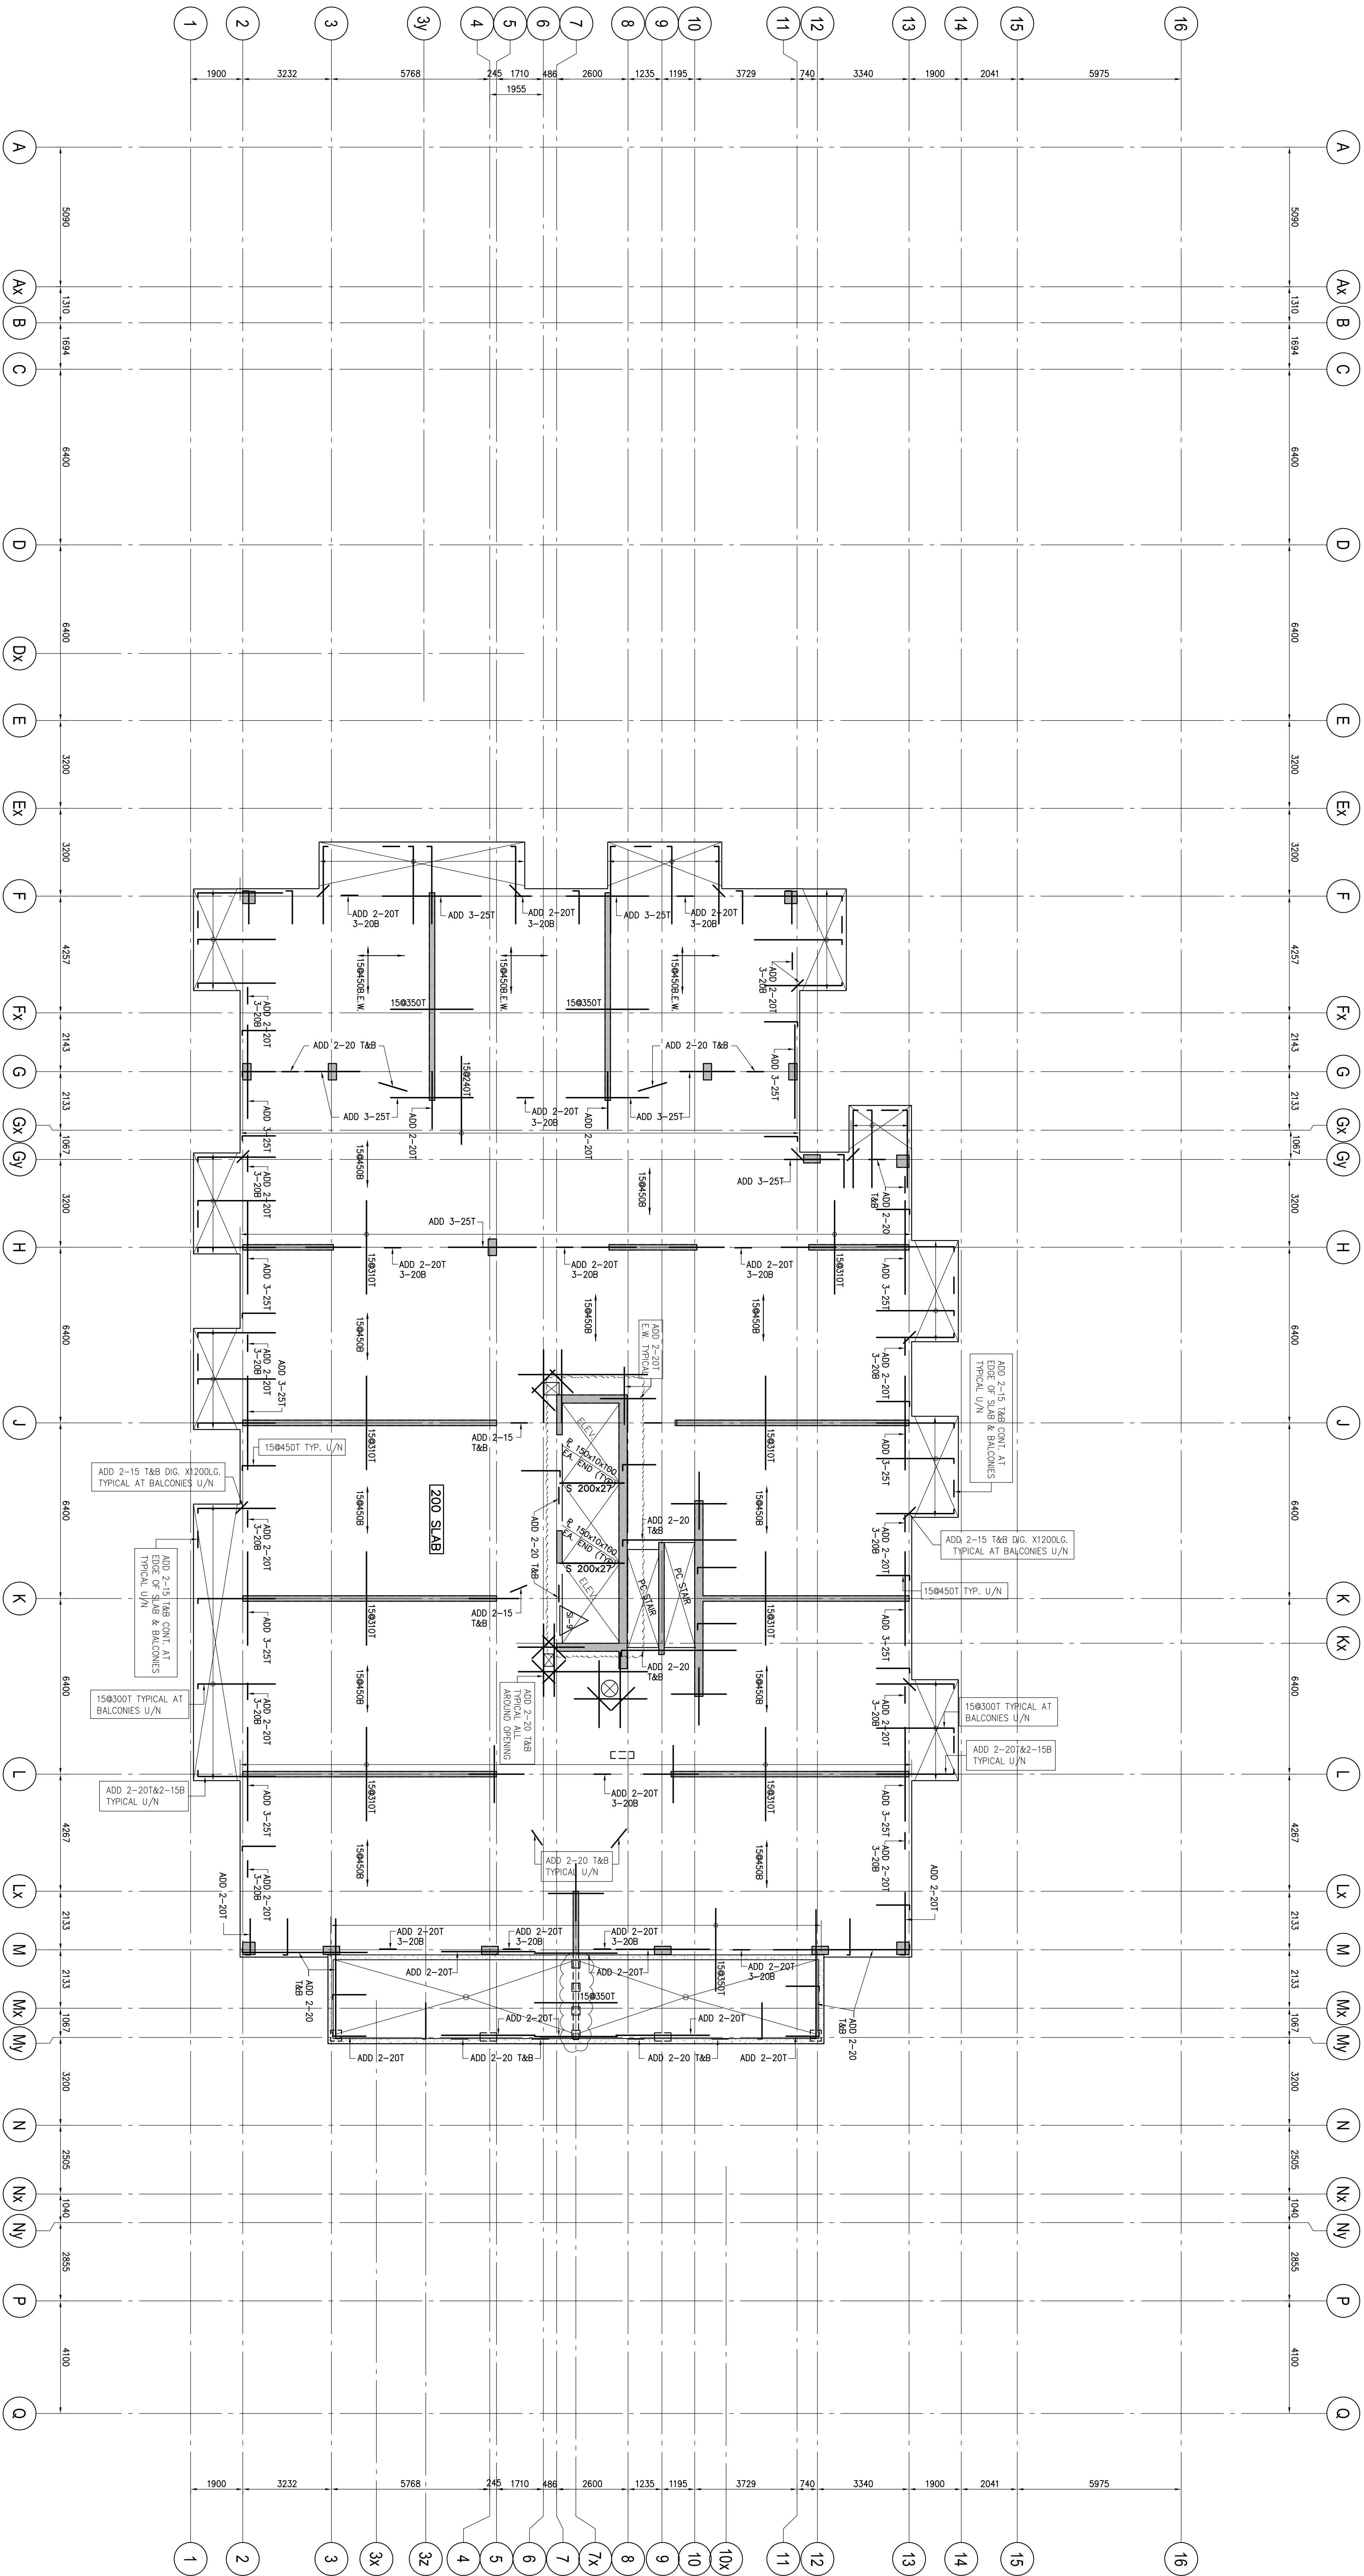

  
**Jablonsky, Ast  
and Partners**  
**CONSULTING  
ENGINEERS**  
1129 LESLIE STREET  
DUN MILLS, ON, M5C 2K5  
TEL. 416-447 7405  
FAX 416-447 2771  
E-mail [jap@atn1.on.ca](mailto:jap@atn1.on.ca)

| no. | issued / revised | client     |
|-----|------------------|------------|
| 1   | 16.04.2016       | 25.04.2016 |
| 2   | 16.04.2016       | 25.04.2016 |
| 3   | 16.04.2016       | 25.04.2016 |
| 4   | 16.04.2016       | 25.04.2016 |
| 5   | 16.04.2016       | 25.04.2016 |
| 6   | 16.04.2016       | 25.04.2016 |
| 7   | 16.04.2016       | 25.04.2016 |
| 8   | 16.04.2016       | 25.04.2016 |
| 9   | 16.04.2016       | 25.04.2016 |
| 10  | 16.04.2016       | 25.04.2016 |
| 11  | 16.04.2016       | 25.04.2016 |



**ALEXANDRA PARK - BLOCK 11**  
TORONTO, ONTARIO