
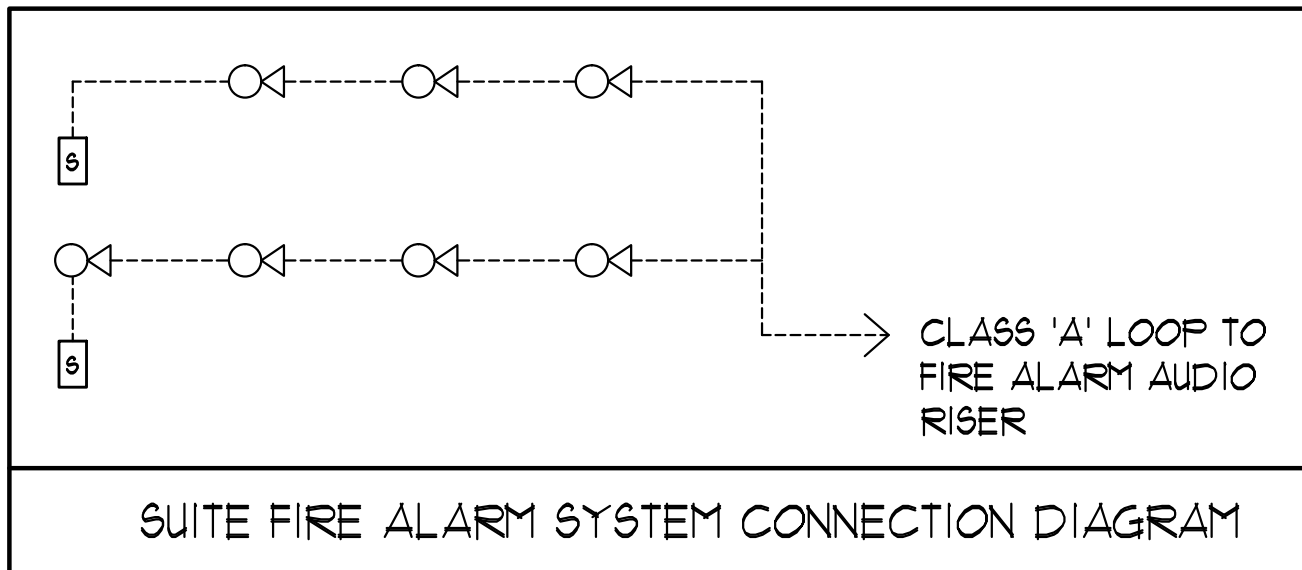




Mounting Height Schedule (Dimensions are from finish floor to top of wall box)

Outlet	Suites	Public Area
Receptacle	18" FFF	18" FFF
Kitchen Counter Split Receptacle	46" FFF	46" FFF
TV/Telephone (Multi-Port) Outlet	18" FFF	18" FFF
Light Switch	38" FFF	38" FFF
Security Panel	62" FFF	62" FFF
Wall Thermostat	62" FFF	62" FFF
Fridge Receptacle	To Suit Equipment	
Microwave/Fan Unit Receptacle	Locate in upper cabinet above	
Under Cabinet Lighting Receptacle	Locate in upper cabinet above microwave / fan unit	
Intercom	41" FFF	
Firefighter's Handset	41" FFF	
Pull Station	41" FFF	

General Area Circuiting - Table #1

Lighting Fixture Location	CCT #	Receptacle Location	CCT #
P4 TO P1 - Exit Signs	EX-XX	Lobby (P4 to P1)	EX-XX
P4 TO 10/F - Exit Signs	EX-XX	Stair "A" (15/2/F)	EX-XX
1/F TO ROOF - Exit Signs	EX-XX	Stair "B" (MP4.30.21.24.21.0.8.5) Floors	EX-XX
Lobby (P4 to P1)	EX-XX	Stair "C" (MP4.30.21.24.21) Floors	EX-XX
Stair "A" (P4 to G/F)	EX-XX	Stair "D" (10.5/12.36.3) Floors	EX-XX
Corridor	EX-XX	Stair "E" (P1) Floor	EX-XX
Corridor	EX-XX	Corridor	EX-XX

ELECTRICAL LEGEND	
LIGHTING	
	FLUORESCENT LIGHT FIXTURE, TYPE AS INDICATED
	NIGHT LIGHT OR LIGHT CONNECTED TO EMERGENCY POWER
	CEILING MOUNTED WALL MOUNTED LIGHT FIXTURE, INSCRIBED LETTER DENOTES TYPE
	POLE MOUNTED LIGHT FIXTURE, INSCRIBED LETTER DENOTES TYPE
	CAPPED CEILING LIGHT OUTLET
	TRACK LIGHT
	STRIP LIGHT
	UNDER CABINET FLUORESCENT LIGHT FIXTURE
	CEILING MOUNTED WALL MOUNTED EXIT SIGN
	EMERGENCY BATTERY PACK
	OCCUPANCY SENSOR POWER PACKS
	SINGLE/DOUBLE POLE, SINGLE/DOUBLE THROUGH DOUBLE SWITCH RESPECTIVELY