


KEY NOTES - INSUITE:

- 1) DESIGNATED "LAUNDRY RECEPTACLE" AS DEFINED BY ESA CODE 26-120(e)(1), 26-120(b) AND ESA BULLETIN 26-26-0 (WITHIN 2' RADIUS OF LAUNDRY CLOSET). RECEPTACLE SHALL BE CONNECTED TO A DEDICATED CIRCUIT. SEE DETAIL #4 ON DUG. E-35.
- 2) SUITE DOOR CONTACTS AND GLASS BREAK DETECTOR WILL COMPLETE WITH INTRUSION ALARM SYSTEM THAT CONTACT TO THE CONCERGE STATION. (TYPICAL)
- 3) FOR FAN COIL UNITS (FCU) ELECTRICAL CONTRACTOR TO SUPPLY AND INSTALL CONDUIT AND JUNCTION BOX FOR REMOTE THERMOSTAT. MECHANICAL CONTRACTOR SHALL SUPPLY, WIRE, TERMINATE WIRING AND MOUNT THERMOSTAT.
- 4) INSTALL GIDE-MOUNTED RECEPTACLE ON KITCHEN ISLAND CABINET.

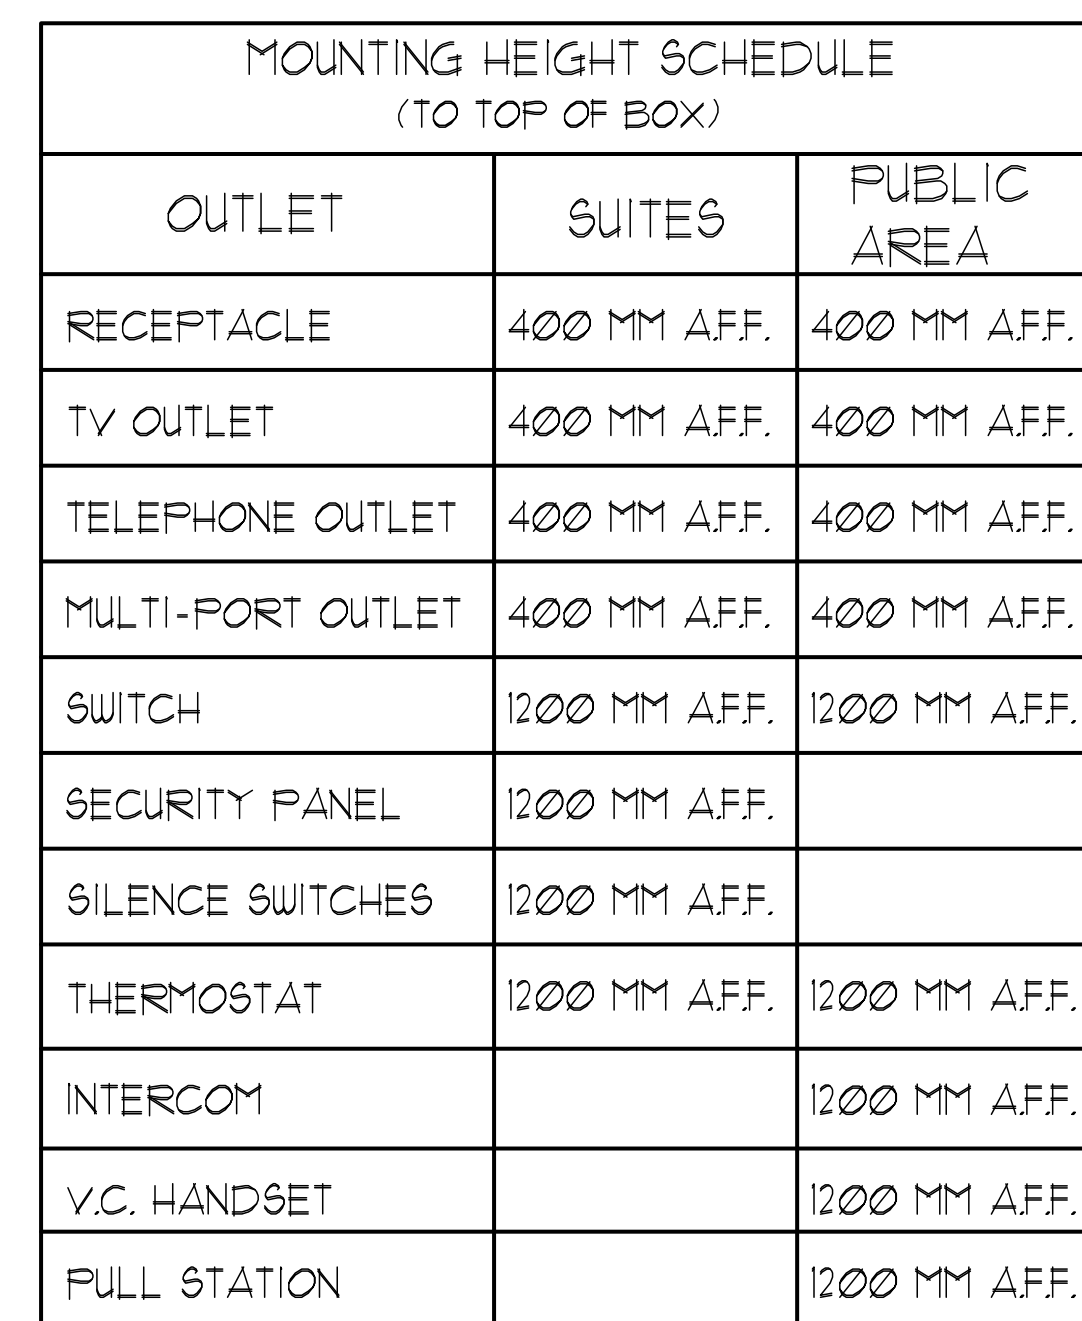


- ## KEY NOTES - RESIDENTIAL - COMMON AREA:
- ⑦ FOR CIRCUITING, REFER TO TABLE #1.
 - ⑧ PROVIDE ALARM SPEAKER, SMOKE DETECTOR AND RECEPTACLE AT EVERY THIRD FLOOR STAIR WELL STARTING FROM TOP FLOOR, AS PER TO DUG. E-32 FOR FIRE ALARM RISER DIAGRAM.
INSTALL SIDE-MOUNTED RECEPTACLE ON KITCHEN ISLAND CABINET.
 - ⑨ PROVIDE TELECOMMUNICATION BACKBOARD C/W 15V, 10, 15A RECEPTACLE AS PER COMMUNICATION RISER DIAGRAM ON DUG. E-31.
 - ⑩ CONTRACTOR SHALL REFER TO ELECTRICAL SINGLE LINE DIAGRAM ON DUG. E-30 AND SDP RISER ON DUG. E-31 FOR SDP LOCATIONS AND DISTRIBUTION.
 - ⑪ PROVIDE CONDUIT AS PER RISER DETAIL #9 ON DUG. E-35 FOR DISORTER/TRANSORTER CONTROL SYSTEM.
 - ⑫ REFER TO SUPERVISED VALVE AND FLOW SWITCH SCHEDULE ON DUG. E-33 FOR DETAILS ON TYPICAL FLOORS.

[illegible]

PROJECT TITLE:
ALEXANDRA PARK

38 CAMERON STREET, BLOCK II
TORONTO ONTARIO

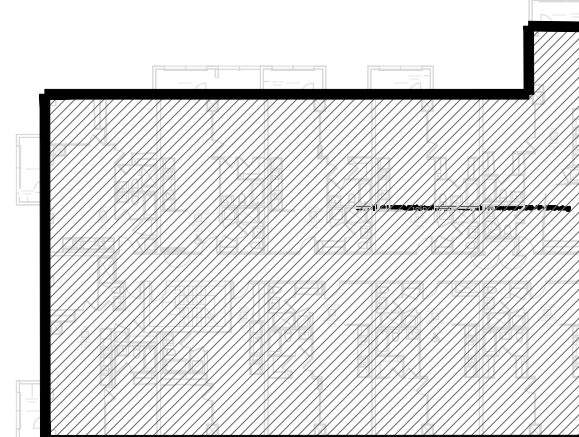

NTS
