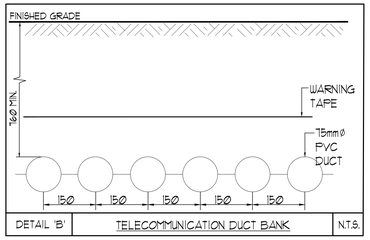

DETAIL 'B' | TELECOMMUNICATION DUCT BANK | N.T.S.

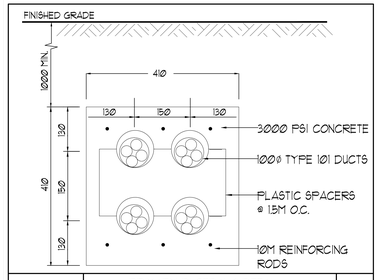

DETAIL 'A' | PRIMARY DUCTBANK DETAIL (TO BE CONFIRMED WITH UTILITY & ESA) | N.T.S.

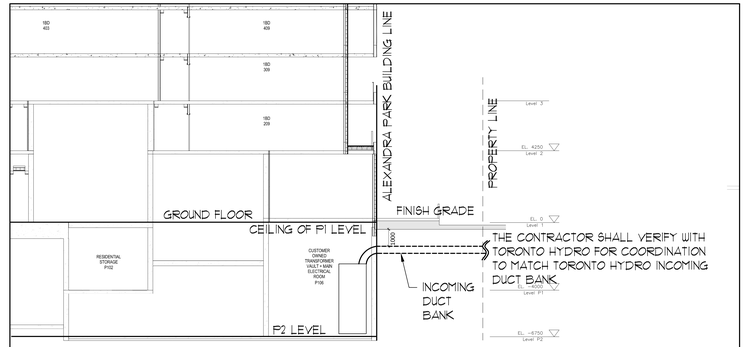

NOTE:
THE SECTION VIEW TO BE CONFIRMED BY ARCHITECT AND STRUCTURAL ENGINEER.

C / E-1 ELECTRICAL ROOM AND TRANSFORMER VAULT SIDE VIEW
SCALE 1:100

ALEXANDRA PARK (#1313)
ELECTRICAL DRAWING LIST

		SCALE	ISSUED FOR PERMIT MAY 30/2014	ISSUED FOR PERMIT JULY 10/2014	ISSUED FOR PERMIT SEPTEMBER 15/2014	ISSUED FOR TENDER OCTOBER 31/2014	ISSUED FOR TENDER SEPTEMBER 15/2014	ISSUED FOR TENDER OCTOBER 31/2014	07/28/15 ISSUED FOR S.I. E-1	07/29/15 ISSUED FOR S.I. E-2	07/29/15 ISSUED FOR S.I. E-3	07/27/15 ISSUED FOR SECURITY TENDER	07/08/15 ISSUED FOR S.I. E-4	07/15/15 ISSUED FOR S.I. E-5	07/17/15 ISSUED FOR S.I. E-6	07/28/15 ISSUED FOR S.I. E-7	08/11/15 ISSUED FOR S.I. E-8	09/24/15 ISSUED FOR S.I. E-9
E-1	SITE PLAN	1:200	√	√	√	√	√	√	√	√	√			√	√	√	√	
E-2	P-2 FLOOR PLAN - ELECTRICAL LAYOUT	1:100	√	√	√	√	√	√			√		√					
E-3	P-1 FLOOR PLAN - ELECTRICAL LAYOUT	1:100	√	√	√	√	√	√	√	√	√		√		√		√	
E-4	G/F SOUTH FLOOR PLAN - POWER LAYOUT	1:50	√	√	√	√	√	√	√	√	√		√	√	√			
E-5	G/F NORTH FLOOR PLAN - POWER LAYOUT	1:50	√	√	√	√	√	√	√	√	√		√	√	√			
E-6	G/F SOUTH FLOOR PLAN - LIGHTING LAYOUT	1:50	√	√	√	√	√	√			√	√	√	√				
E-7	G/F NORTH FLOOR PLAN - LIGHTING LAYOUT	1:50	√	√	√	√	√	√			√	√	√	√	√			
E-8	2/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√		√		
E-9	2/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√		√		
E-10	3/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-11	3/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-12	4/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-13	4/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√							
E-14	5/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-15	5/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-16	6/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-17	6/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-18	7/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√							
E-19	7/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-20	8/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√							
E-21	8/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√							
E-22	9/F SOUTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√		√	√	√			
E-23	9/F NORTH FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√		√	√				
E-24	10/F FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-25	11/F FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-26	12/F FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-27	13/F FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√				
E-28	14/F FLOOR PLAN - ELECTRICAL LAYOUT	1:50	√	√	√	√	√	√			√			√	√			
E-29	ROOF FLOOR PLAN - ELECTRICAL LAYOUT	N.T.S.	√	√	√	√	√	√			√		√		√			
E-30	SINGLE LINE DIAGRAM	N.T.S.	√	√	√	√	√	√			√		√	√	√			
E-31	SUITE DISTRIBUTION PANEL, TELECOMMUNICATIONS & SECURITY RISER DIAGRAMS	N.T.S.	√	√	√	√	√			√	√							
E-32	FIRE ALARM RISER DIAGRAM	N.T.S.	√	√	√	√	√	√			√							
E-33	FIRE ALARM SCHEDULES AND DETAILS	N.T.S.	√	√	√	√	√	√			√							
E-34	ELECTRICAL PANEL SCHEDULES & LIGHTING SCHEDULES	N.T.S.	√	√	√	√	√	√	√	√	√		√		√			
E-35	ELECTRICAL DETAILS	N.T.S.	√	√	√	√	√				√			√				
E-36	SYSTEM WATER RISER DIAGRAM	N.T.S.					√				√							

ELECTRICAL LEGEND

LIGHTING

- FLUORESCENT LIGHT FIXTURE TYPE AS INDICATED
- NIGHT LIGHT OR LIGHT CONNECTED TO EMERGENCY POWER
- CEILING MOUNTED/WALL MOUNTED LIGHT FIXTURE, INSCRIBED LETTER DENOTES TYPE
- POLE MOUNTED LIGHT FIXTURE INSCRIBED LETTER DENOTES TYPE
- CAPPED CEILING LIGHT OUTLET
- TRACK LIGHT
- STRIP LIGHT
- UNDER CABINET FLUORESCENT LIGHT FIXTURE
- CEILING MOUNTED/WALL MOUNTED EXIT SIGN
- SINGLEHEAD EMERGENCY LAMP REMOTE HEAD
- EMERGENCY BATTERY PACK
- OCCUPANCY SENSOR POWER PACKS
- S/S/3 S1, S2, SP, SD — SINGLE/TWO/THREE POLE, SINGLE/TWO/THREE THROW TOGGLE SWITCH RESPECTIVELY, (3'X4'P.5" DENOTES 3-WAY 4-WAY/PILOT LIGHT, DIMMER SWITCHED LIGHT RESPECTIVELY)
- MASTER LIGHTING SWIT-OFF SWITCH
- SENSOR WALL SWITCH PIR, SELF POWERED
- OCCUPANCY SENSOR, CEILING MOUNTED

POWER

- REGULAR DUPLEX RECEPTACLE
- DUPLEX RECEPTACLE, GROUND FAULT INTERRUPT
- 5-20R T-SLOT DUPLEX RECEPTACLE
- SINGLE RECEPTACLE, TYPE AND CONFIGURATION AS SPECIFIED FOR DRYER
- CONNECTION FOR OVEN/COOKTOP
- ABOVE COUNTER DEVICE
- CEILING MOUNTED DEVICES
- FLOOR MOUNTED DEVICES
- DISCONNECT SWITCH NON-FUSED
- DISCONNECT SWITCH FUSED
- COMBINATION STARTER
- FRACTIONAL MOTOR/FAN DIRECT CONNECTION
- DIRECT CONNECTION, SINGLE PHASE
- DIRECT CONNECTION, THREE PHASE
- THERMOSTAT
- DRYER SENSOR
- HEAT TRACE
- ELECTRICAL HEATER
- ELECTRICAL PANEL / SECURITY PANEL

TELECOMMUNICATION

- TV/CABLE OUTLET
- TELEPHONE OUTLET
- TELEPHONE/TV CABLE (MULTI-PORT OUTLET)
- DATA OUTLET
- DATA/TELEPHONE OUTLET
- IN SUITE TELECOMM. BOX CAT RECEPTACLE
- WIFI LOCATION
- VIDEO INTERCOM
- RADIO RECEIVER

SECURITY

- IC / IRP — INTERCOM / ENTERPHONE
- INTERCOM WITH CAMERA
- PB / PAB — PANIC BUTTON / PANIC INTERCOM STATION
- CR — CARD READER
- ARCA / ARR — AUTOMATIC RELEASE CARD ACCESS/RADIO RECEIVER
- ES — ELECTRIC STRIKE
- ML — MAGLOCK
- DC / DC — DOOR CONTACT / WINDOW CONTACT
- GB — GLASS BREAK DETECTOR
- DO — AUTOMATIC DOOR OPERATOR
- MD — MOTION DETECTOR
- PB — PUSH BUTTON
- CAMERA

LIFE SAFETY

- FIRE ALARM SMOKE DETECTOR
- SMOKE ALARM
- FIRE ALARM DUCT TYPE SMOKE DETECTOR
- FIRE ALARM HEAT DETECTOR
- FIXED TEMP. AT 72 DEGREE HEAT DETECTOR
- MOISTURE PROOF HEAT DETECTOR
- CO ALARM
- COMBINATION SMOKE & CO ALARM
- CO / CO — CO SENSOR / NO SENSOR
- FAP — FIRE ALARM PANEL, PULL STATION
- FH — FIRE/HYDRANT HANDSET
- FA — FIRE ALARM SPEAKER/STROBE WALL MTD.
- FA — FIRE ALARM SPEAKER WALL MTD.
- FA — FIRE ALARM SPEAKER/STROBE CEILING MTD.
- FA — FIRE ALARM SPEAKER CEILING MTD.
- FAAP — FIRE ALARM ANNUNCIATOR PANEL
- FACP — FIRE ALARM CONTROL PANEL

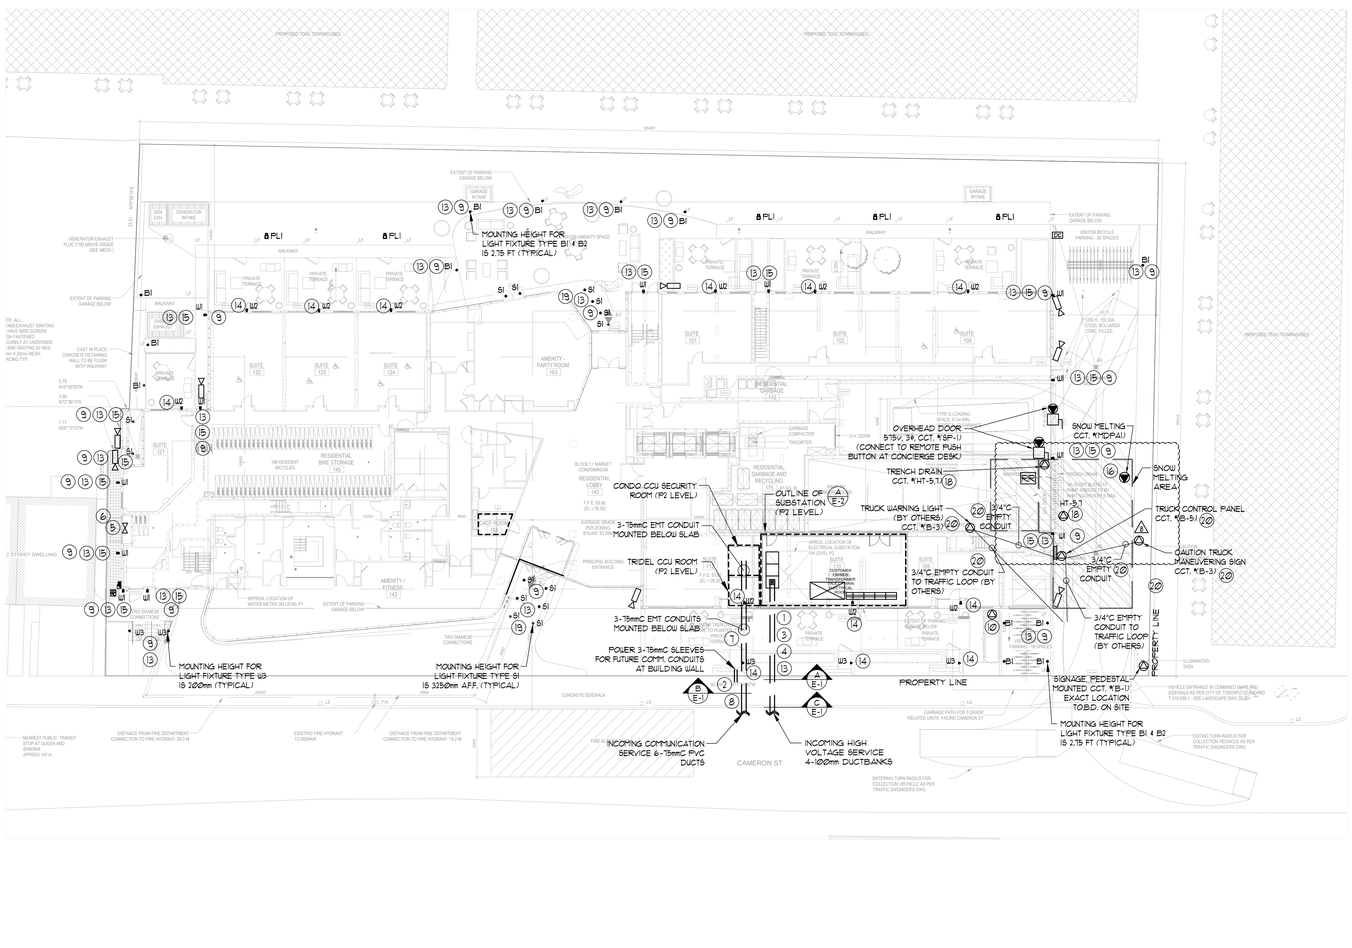

① COMMUNICATION CONDUIT REQUIREMENTS:
a) PLACE 24" PULL BOX ON BUILDING WALL WHERE ENTRANCE SUB DUCT ENTERS BUILDING SO DUCT CAN BE SEALED AFTER ENTRANCE CABLE IS PLACED TO PREVENT WATER AND GASES SEEPING INTO BUILDING.
b) CONDUIT TERMINATION AT THE PROPERTY LINE TO BE MARKED WITH A 2"x4" STAKED INTO THE GROUND APPROXIMATELY 3' HIGH MARKED "BELL".
c) INSIDE THE BUILDING, CONDUIT MUST BE BRT (FIRE RATED ELECTRICAL METALLIC TUBING) 89mm (3.5") OR 100mm (4") INSIDE DIAMETER, TO ENSURE THE SUCCESSFUL PLACEMENT AND TO AVOID DAMAGING THE CABLE DURING THE PULLING OPERATION. "T-STEM" PULL BOXES ARE REQUIRED AT 360 DEGREE BENDS WITHIN THE BUILDING.
d) CONDUIT LENGTHS OVER 30m HAVE A PULL ROPE.
e) ALL CONDUITS TO BE FREE AND CLEAR OF OBSTRUCTIONS AS A BLOCKAGE AT THE TIME OF CABLE ATTACHED, OR RUBBERS PADS OR SLEEVES IN PLACE, WILL RESULT IN A DELAY OF SERVICE UNTIL THE PATH HAS BEEN CLEARED AT THE OWNER'S EXPENSE.
f) 4'x8'x3/4" FIRE RETARDANT PLYWOOD BACKBOARD FASTENED TO WALL IN AN AREA ACCESSIBLE WITHOUT THE USE OF A LADDER WHERE IT IS POSSIBLE FOR A TECHNICIAN TO WORK WITHOUT BLOCKING A PASSAGEWAY AND WHERE THE EQUIPMENT MOUNTED WILL NOT BE DAMAGED BY DOORS OR ANY MOVING OBJECTS.

② THE CONTRACTOR SHALL VERIFY THE LOCATION OF TELECOMMUNICATION DUCT BANK WITH BELL/ROGERS.

③ REFER TO LANDSCAPE DRAWINGS FOR DETAILED LAYOUT. LANDSCAPE LIGHTS SHALL BE CONTROLLED BY A TIMER/CONTACTOR (LOCATED NEAR ELP-B) AND CONNECT TO ELP-B2.

④ PROVIDE 1" CONDUIT C/W PULL STRING FROM IRRIGATION CONTROL PANEL TO IRRIGATION CONTROL POINT. FOR QUANTITY AND LOCATIONS OF IRRIGATION POINTS REFER TO IRRIGATION DRAWINGS.

⑤ RESERVED.

⑥ RESERVED.

⑦ FOR CIRCUITING REFER TO TABLE 1.

⑧ U2 LIGHT FIXTURES FOR GRADE SUITES TO BE CONNECTED TO SUITE ELECTRICAL PANEL. MOUNTING HEIGHT FOR U2 IS CENTERED 2350mm A.F.F. REFER TO ARCHITECTURAL/LANDSCAPE DRAWINGS FOR MOUNTING HEIGHT AND EXACT LOCATION OF LIGHT FIXTURE.

⑨ MOUNTING HEIGHT FOR U2 IS CENTERED 2350mm A.F.F., REFER TO ARCHITECTURAL/LANDSCAPE DRAWINGS FOR MOUNTING HEIGHT AND EXACT LOCATION OF LIGHT FIXTURE.

⑩

CONCRETE RAMP WITH ASPHALT TOPPING, 6.00V, 3Ø (167 SQFT, 48LISQFT			
QTY.	TYPE	CAT#	DESCRIPTION
6	EA	BISGARD-SPACERSALY-25MT-25M	CODE DIRECT HEATING UNIT DESIGN B - 5.48', 1.00Ø0V, 6.00V, WITH 15' COLD LEADS
7	EA	HARD-SPACERSALY-25MT-25M	GALVANIZED STEEL FRE-FUNCH STRAPPING 25M
2	EA	SMCS	SNOW MELTING CAUTION SIGN
CONTROLS FOR RAMP-CONTACTORS & GROUND FAULT PROTECTION INCLUDED			
1	EA	AP6-4C-6.00V 3P	AUTOMATIC SNOWICE MELTING SYSTEM CONTROLLER 6.00V GFEP
1	EA	5C-4DC 6.00V	SATELLITE CONTACTOR
1	EA	CT-1	AUTOMU SENSOR
AS REQ	EA	SIT-6E	PAVEMENT MOUNTED SENSOR

NOTES:
1. THE SYSTEM SHALL BE PENTAIR, 6.00V, 3Ø, 6.4kW.
2. THE INSTALLATION SHALL COMPLY WITH PENTAIR'S MANUFACTURER'S RECOMMENDATION.
3. CONTRACTOR TO VERIFY MATERIAL LIST IS SUITABLE FOR THE ACTUAL SITE MEASUREMENTS AND CONDITIONS.

⑪ THE CABLES RUNNING TO AND FROM HV TRANSFORMER IN DUCT BANKS SHALL BE EXTERNALLY RUBBER LINED BY CONTRACTOR TO PREVENT VIBRATION TRANSMISSION TO GROUND FLOOR SLAB. (FOR CUSTOM OWNED TRANSFORMERS - SCPE CASES ONLY.)

⑫ PROVIDE HEAT TRACING FOR TRENCH DRAIN AS FOLLOW.

ONE CONCRETE TRENCH DRAIN SNOW MELTING 2.00V, 133' x22'			
1	EA	D/3258D3144D/S 4D/S2B/TL533A/X	E550 - ENGINEERED ALLOY 825 HEATING UNIT DESIGN D - 40', 9.4Ø0, 2.00V, WITH A 1' COLD LEAD MADE TO ORDER
CONTROLS FOR TRENCH DRAIN - MI LIMIT PURPOSES ONLY -- GROUND FAULT PROTECTION 4 CONTACTORS SUPPLIED BY OTHERS			
1	EA	EC-T5	PIPE, SLAB, OR AMBIENT SENSING ELECTRONIC THERMOSTAT C/U 25 FT THERMISTOR

ACOUSTIC NOTES:

1. THE POWER TRANSFORMER LOCATED IN THE CUSTOMER OWNED SUBSTATION SHOULD BE SELECTED FOR LOW NOISE TRANSFORMER CORES SHOULD BE INTERNALLY ISOLATED WITH SPRINGS OR NEOPRENE-IN-SHEAR MOUNT. ISOLATED 150mm HOUSE KEEPING POURED ON 50mm THICK UNDERLAY (1 LAYER OF ISO-SEP 40 OR 2 LAYERS OF DURACOUSTIC) SHOULD BE INCLUDED BELOW THE UNIT. SHALL BE INSTALLED BELOW THE TRANSFORMER AND ASSOCIATED SWITCHGEAR. AND THE SPRINGS OR MOUNTS SHOULD BE SELECTED FOR A MINIMUM OF 6MM DEFLECTION UNDER THE WEIGHT OF THE CORE.
2. THE INCOMING DUCT BANK MUST BE WELL ISOLATED AT ANY POINTS OF SUSPENSION FROM UNDERSIDE OF THE GROUND FLOOR SLAB OR ANY SHEAR WALLS. USING RUBBER COMPRESSION MOUNTS IN SERIES WITH THE RODS SUPPORTING THE UNISTRUT ASSEMBLIES TO WHICH THE CABLES OR CONDUITS ARE ATTACHED. OR RUBBER PADS OR SLEEVES IN PLACE. THIS ISOLATION LAYER SHALL BE INCLUDED BELOW THE HOUSE KEEPING PAD FOR THE SWITCHGEAR.
3. ALL CONDUITS OR CABLES THAT ARE SUSPENDED FROM THE GROUND FLOOR SLAB ABOVE SHOULD BE VIBRATION ISOLATED AT ANY POINT OF SUSPENSION FROM THE STRUCTURE USING RUBBER COMPRESSION MOUNTS IN SERIES WITH THE RODS SUPPORTING THE UNISTRUT ASSEMBLIES TO WHICH THE CABLES OR CONDUITS ARE ATTACHED. IN A MANNER SIMILAR TO THAT DESCRIBED ABOVE. CONDUITS OR CABLES FOR THESE TRANSFORMERS SHOULD NOT BE BURIED IN THE GROUND FLOOR SLAB. BUT SURFACE MOUNTED TO FACILITATE ISOLATION FROM THE BUILDING STRUCTURE. TO PREVENT BRIDGING OF THE ISOLATION PADS THROUGH CONDUIT CONNECTION.
4. SMALL TO MEDIUM TRANSFORMERS (30kVA, 45kVA to 75kVA) LOCATED IN PI AND ON THE BOILER ROOM AT 9TH FLOOR. (HANG TRANSFORMERS) PADS LOCATED BETWEEN THE CASING AND THE UNISTRUT. OR CAN BE INCLUDED IN THE RODS). ALL TRANSFORMERS ARE TO BE ISOLATED ON DOUBLE-LAYER RUBBER PADS (25mm THICK, 50 DUROMETER MAXIMUM).
5. THE GENERATOR SHALL BE LOCATED ON A 100mm THICK HOUSEKEEPING CONCRETE PAD ABOVE THE FLOATING FLOOR. THE GENERATOR SUPPORTED FROM THIS HOUSEKEEPING PAD WITH SPRING ISOLATORS HAVING A NORMAL 25mm STATIC DEFLECTION. WITH RIBBED RUBBER PADS UNDER THE SPRING BASE. THE FLOATING FLOOR ITSELF SHOULD CONSIST OF A 100MM THICK CONCRETE SLAB. WITH BATT INSULATION IN THE CAVITY BELOW AND ISOLATION PADS THAT ARE MINIMUM 50MM THICK. SIZED AND SPACED TO ACHIEVE A FUNDAMENTAL FREQUENCY OF 8Hz OR LESS.
6. BACK TO BACK ELECTRICAL OUTLETS ARE TO BE AVOIDED IN SUITE DEMISING WALLS. THEY SHOULD BE STAGGERED BY. A MINIMUM OF 1' (300MM) IN CONCRETE WALLS) OR ONE 1 STUD SPACE (IN DRYWALL). TO PREVENT REDUCING THE SOUND INSULATION PERFORMANCE OF THOSE WALLS. THIS ALSO APPLIES TO COMMUNICATIONS OUTLETS AND FIRE ALARM SUPPRESSION SWITCHES. IF THESE ARE TO BE INCLUDED IN THIS DEVELOPMENT.
7. CONDUITS SHOULD INCLUDE A LENGTH. PREFERABLY A FULL TURN COIL. BETWEEN THE EQUIPMENT AND LOW VOLTAGE CONDUIT. PRIOR TO THE CAST-IN-SLAB FEED AND SHALL BE SUPPORTED VIA HANGERS WITH NEOPRENE PADS.
8. ALL OUTDOOR RECEPTACLES SHALL BE WEATHERPROOF (LEGRADE CAT# 1332TRUR-GRY FOR NON-GFCI AND CAT# 1591TRUR-GRY FOR GFCI) AND SHALL BE EQUIPPED WITH A WHILE IN USE CAST ALUMINUM COVERPLATE (LEGRADE CAT# UUCAST) COVERPLATE.

KEY NOTES:

① ELECTRICAL CONTRACTOR TO PROVIDE CONCRETE ENCASED DUCT BANKS AND TO VERIFY ON SITE EXACT LOCATION AND DEPTH OF HV CABLES FOR MATCH-UP WITH HV DUCTS AT PROPERTY LINE. INSTALLATION OF HV CABLES AND TERMINATION ARE DONE BY TORONTO HYDRO.

② ELECTRICAL CONTRACTOR SHALL PROVIDE 6-3" DUCTS FOR TELECOMMUNICATION SERVICES FROM THE BUILDING UP TO PROPERTY LINE. INSTALLATION OF CABLES AND TERMINATION UP TO THE PROPERTY LINE ARE DONE BY THE ELECTRICAL CONTRACTOR. TELECOMMUNICATION SERVICE PROVIDERS ARE RESPONSIBLE FOR DUCTS AND CABLING BEYOND PROPERTY LINE. DUCTS SHALL CONTINUE AS SLEEVES AS THEY PENETRATE THE GARAGE WALL.

③ DIV. 16 CONTRACTOR SHALL PAINT RED WARNING SIGNS FOR HIGH VOLTAGE DUCT BANK IN ACCORDANCE WITH LATEST TORONTO HYDRO STANDARDS.

④ ALL UNDERGROUND INSTALLATION OF ELECTRICAL DUCTS/CONDUITS SHALL COMPLY WITH THE LATEST ESA CODE RULE 12-012 (BULLETIN 12-3-B) WHICH SPECIFIES "CONTINUOUS RED PLASTIC MARKER TAPES WITH BLACK LETTERS IDENTIFYING THE POWER LINE UNDERGROUND INSTALLATION.
I) PLACED APPROXIMATELY HALF WAY BETWEEN THE INSTALLATION AND GRADE LEVEL.
II) INSTALLED COVERING THE WIDTH OF THE INSTALLATION. AND
III) WHERE MULTIPLE MARKER TAPES ARE REQUIRED TO COVER THE WIDTH OF THE INSTALLATION MARKER TAPES SHALL BE PERMITTED TO BE PLACED A MAXIMUM OF 600mm APART.

⑤ RUN 1" CONDUIT TO GENERATOR CONTROL PANEL AND CACF ROOM FROM INCOMING GAS STATION CONTROL VALVE.

⑥ ELECTRICAL CONTRACTOR SHALL KEEP MINIMUM CLEARANCE OF 600mm HORIZONTAL AND 300mm VERTICAL BETWEEN SERVICES GAS LINE AND HYDRO DUCT BANK.

#13313	8	ISSUED FOR S.I. E-8	
08/17/15	7.1	ISSUED FOR S.I. E-9 (LIGHTING ADDENDA#1)	S.T.
07/27/15	6	ISSUED FOR SECURITY TENDER	S.T.
07/28/15	5	ISSUED FOR S.I. E-1 - E-7	S.T.
10/31/14	4	RE-ISSUED FOR TENDER	S.T.
09/23/14	3	ISSUED FOR TENDER	S.T.
07/10/14	2	RE-ISSUED FOR PERMIT	S.T.
05/30/14	1	ISSUED FOR PERMIT	S.T.
DATE	NO.	DESCRIPTION	BY

PLANK VOID ALL PRINTS DATED PREVIOUS TO FINAL DATE ABOVE

REVISIONS

CONTRACTOR MUST CHECK AND VERIFY ALL DIMENSIONS AND CONDITIONS ON THE JOB AND REPORT DISCREPANCIES TO THE ENGINEER BEFORE PROCEEDING WITH THE WORK. THIS DRAWING IS THE PROPERTY OF THE ENGINEER AND MUST BE RETURNED UPON COMPLETION OF THE WORK.

DRAWINGS ARE NOT TO BE SCALED

NOVA TREND ENGINEERING ASSOCIATES
115 West Beaver Creek Road, Unit 31
Richmond Hill, Ontario L4B 3P1
Tel: 905 882-5445
Fax: 905 882-5447
Email: cad@novatrendeng.com

DRAWING TITLE: SITE PLAN

PROJECT TITLE: ALEXANDRA PARK
38 CAMERON STREET, BLOCK II
TORONTO ONTARIO

DRAWN BY:	CHECKED BY:	SCALE:
S.O.	S.T.	1:150
DATE: FEB. 13	PROJECT NUMBER: 1313	DRAWING NUMBER: E-1 OF

Drawing name: \\CADSERVER\Current Dwg\1313\1313 - Alexandra Park\2014\1313E - 1 (SITE PLAN).dwg Plotted: Aug 26, 2015 - 2:24pm