


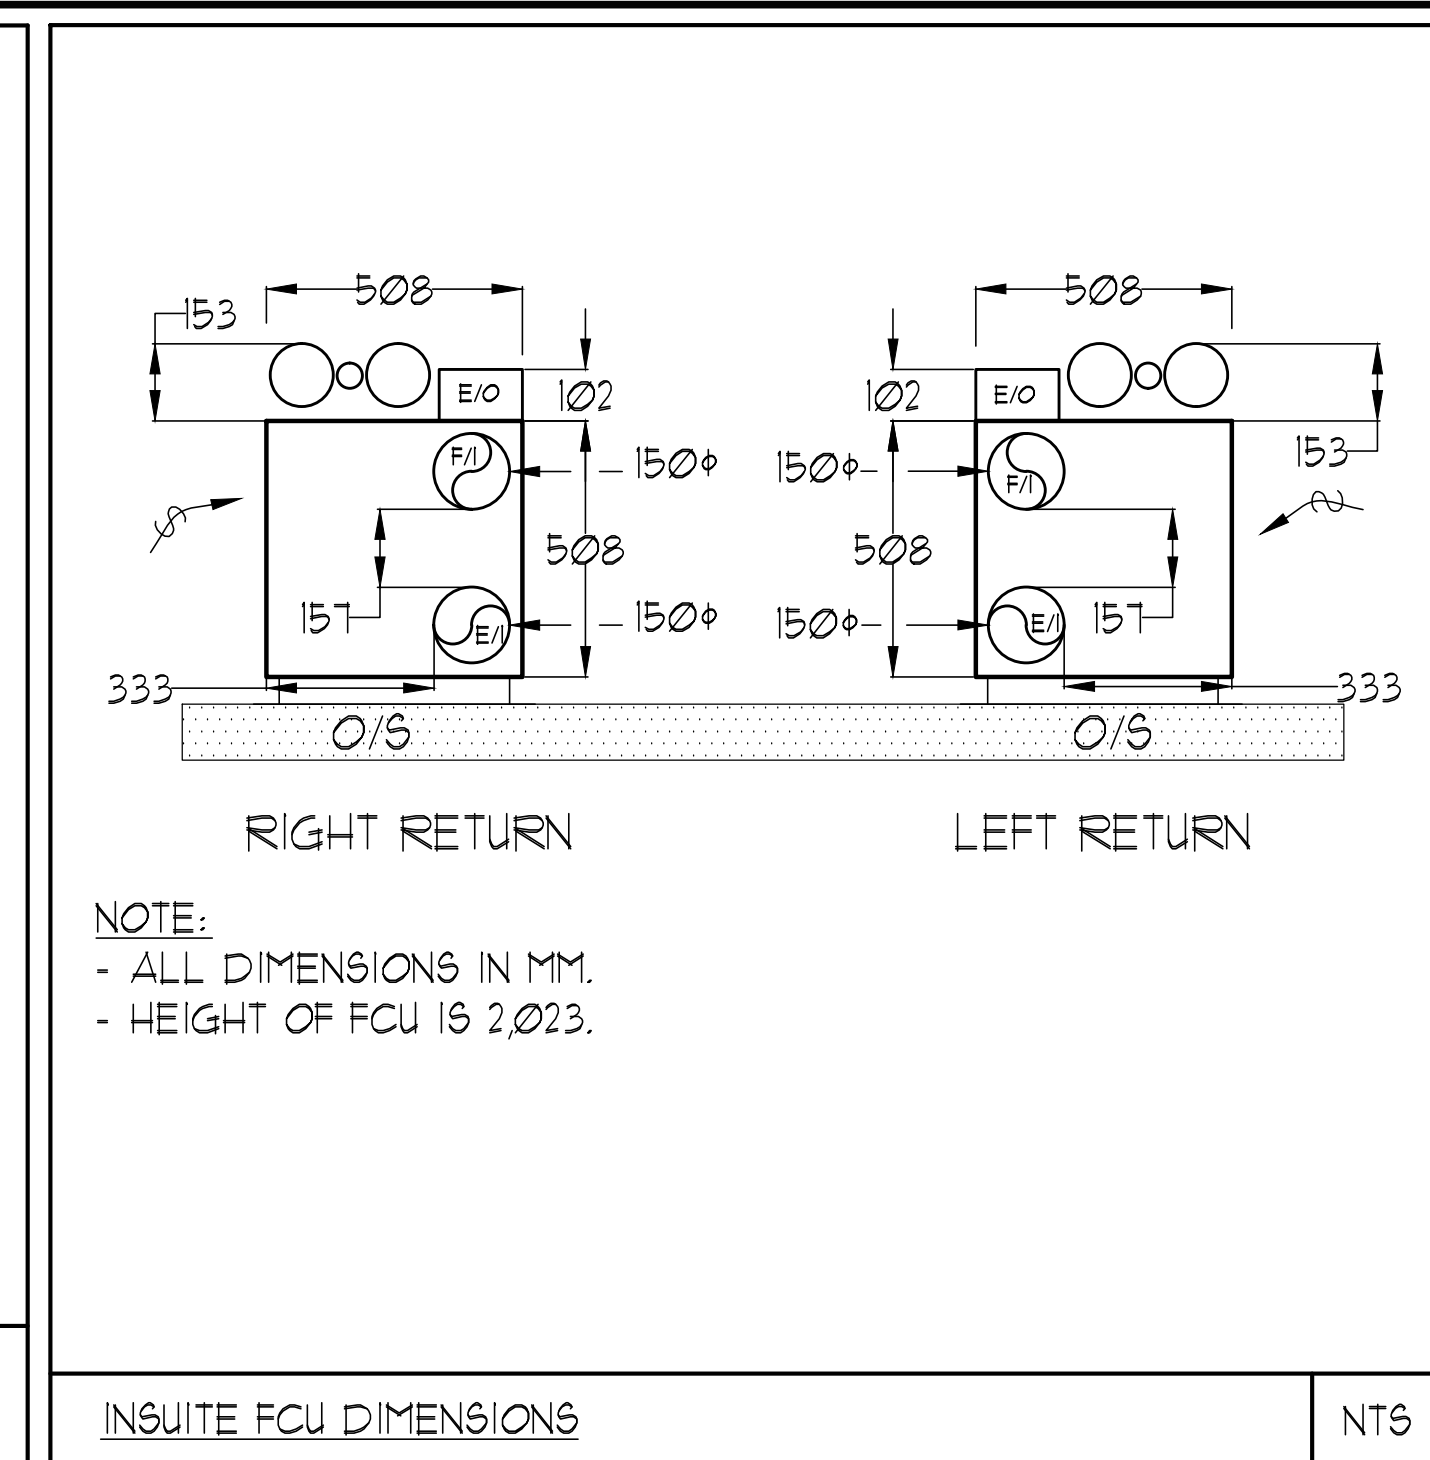

GRILLE SIZING TABLE				VERTICAL FAN COIL SIZE			
DESIGNATION	SIZE	L/S	(AIR FLOW SPECIFIED @ 0.044 W/m ²)	DESIGNATION	MODEL	W x D	
SG-A	300x100		41-10	FCU-1T	450	500x660	
SG-B	300x150		71-93	FCU-15T	600	500x660	
SG-C	400x150		94-140	FCU-2T	800	500x660	
SG-D	450x150		141-188	FCU-25T	1000	559x660	
EG-A	150x150		35	FCU-3T	1200	559x660	
W-1	225x200		210mm(L)	NOTE: A MIN. OF 125mm IS REQUIRED ON THE SIDE OF PIPE RISER.			
W-2	425x200		INSULATED				
W-3	625x200		WALL BOX				

- [illegible]

- CLEAR FLOOR TO UNDERSLAB = 2850mm
ALL UNITS CLEAR PRODUCT = 2800mm
EXCEPT UNITS: 905/908 CLEAR PRODUCT = 2700mm
UNITS 905/908/919/921: DRAINS FROM TERRACE ON 10/F

- | | | | |
|----------|-------------------------------|----------------------|----|
| 140 | CROCKET BALANCING VALVE | | |
| ----- | MULTIPLE PIPES | | |
| | - DENOTES NO. OF PIPES | | |
| 151 | TEMPERATURE SENSOR | | |
| 152 | THERMISTOR | | |
| 201 | 2-WAY MODULATING VALVE | | |
| 301 | 3-WAY MODULATING VALVE | | |
| 10 | 10 WATT THERMOWELL | | |
| | C/W 1/2" BUSHING & 1/2" PLUG | | |
| 2000 | FLOOR ELEVATION ABOVE LEVEL | | |
| 2001 | FLOOR ELEVATION THIS LEVEL | | |
| 2002 | HEADROOM (FLOOR TO US HEIGHT) | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| | | | |
| 07/01/14 | 3 | ISSUED FOR TENDER | EP |
| 07/01/14 | 7 | RE-ISSUED FOR PERMIT | EP |
| 07/01/14 | 1 | ISSUED FOR PERMIT | EP |
| DATE | NO | DESCRIPTION | BY |

