


- 1) ALL RISER ANCHORS MUST INCLUDE 25MM THICK NSN ISOLATION PADS. THE PADS ARE TO BE HELD IN PLACE WITH HORIZONTAL STEEL PLATES WELDED TO BRACKETS THAT ARE IN TURN WELDED TO THE RISER.
- 2) WHEN RISERS ARE SUPPORTED BY T-C.LAMPS RATHER THAN ANCHORS, NSN PADS ARE TO BE INCLUDED BELOW THE T-C.LAMP.
- 3) ANY PIPE GUIDES USED IN CONNECTION WITH EXPANSION JOINTS OR LOOPS ARE TO BE THE PRE-FABRICATED TYPE WITH INTEGRAL RUBBER ISOLATION.

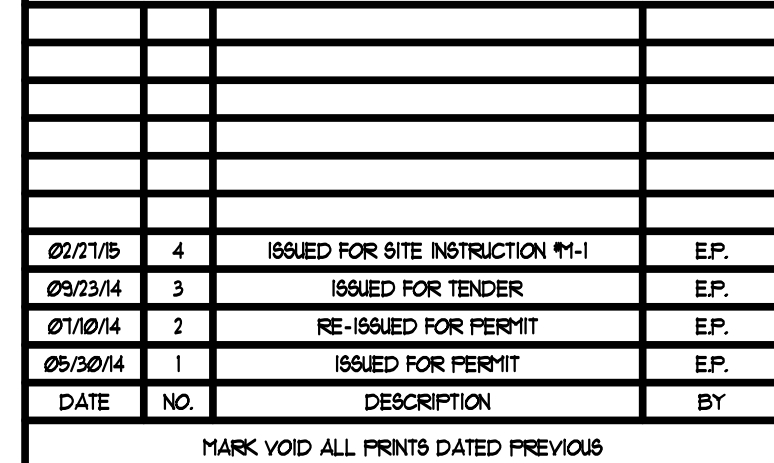

NOVA
TREND
ENGINEERING GROUP LTD

REGISTERED PROFESSIONAL ENGINEER
02/12/15
ERIC PUI KAI FUN
PROVINCE OF ONTARIO

PROJECT TITLE:
SQ ALEXANDRA PARK
BLOCK II
38 CAMERON STREET

TORONTO		ONTARIO	
DRAWN BY: G.S.	CHECKED BY: E.P.	SCALE: N.T.S.	
DATE: FEB. 13	PROJECT NUMBER: 1313	DRAWING NUMBER: M-35 OF 43	