
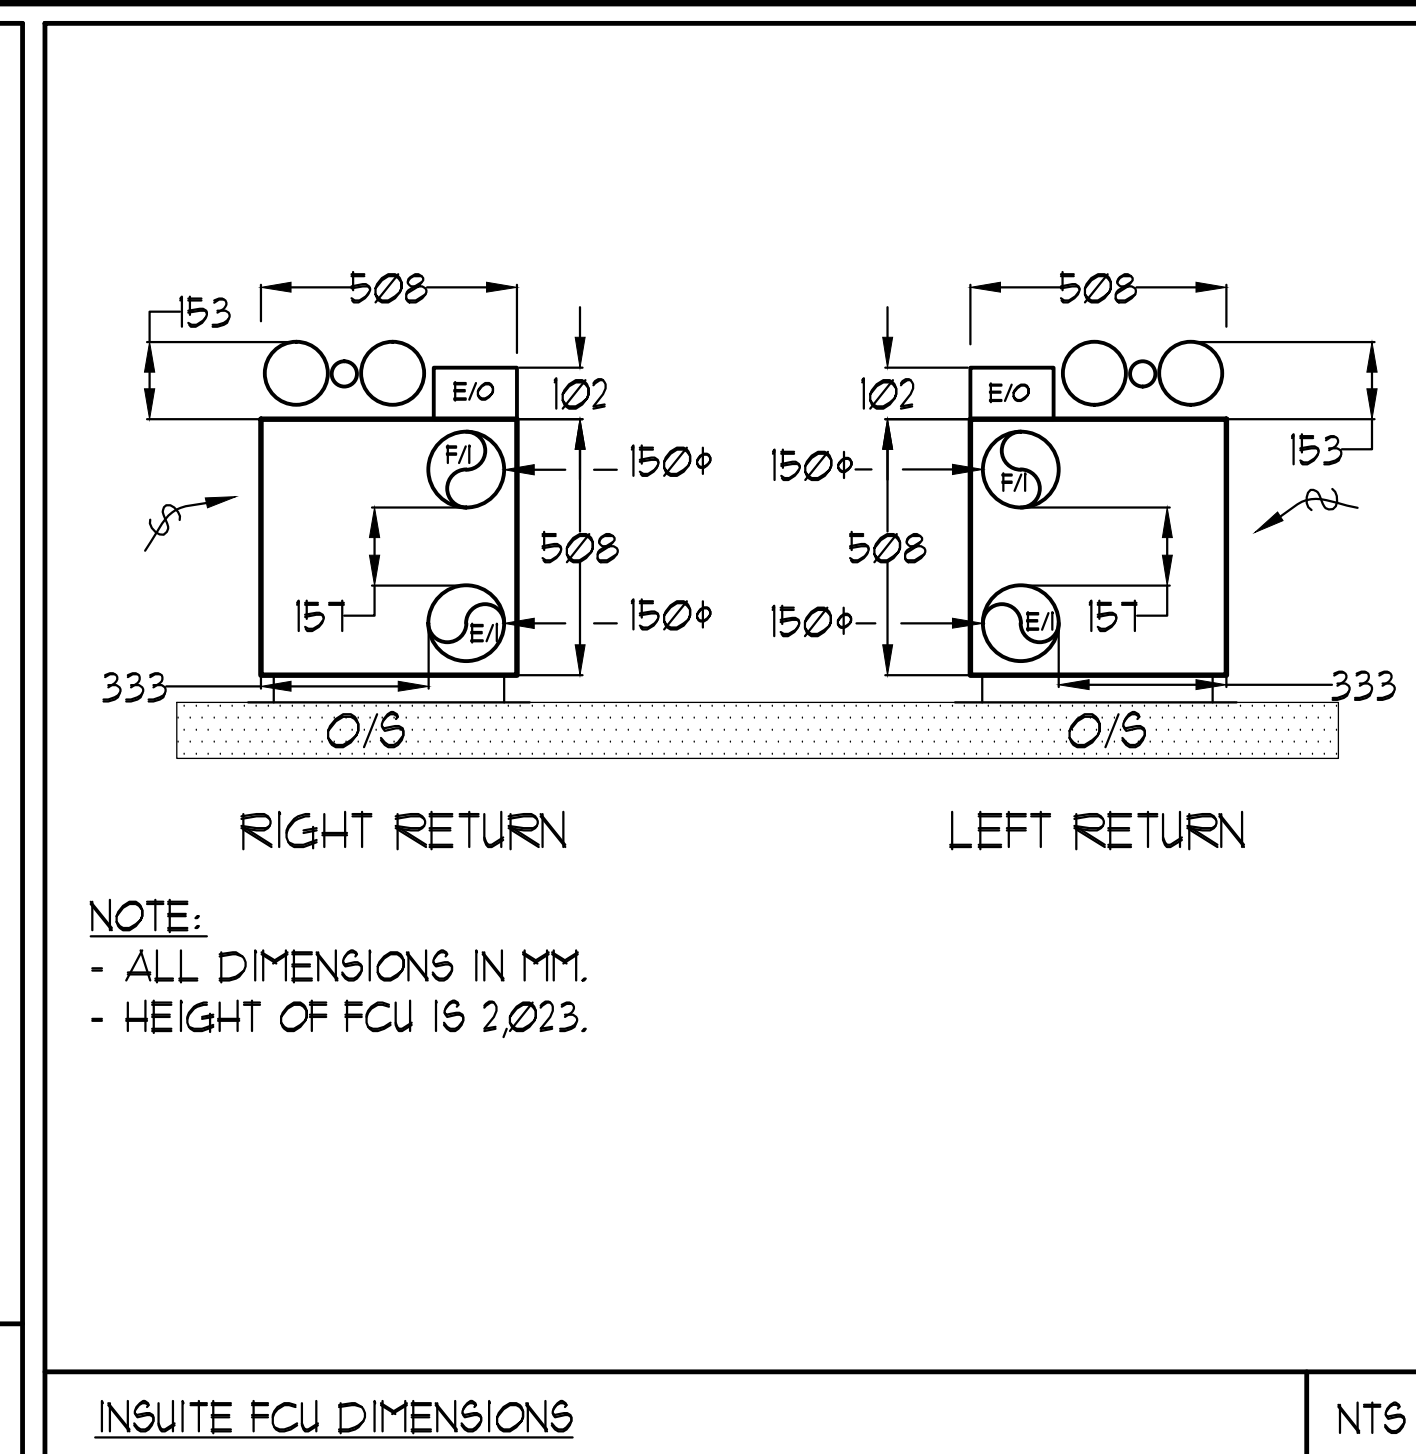


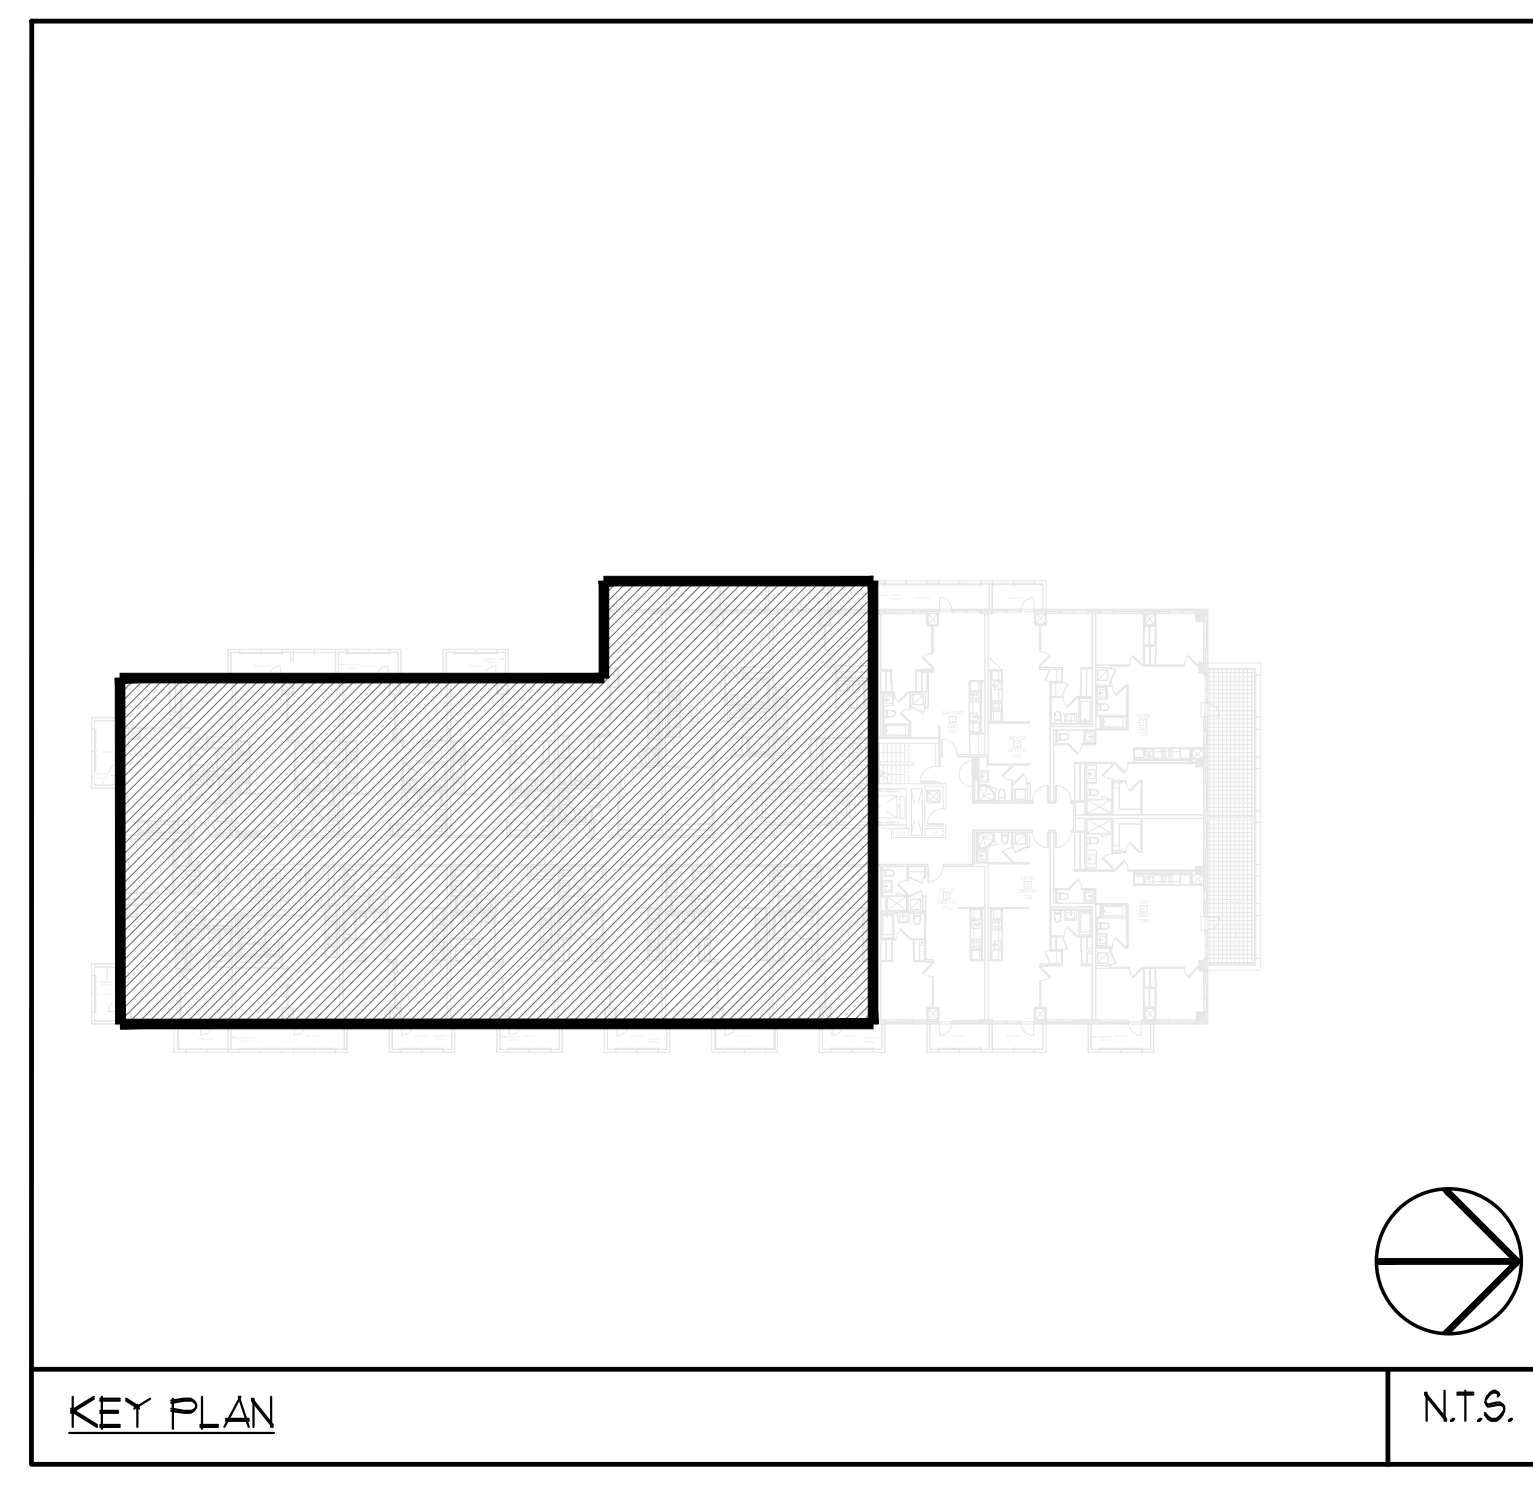

- 1) CONTRACTOR SHALL CO-ORDINATE ARCHITECTURAL, STRUCTURAL, LIGHTING, HVAC, SPRINKLER DRAWINGS TO AVOID AREAS OF CONFLICT AND TO MAINTAIN CEILING HEIGHTS.
- 2) CONTRACTOR SHALL REPORT ALL DISCREPANCIES AND AREA OF CONFLICTS TO THE ENGINEER PRIOR TO WORK BEGINS.
- 3) PROVIDE EXPANSION CHAMBERS FOR ALL KITCHEN SINKS.
- 4) SEE INSTALLATION DETAILS DRAWING FOR WASHER DCM, H4C WATER, SANITARY CONNECTION DETAILS.
- 5) SUPPLY AND INSTALL COMPLETE DOMESTIC HOT AND COLD WATER LINES, SINKING AND VENT LINES TO EACH FIXTURE, EQUIPMENT AND COLD WATER CLOSETS, LAVATORIES, BATHS, SHOWERS, KITCHEN SINK, WASHING MACHINES, DISHWASHERS, AND FLOOR DRAINS, KITCHEN SINK, LAVATORIES, WATER CLOSETS AND WASHING MACHINE TO BE C/J LOCALIZED SHUT-OFF VALVES.
- 6) ALL VENT PIPE INSTALLATION TO COMPLY WITH PLUMBING CODES.
- 7) FOR D.H.C. W. RISER SIZES, REFER TO RISER DIAGRAM.
- 8) FIRE DAMPERS ARE REQUIRED TO BE LISTED AND ARE TO HAVE FIRE PROTECTION RATING OF THE PENETRATED FIRE SEPARATION.
- 9) THE PIPING PENETRATING THE VARIOUS FIRE SEPARATION IS REQUIRED TO BE FIRESTOPPED WITH A LISTED FIRESTOPPING MATERIAL IN ACCORDANCE WITH OBC ARTICLE 3.13.1
- 10) THE FIRE HOSE CABINET THAT ARE RECESSED INTO THE EXIT STAIR SHAFTS ARE REQUIRED TO BE SEPARATED FROM THE EXIT STAIR BY A 2 HR. FIRE SEPARATION.
- 11) NO FLEXIBLE DUCT SHALL BE USED FOR ANY IN-SUITE DUCTWORK.
- 12) PROVIDE 25MM EXTERNAL INSULATION TO ENTIRE FRESH AIR DUCT FROM EXTERIOR WALL TO ERV FAN COIL UNIT.
- 13) DRYER EXHAUST DUCT SHALL BE SMOOTH AND CORROSION-RESISTANT MATERIAL. (FLEXIBLE CONNECTION IS NOT ACCEPTABLE.)

[illegible][illegible]