


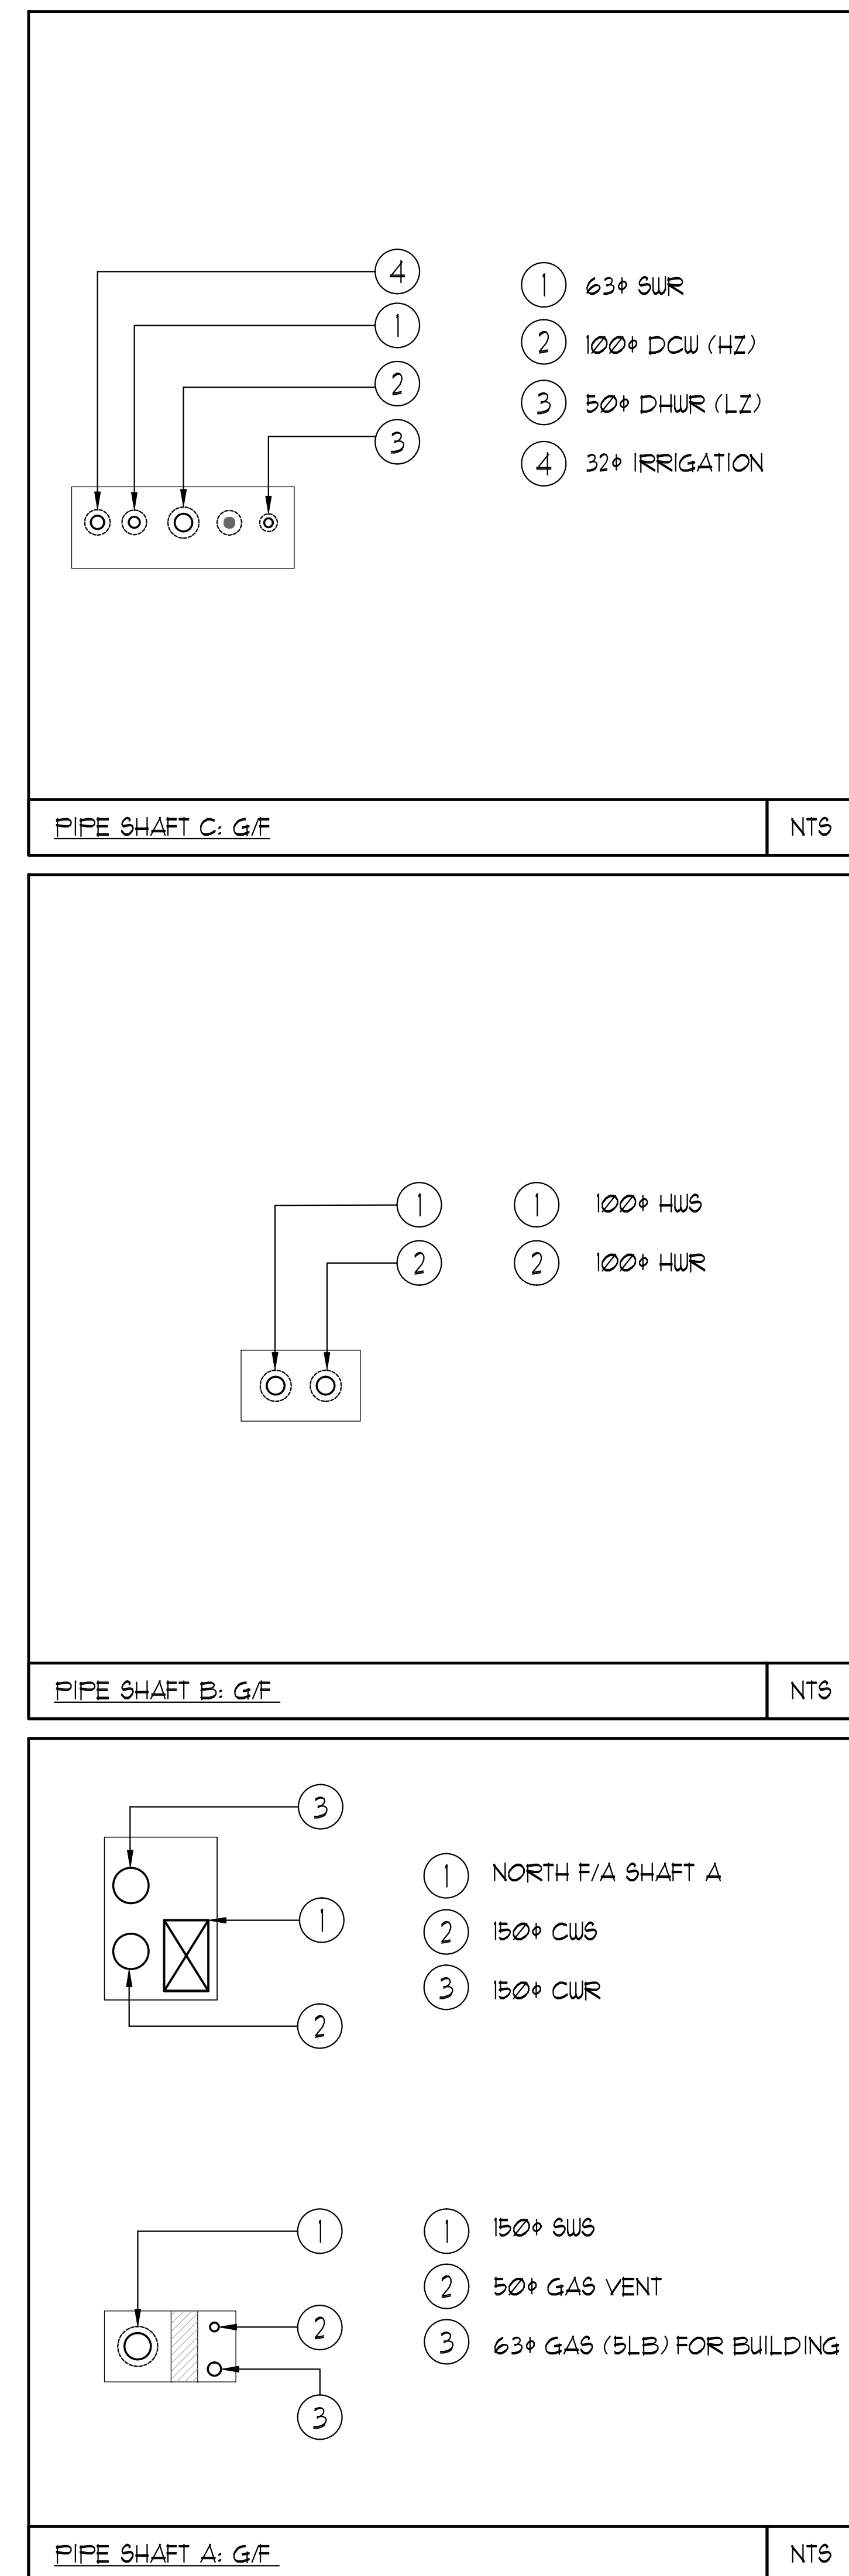

- (2) 100" SAN @ 1%.
- (3) 150" SAN @ 1%.
- (4) 200" SAN @ 1%.
- (5) 200" SAN DOWN.
- (6) 100" DCW (HZ) UP & 50" DHWR FROM PIPE RISER ABOVE.
- (7) DRAIN FOR GARBAGE ROOM TO BE 300x300 AREA DRAIN.
- (8) NOTE DELETED.
- (9) 100" DCW (HZ) & 50" DHWR (LZ)
- (10) NOTE DELETED.
- (11) NOTE DELETED.
- (12) 30" DCW (LZ) & 32" DHW (LZ).
- (13) 19" DCW & DHW DOWN TO SERVE (1) HOSEBIB FOR GARBAGE ROOM
- (14) 150" SAN UP.
- (15) 32" DCW (LZ) & 25" DHW (LZ) DOWN.
- (16) 32" DCW (LZ) & 25" DHW (LZ).
- (17) 19" DCW & 19" DHW.
- (18) NOTE DELETED.
- (19) NOTE DELETED.
- (20) DCW MANIFOLD C, SEE DCW MANIFOLD C DETAIL ON THIS DRAWING
- (21) DHW MANIFOLD D, SEE DHW MANIFOLD D DETAIL ON THIS DRAWING
- (22) 150" SAN DOWN.
- (23) 19" CONDENSATE PIPE DOWN.
- (24) 100" RWL FROM ABOVE.
- (25) 150" RWL FROM ABOVE.
- (26) 100" RWL DOWN.
- (27) 100" STM @1%.
- (28) 150" STM @1%.
- (29) 150" RWL DOWN.
- (30) 250" RWL DOWN.
- (31) 200" STM @1%.
- (32) SLEEVE THRU BEAM (TYPICAL).
- (33) TRENCH DRAIN TO BE HEAT TRACE BY DIV.16 AND INSULATE AND JACKET BY DIV.15.
- (34) STM PIPE TO BE HEAT TRACE BY DIV.16 AND INSULATE & JACKET BY DIV.15.
- (35) 32" IRRIGATION SUPPLY LINE.
- (36) 30" DCW TO SERVE MAKE UP WATER FOR IRRIGATION PUMP.
- (37) 19" DCW & 19" DHW DOWN TO SERVE NFHB.
- (38) FROM BELOW 30" FOR IRRIGATION.
- (39) 20" DCW (LZ) & 19" DHW (LZ) INSIDE HEATED FLENUM.
- (40) 19" DCW DOWN TO SERVE (1) NFHB.

[illegible]