
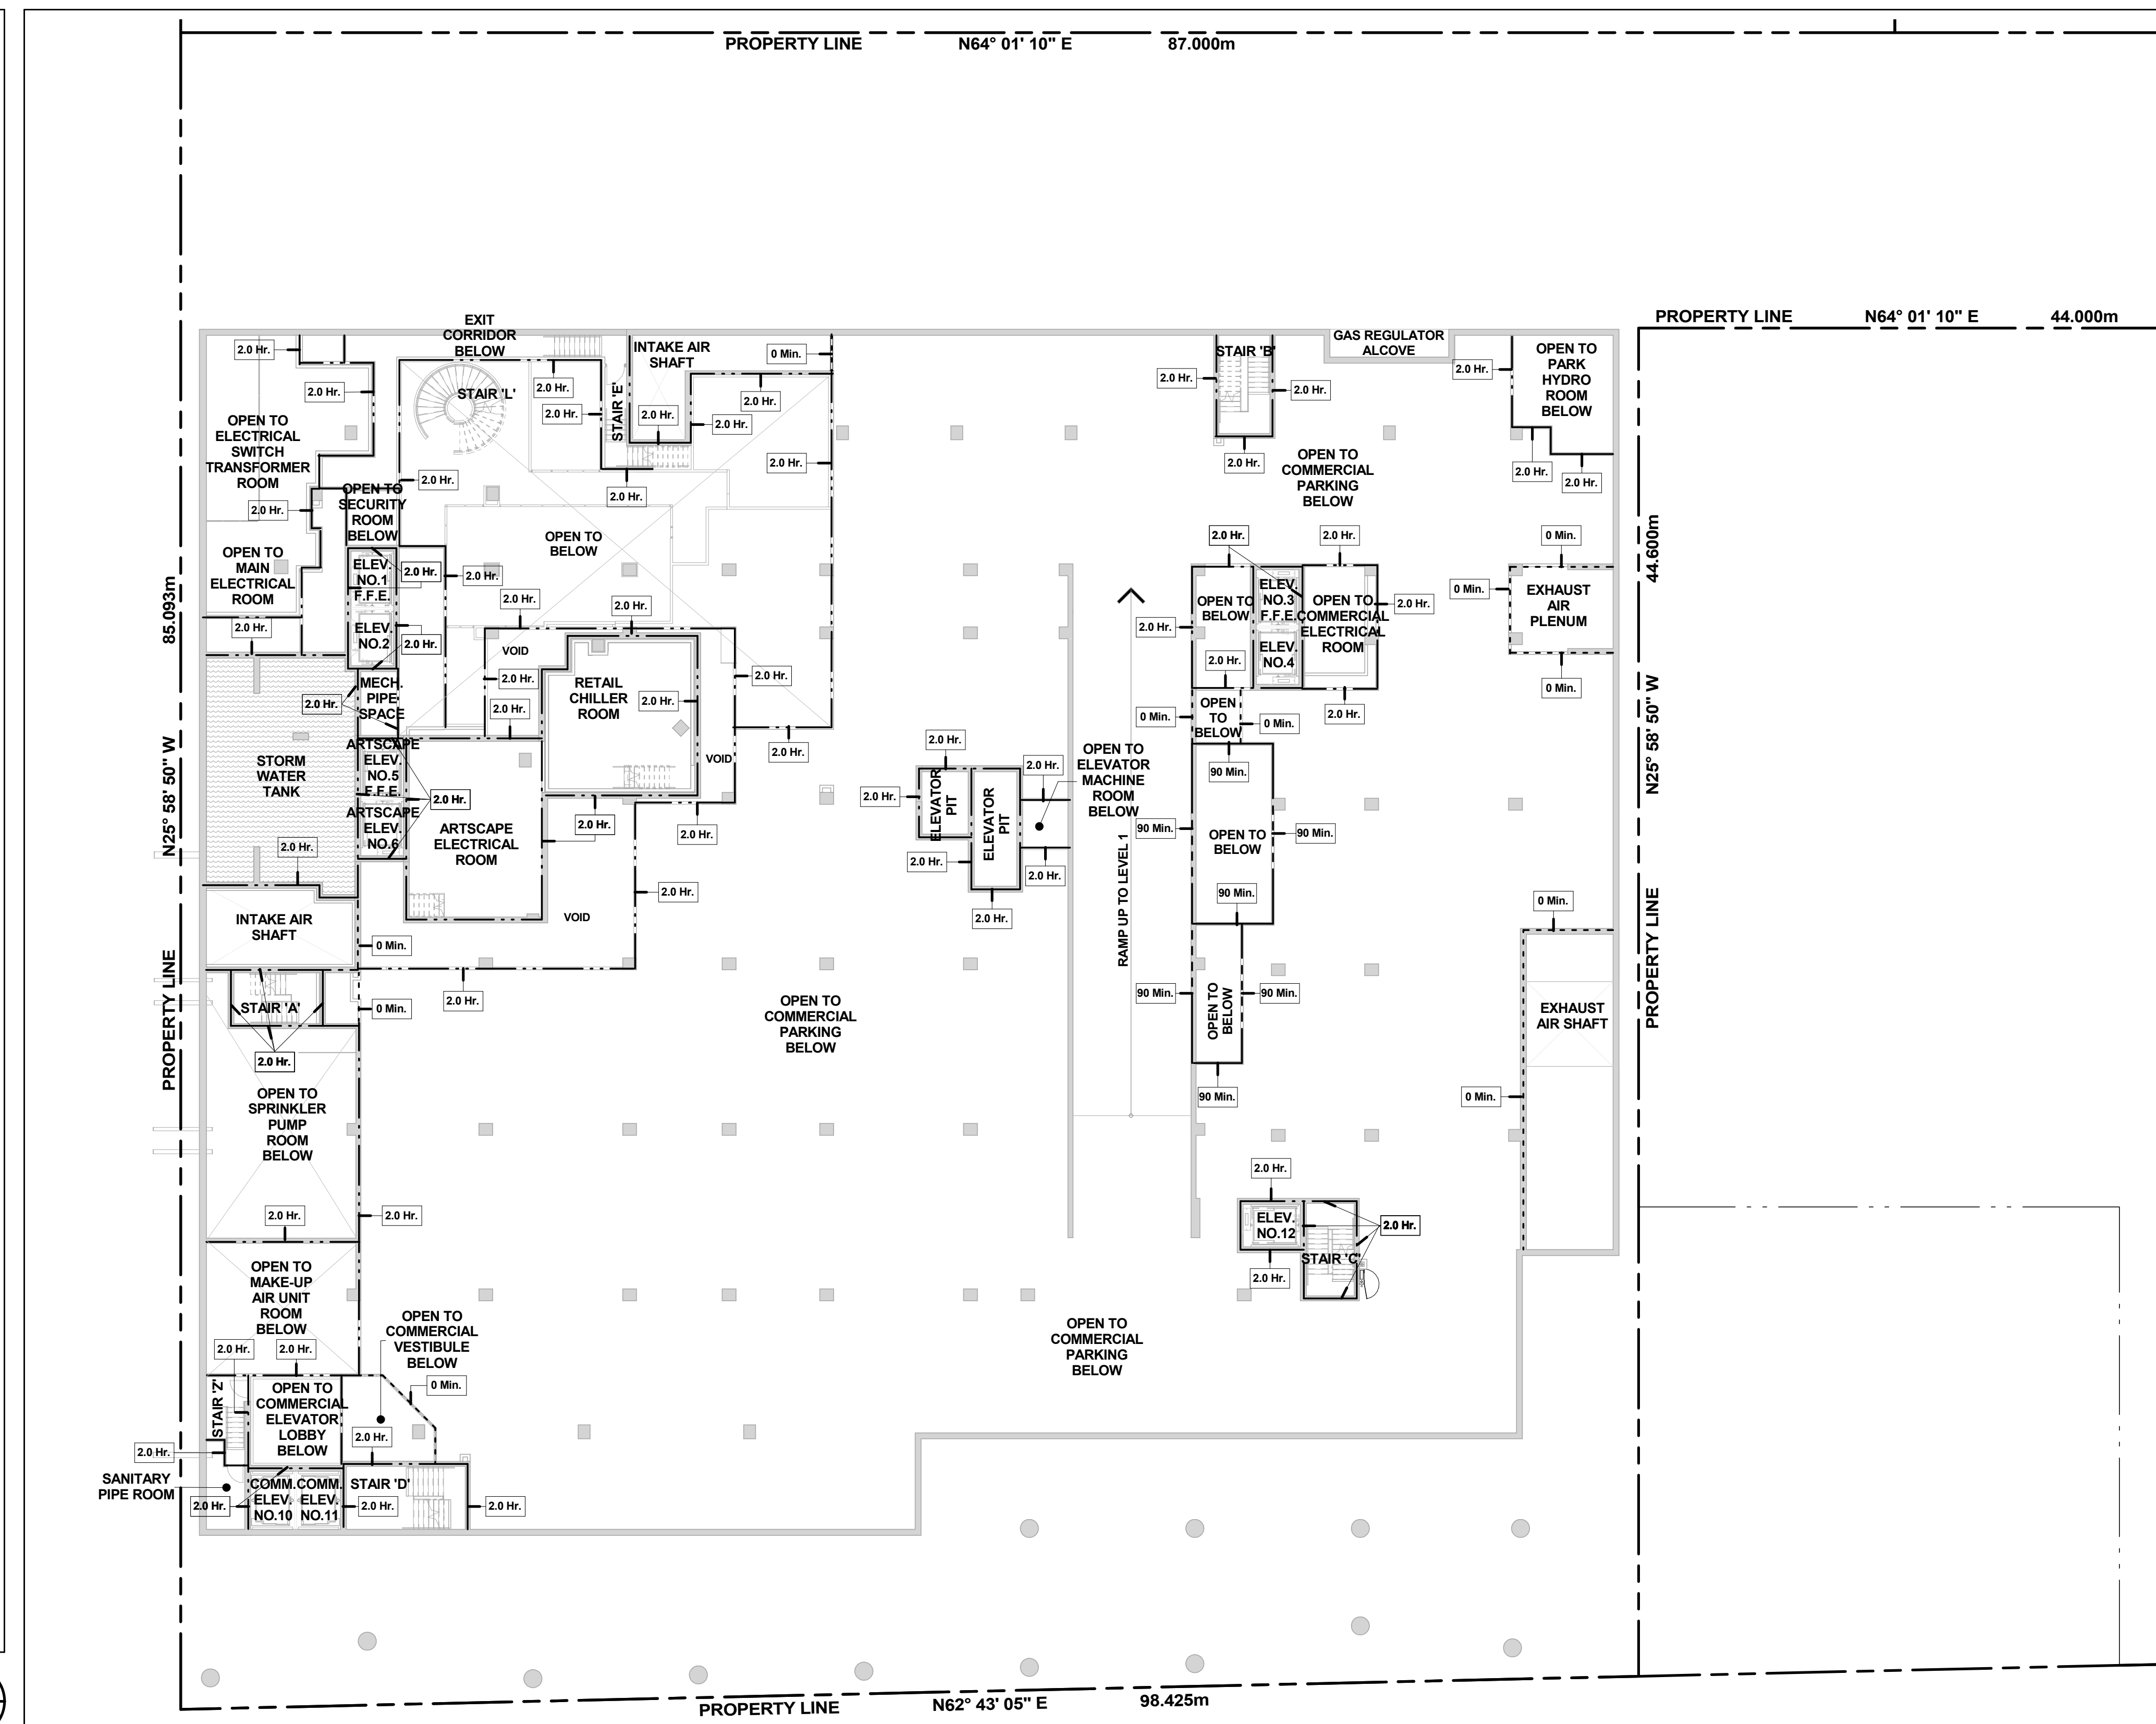
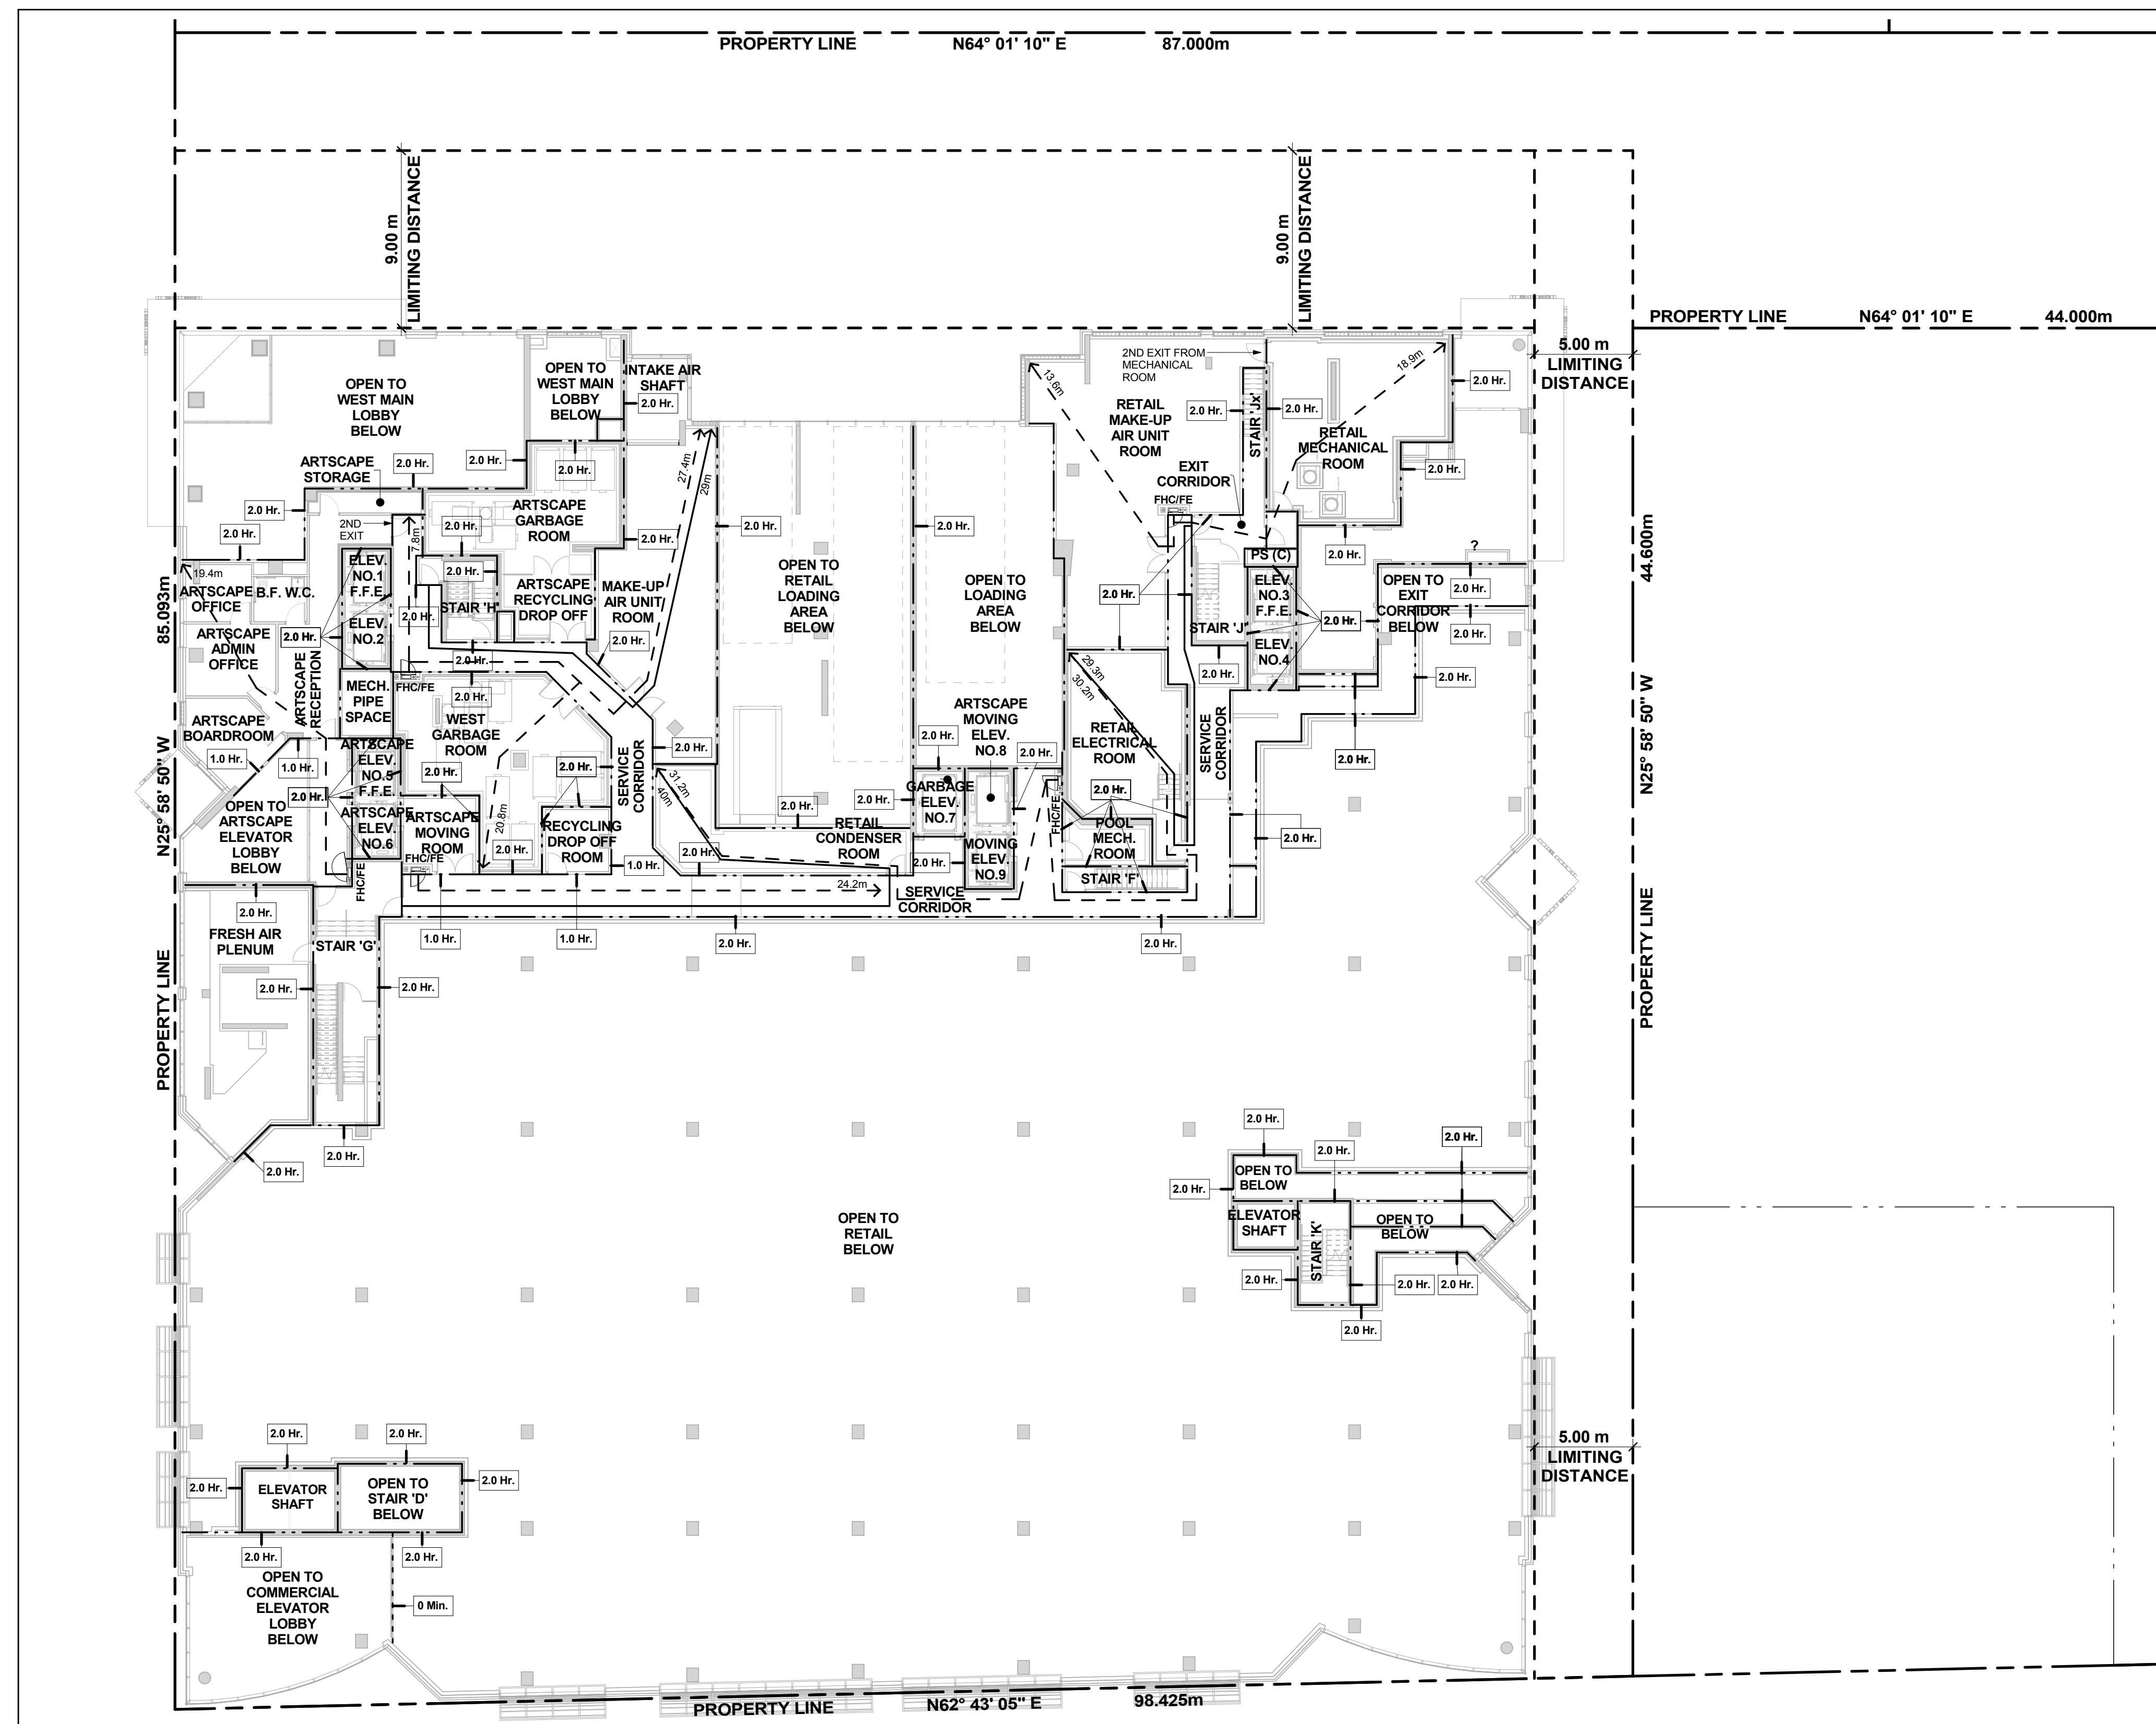
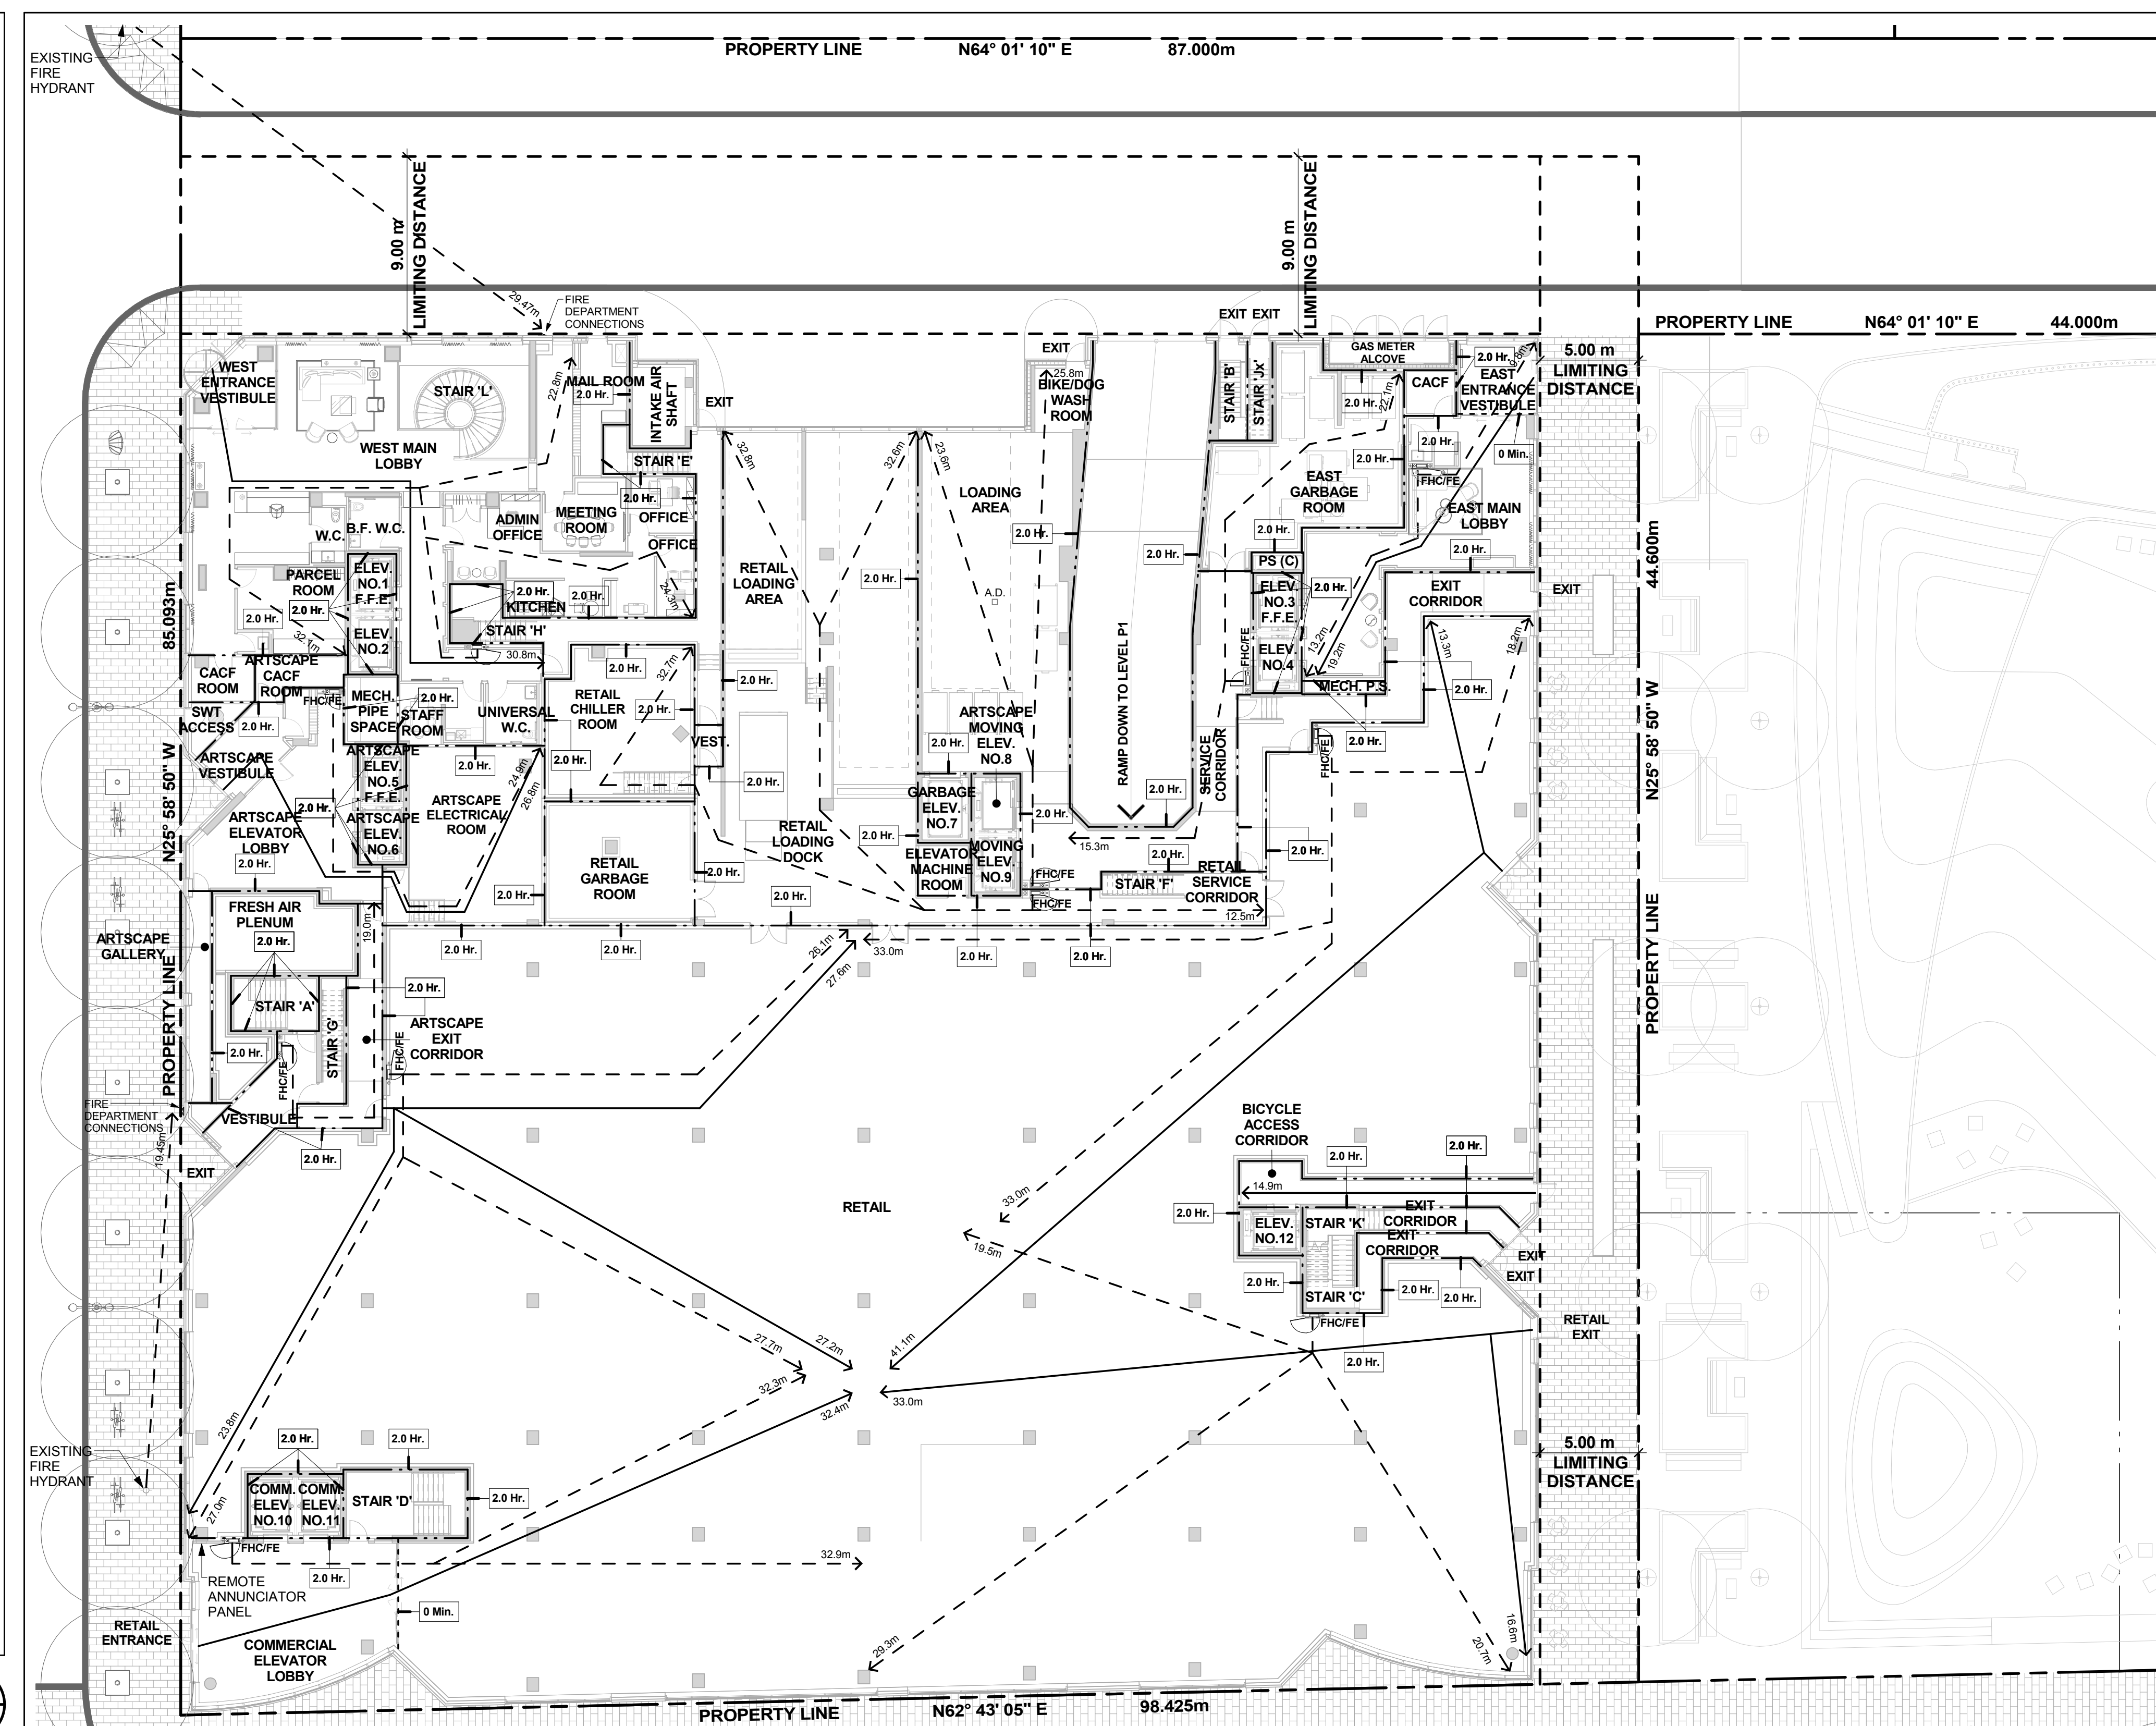


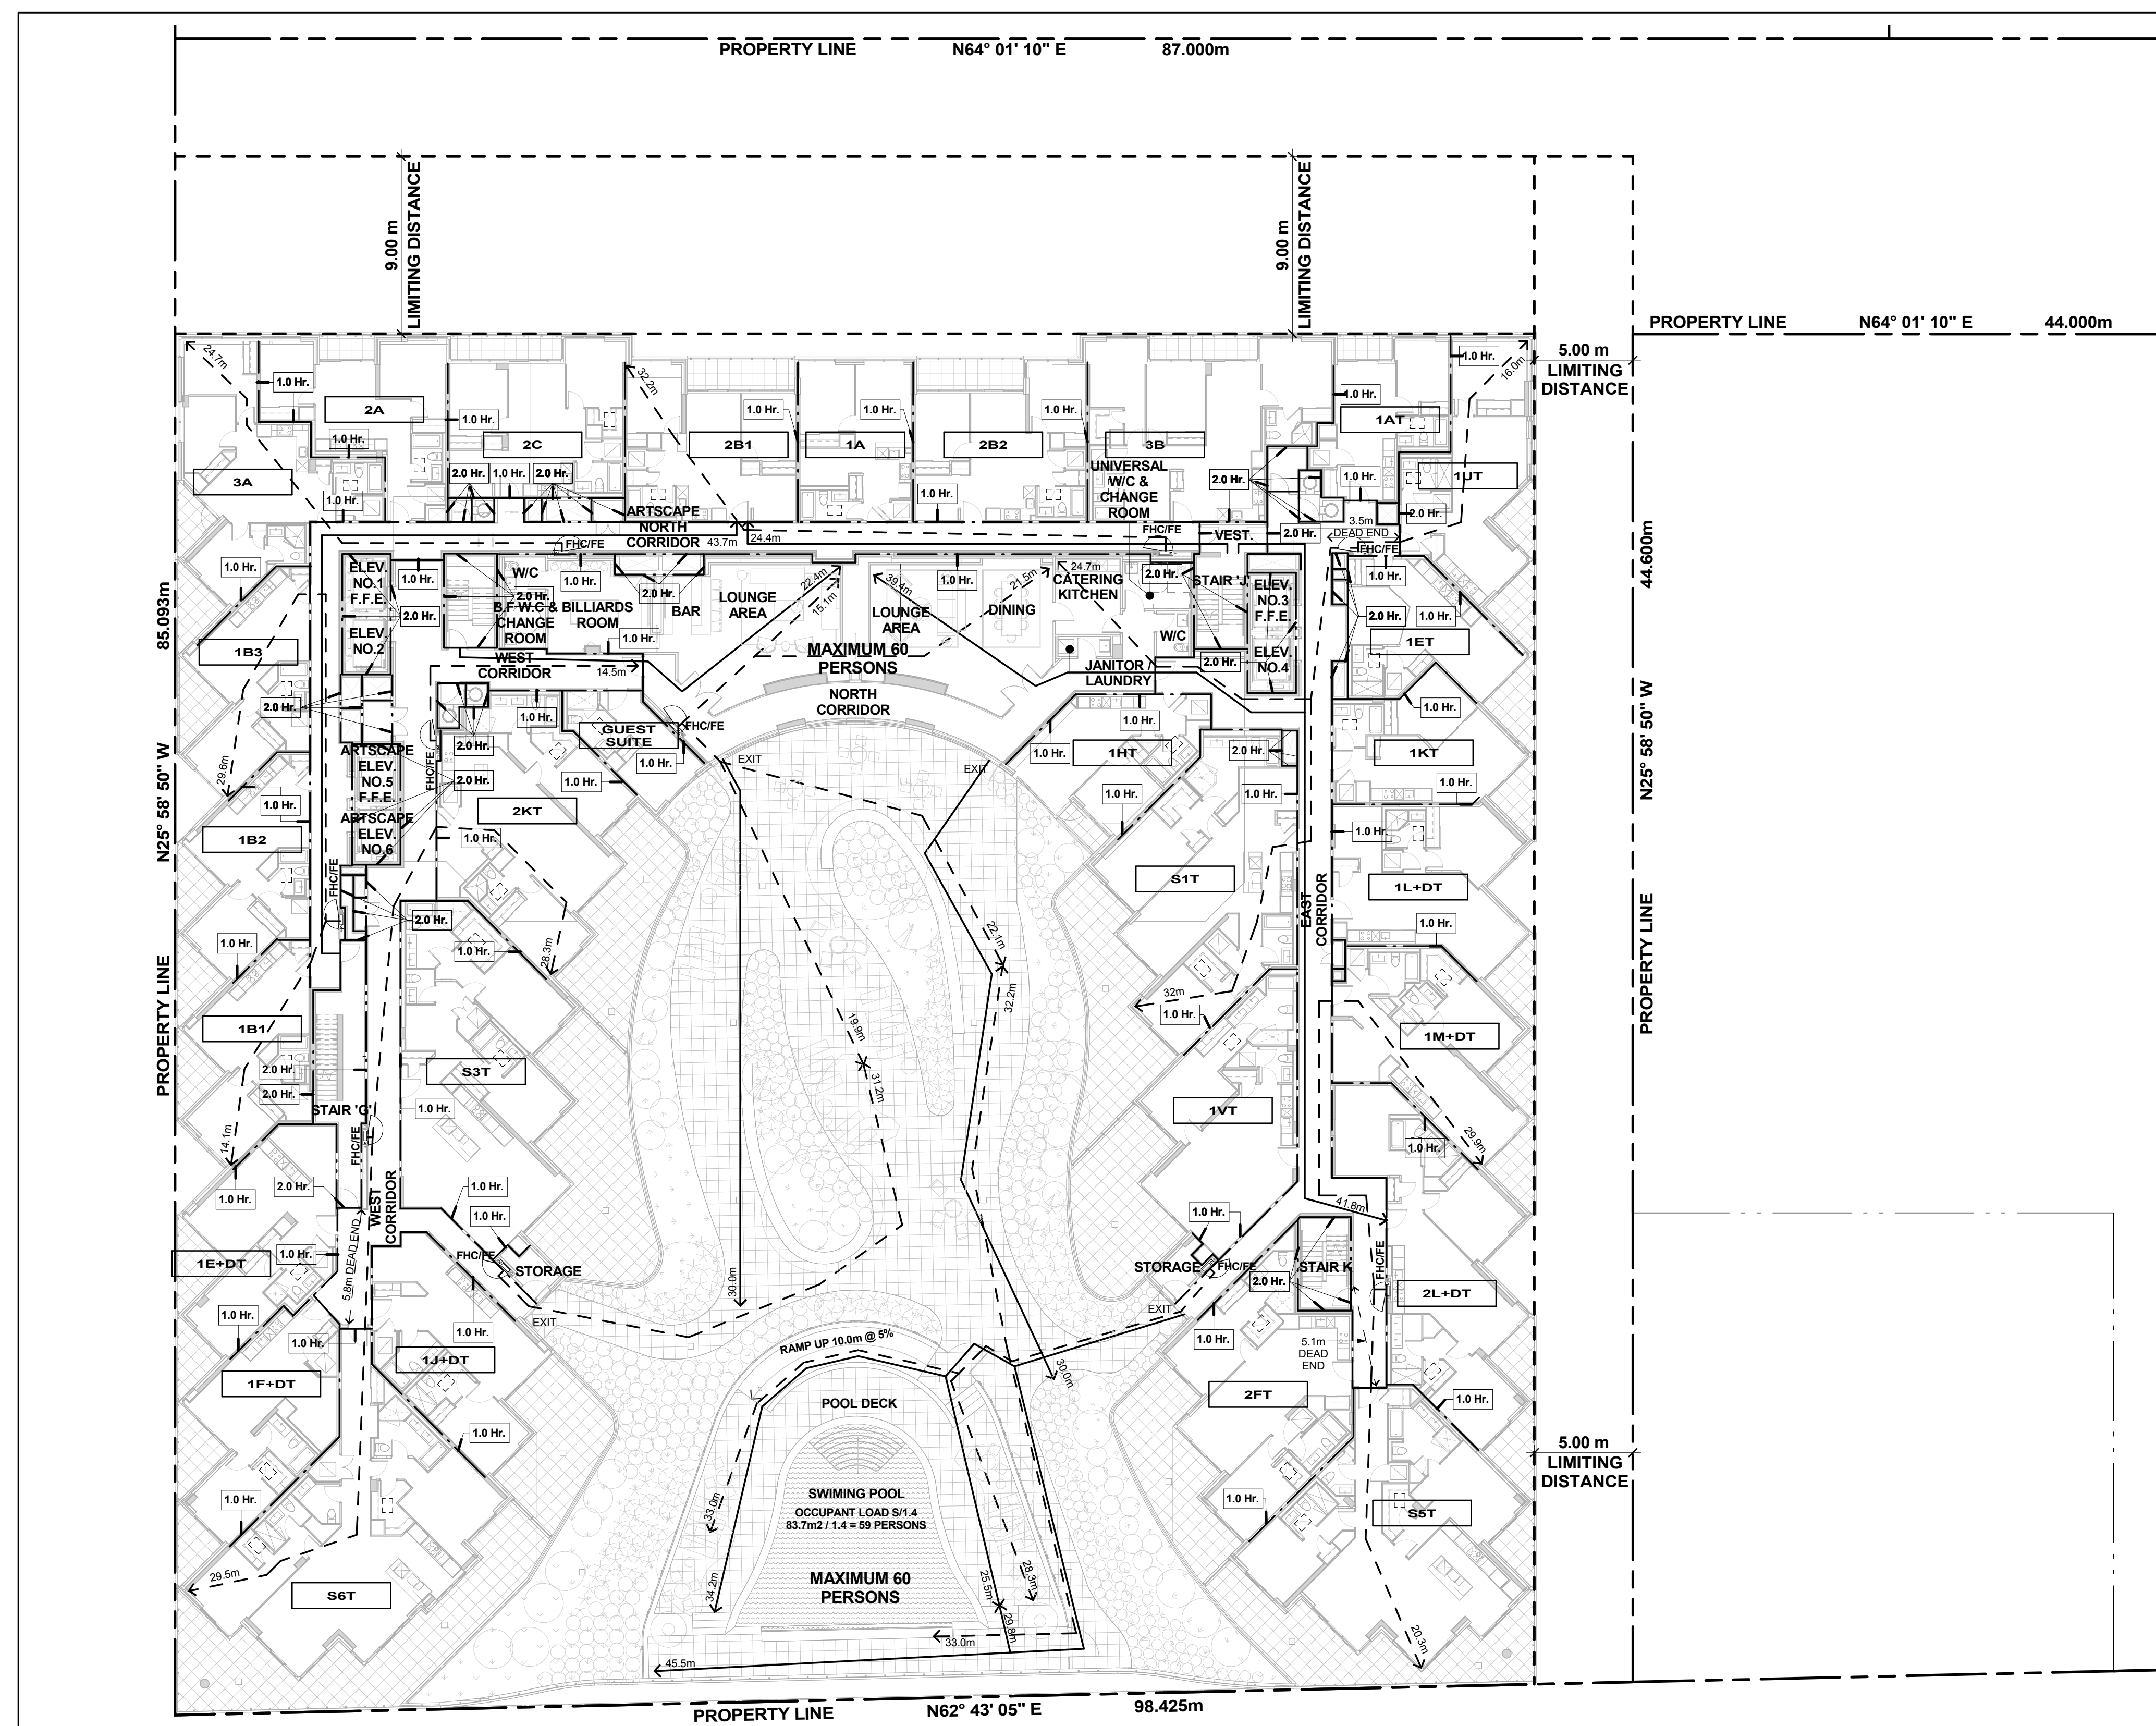

CODE COMPLIANCE LEGEND:

0 Min.	DENOTES FIRE SEPARATION HAVING A FIRE RESISTANCE RATING OF 0-MIN.
45 Min.	DENOTES FIRE SEPARATION HAVING A FIRE RESISTANCE RATING NOT LESS THAN 45 MIN.
1.5 Hr.	DENOTES FIRE SEPARATION HAVING A FIRE RESISTANCE RATING NOT LESS THAN 1 1/2 HR.
2.0 Hr.	DENOTES FIRE SEPARATION HAVING A FIRE RESISTANCE RATING NOT LESS THAN 2.0 HR.
2.2 Hr.	DENOTES FIRE SEPARATION HAVING A FIRE RESISTANCE RATING NOT LESS THAN 2 1/5 HR.
3.0 Hr.	DENOTES FIRE SEPARATION HAVING A FIRE RESISTANCE RATING NOT LESS THAN 3 HR.
XMin	DENOTES FIRE HOSE CABINET HOSE LENGTH 20' OR 30' HOSE STREAM.
XXMin	DENOTES TRAVEL DISTANCE 4 MIN. MAXIMUM.
XXMin	DENOTES DEAD END CORRIDORS 8 MIN. MAXIMUM.

WHERE DISPROPORTIONATE OCCUR BETWEEN CODE COMPLIANCE DRAWINGS AND FLOOR PLANS, CODE COMPLIANCE DRAWINGS SHALL PREVAIL.

FIRE SEPARATION AS PROVIDED BY NADRA, BROWN & ASSOCIATES

ALL OTHER WALLS NOT NOTED HAVE A FIRE RESISTANCE RATING OF 20'00 (2 HR).

[illegible]

- C. ELEVATOR SHAFT WALLS TO BE CONSTRUCTED TO ACHIEVE A MIN. FIRE RESISTANCE RATING OF 2 HRS.
- D. AN APPROVED FIRE STOP MATERIAL IS TO BE USED TO SEAL INTERSECTION TOP OF CONCRETE BLOCK AT FLOOR SLABS.

11. LOCKER ROOM NOTES:
ALL LOCKER RAILS W/EN TO BE 1500MM (TYP.) LOCKERS TO BE CONNECTED WITH 40MM WELD MESH PARTITIONS MINIMUM 2000MM HIGH PROVIDE INTER MESH DOOR AND CEILING. ALL WHEEL MOUNTS TO BE 400MM BELOW SPRINGER DERAILERS THROUGHOUT
SEVEN (7) LOCKER ROOMS W/OUT PREPARED BY ARCHITECT AND INSTALLER TO PROVIDE INSTALLATION SHOP DRAWINGS FOR REVIEW BY OWNER AND ARCHITECT

BIKE SPACE NOTES:
ALL BIKE SPACES TO COMPLY WITH TORONTO BIKEWAY STANDARDS
HORIZONTAL PARKING 2000 x 1000 x 1000
VERTICAL PARKING 2000 x 1000 x 1000

General Typical Floor Notes

1
(A1-07)