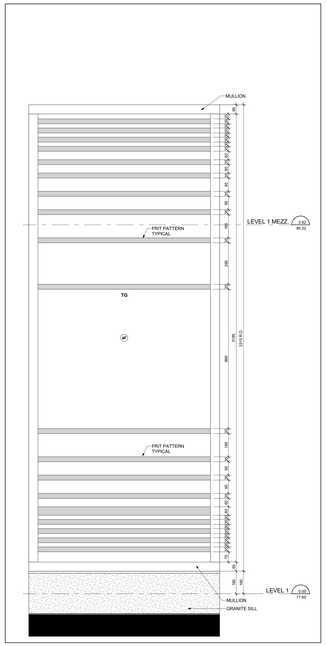

Typical Window Frit Dimentions 23 A4-06
Scale: 1 : 10

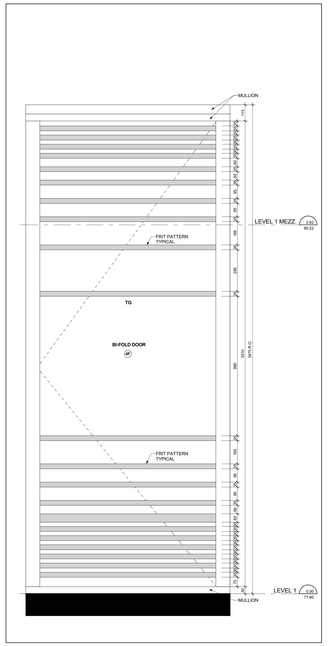

Typical Door Frit Dimentions 22 A4-06
Scale: 1 : 10

TYPICAL WINDOW SCHEDULE NOTES:

1. ADD 10MM GAP AND ALLOWANCE ON ONE OR BOTH SIDES OF WINDOW OPENING.
2. CO-ORDINATE WITH ELEVATIONS FOR FRIT PATTERN AND LOCATION.
3. CO-ORDINATE LOUVER LOCATIONS WITH MECHANICAL DRAWINGS.
4. CO-ORDINATE WITH ELEVATIONS FOR LOCATION OF ELECTRICAL OUTLETS.
5. CO-ORDINATE BALCONY/TERRACE ELECTRICAL OUTLETS WITH ELECTRICAL DRAWINGS.

OBC REQUIREMENTS

9.7.2. WINDOW STANDARDS
9.7.2.1. WINDOW STANDARD
(1) WINDOWS SHALL CONFORM TO:
(a) THE CANCGSA-A440 "NWWDA" SERIES,
(b) THE CANCSA-A440.1, "USER SELECTION GUIDE TO CSA STANDARD CANCSA-A440-S0 WINDOWS",
9.7.3. GLASS
9.7.3.1. GLASS STANDARDS
(1) GLASS SHALL CONFORM TO:
(a) CAN/CGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS",
(b) CAN/CGSB-12.2-M, "FLAT, CLEAR SHEET GLASS",
(c) CAN/CGSB-12.3-M, "FLOAT GLASS",
(d) CAN/CGSB-12.4-M, "HEAT-ABSORBING GLASS",
(E) CAN/CGSB-12.8, "INSULATING GLASS UNITS",
(f) CAN/CGSB-12.11-M, "WIRE GLASS, WIRED SAFETY GLASS",
(G) CAN/CGSB-12.11-M, "WIRED SAFETY GLASS", OR
(H) ASTM E2190, "INSULATING GLASS UNIT PERFORMANCE AND EVALUATION".
9.7.3.2. GLASS IN WINDOWS, SLOPED GLAZING
(1) GLASS IN WINDOWS, SLOPED GLAZING AND SKYLIGHTS SHALL BE DESIGNED IN CONFORMANCE WITH CANCGSB-12.20-M, "STRUCTURAL DESIGN OF GLASS FOR BUILDINGS".
9.7.4. SEALING COMPOUND
9.7.4.1. SEALING COMPOUND
(1) SEALING COMPOUND USED TO SEAL THE GLASS COMPONENT OF A FACTORY-SEALED DOUBLE-GLAZED UNIT TO THE SASH COMPONENT SHALL BE COMPATIBLE WITH THE MATERIAL USED TO EDGE SEAL THE GLASS COMPONENT.
9.7.5.4. WINDOWS ABOVE THE SECOND STOREY
(1) WINDOWS IN PUBLIC AREAS THAT EXTEND TO LESS THAN 1 000 MM FROM THE FLOOR AND ARE LOCATED ABOVE THE SECOND STOREY SHALL BE ONE OF THE FOLLOWING, OR ONE OF THE FOLLOWING:
(a) PROTECTED BY GUARDS IN ACCORDANCE WITH SUBSECTION 9.8.8., OR
(b) NON-OPENABLE AND DESIGNED TO WITHSTAND THE LATERAL DESIGN LOADS FOR GUARDS AS PROVIDED IN ARTICLES 4.1.5.15. OR
9.7.6. RESISTANCE TO FORCED ENTRY
9.7.6.1. RESISTANCE TO FORCED ENTRY
(1) IN DWELLING UNITS, WINDOWS, ANY PART OF WHICH IS LOCATED WITHIN 2 000 MM OF ADJACENT GROUND LEVEL, SHALL CONFORM TO THE REQUIREMENTS FOR RESISTANCE TO FORCED ENTRY AS DESCRIBED IN CLAUSE 13.19 OF CAN/CSA-A440.2M, "WINDOWS".

9.8.8.1. REQUIRED GUARDS
(1) EXCEPT AS PROVIDED IN SENTENCES (2) AND (3), EVERY SURFACE TO WHICH ACCESS IS PROVIDED FOR OTHER THAN MAINTENANCE PURPOSES, INCLUDING BUT NOT LIMITED TO LIGHTS OF STEPS AND RAMPS, EXTERIOR LANDINGS, PORCHES, BALCONIES, GALLERIES AND RAISED, SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL FOR THE LENGTH WHERE
(a) THE VERTICAL DISTANCE BETWEEN THE ADJACENT SURFACE AND THE ADJACENT SURFACE OR GROUND BELOW THE ADJACENT SURFACE, OR
(b) THE ADJACENT SURFACE WITHIN 1.2 m FROM THE WALKING SURFACE HAS A SLOPE OF MORE THAN 1 IN 2.
(2) GUARDS ARE NOT REQUIRED,
(a) ON THE FRONT STOOP,
(b) AT FLOOR PITS IN REPAIR GARAGES, OR
(c) WHERE ACCESS IS PROVIDED FOR MAINTENANCE PURPOSES ONLY.
(3) EXCEPT AS PROVIDED IN SENTENCE (4), GUARDS SHALL BE PROVIDED FOR RAMP RISES MORE THAN 400 MM, THE SIDES OF THE STAIR OR RAMP AND THE LANDING OR FLOOR LEVEL AROUND THE STAIRWELL OR RAMP SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL.
9.8.8.2. GUARD HEIGHTS
(1) EXCEPT AS PROVIDED IN SENTENCES (2) TO (4), ALL GUARDS SHALL BE NOT LESS THAN 1 070 MM HIGH.
(2) ALL GUARDS WITHIN DWELLING UNITS SHALL BE NOT LESS THAN 900 MM HIGH.
(3) EXCEPT AS PROVIDED IN SENTENCE (4), GUARDS ON THE SIDE OF A RAMP SHALL BE NOT LESS THAN 900 MM HIGH WHERE THE WALKING SURFACE SERVED BY THE GUARD IS NOT MORE THAN 1 800 MM ABOVE THE FINISHED GROUND LEVEL.
(4) GUARDS FOR FLIGHTS OF STEPS, EXCEPT IN REQUIRED EXIT STAIRS, SHALL BE NOT LESS THAN 865 MM HIGH.
(5) THE HEIGHT OF GUARDS FOR FLIGHTS OF STEPS SHALL BE MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE LEADING EDGE OF THE TREADS SERVED BY THE GUARD.
9.8.8.7. GLASS IN GUARDS
(1) GLASS IN GUARDS SHALL BE:
(a) SAFETY GLASS OF THE LAMINATED OR TEMPERED TYPE CONFORMING TO CANCGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS", OR
(b) WIRED GLASS CONFORMING TO CANCGSB-12.11-M, "WIRED SAFETY GLASS".

12.3.1.11. WINDOWS AND GLAZING
(1) EXCEPT AS PROVIDED IN SENTENCES (2) AND (3), WINDOWS AND ALL GLAZING THAT SEPARATES HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL CONFORM TO SENTENCES (2) TO (7) AND (9) TO (12).
(2) EXCEPT WHERE SHALL CONFORM TO SENTENCE (11), THE TOTAL AREA OF GLAZING, INCLUDING GLAZING FOR DOORS AND SKYLIGHTS, SHALL BE NOT MORE THAN 15% OF THE FLOOR AREA OF THE ROOM OR SPACE, THE TOTAL AREA OF GLAZING, INCLUDING GLAZING FOR DOORS AND SKYLIGHTS, THE LESSER OF
(a) 15% OF THE ADJACENT SURFACE WITHIN 1.2 m FROM THE WALKING SURFACE AND A SLOPE OF MORE THAN 1 IN 2,
(b) GUARDS ARE NOT REQUIRED,
(c) EXTERIOR WALL, OR
(d) AT FLOOR PITS IN REPAIR GARAGES, OR
(c) WHERE ACCESS IS PROVIDED FOR MAINTENANCE PURPOSES ONLY.
(3) EXCEPT AS PROVIDED IN SENTENCE (4), GUARDS SHALL BE PROVIDED FOR RAMP RISES MORE THAN 400 MM, THE SIDES OF THE STAIR OR RAMP AND THE LANDING OR FLOOR LEVEL AROUND THE STAIRWELL OR RAMP SHALL BE PROTECTED BY A GUARD ON EACH SIDE THAT IS NOT PROTECTED BY A WALL.
9.8.8.2. GUARD HEIGHTS
(1) EXCEPT AS PROVIDED IN SENTENCES (2) TO (4), ALL GUARDS SHALL BE NOT LESS THAN 1 070 MM HIGH.
(2) ALL GUARDS WITHIN DWELLING UNITS SHALL BE NOT LESS THAN 900 MM HIGH.
(3) EXCEPT AS PROVIDED IN SENTENCE (4), GUARDS ON THE SIDE OF A RAMP SHALL BE NOT LESS THAN 900 MM HIGH WHERE THE WALKING SURFACE SERVED BY THE GUARD IS NOT MORE THAN 1 800 MM ABOVE THE FINISHED GROUND LEVEL.
(4) GUARDS FOR FLIGHTS OF STEPS, EXCEPT IN REQUIRED EXIT STAIRS, SHALL BE NOT LESS THAN 865 MM HIGH.
(5) THE HEIGHT OF GUARDS FOR FLIGHTS OF STEPS SHALL BE MEASURED VERTICALLY FROM A LINE DRAWN THROUGH THE LEADING EDGE OF THE TREADS SERVED BY THE GUARD.
9.8.8.7. GLASS IN GUARDS
(1) GLASS IN GUARDS SHALL BE:
(a) SAFETY GLASS OF THE LAMINATED OR TEMPERED TYPE CONFORMING TO CANCGSB-12.1-M, "TEMPERED OR LAMINATED SAFETY GLASS", OR
(b) WIRED GLASS CONFORMING TO CANCGSB-12.11-M, "WIRED SAFETY GLASS".

12.3.3.12. AIR INFILTRATION
(1) WINDOWS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT THE RATE OF AIR INFILTRATION TO NOT MORE THAN 0.5 L/S FOR EACH SQUARE METRE OF WINDOW AREA WHEN TESTED AT PRESSURE DIFFERENTIAL OF 75 Pa.
(2) EXCEPT WHERE SHALL CONFORM TO SENTENCE (3), DOORS THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT AIR INFILTRATION TO NOT MORE THAN 2 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(3) EXCEPT WHERE THE DOOR IS WEATHER-STRIPPED ON ALL EDGES AND PROTECTED WITH A STORM DOOR OR BY AN ENCLOSED UNHEATED SPACE, EXTERIOR SWING TYPE DOOR ASSEMBLIES FOR DWELLING UNITS, INDIVIDUALLY RENTED HOTEL ROOMS AND SUITES SHALL BE DESIGNED TO LIMIT AIR INFILTRATION TO NOT MORE THAN 5.0 L/S FOR EACH SQUARE METRE OF DOOR AREA WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(4) DOOR ASSEMBLIES OTHER THAN THOSE DESCRIBED IN SENTENCES (2) AND (3), THAT SEPARATE HEATED SPACE FROM UNHEATED SPACE OR THE EXTERIOR SHALL BE DESIGNED TO LIMIT AIR INFILTRATION TO NOT MORE THAN 10 L/S FOR EACH METRE OF DOOR CRACK WHEN TESTED IN CONFORMANCE WITH SENTENCE (1).
(5) CALKING MATERIAL TO REDUCE AIR INFILTRATION SHALL CONFORM TO THE REQUIREMENTS IN SUBSECTION 9.27.4.
(6) WEATHERSTRIPPING TO REDUCE AIR INFILTRATION SHALL BE PROVIDED ALONG THE JAMBS, HEADS AND SILLS OF OTHER LOCATION WHERE THERE IS A POSSIBILITY OF AIR LEAKAGE INTO HEATED SPACE IN A BUILDING THROUGH THE EXTERIOR WALLS SUCH AS AT UTILITY PENETRATIONS, AT CONTROL JOINTS, AT JOINTS BETWEEN ROOF AND WALLS, AND AT JOINTS BETWEEN WALL PANELS.
(7) AIR LEAKAGE BETWEEN HEATED SPACE AND ADJACENT ROOF OR ATTIC SPACE CAUSED BY THE PENETRATION OF SERVICES SHALL BE RESTRICTED IN CONFORMANCE WITH THE REQUIREMENTS OF SUBSECTION 9.25.3.

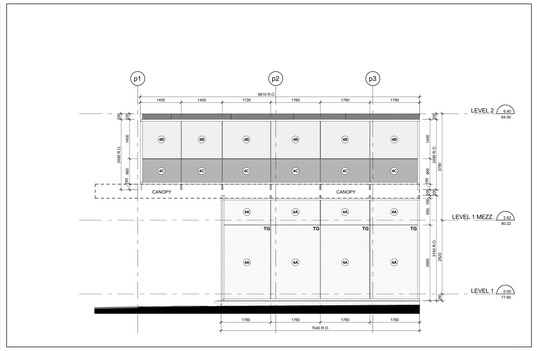

West Elevation - Part 15 21 A4-06
Scale: 1 : 50



West Elevation - Part 14 20 A4-06
Scale: 1 : 50



West Elevation - Part 13 19 A4-06
Scale: 1 : 50



West Elevation - Part 12 18 A4-06
Scale: 1 : 50



West Elevation - Part 11 17 A4-06
Scale: 1 : 50



West Elevation - Part 10 16 A4-06
Scale: 1 : 50



West Elevation - Part 9 15 A4-06
Scale: 1 : 50



West Elevation - Part 8 14 A4-06
Scale: 1 : 50



West Elevation - Part 7 13 A4-06
Scale: 1 : 50



West Elevation - Part 6 12 A4-06
Scale: 1 : 50



West Elevation - Part 5 11 A4-06
Scale: 1 : 50

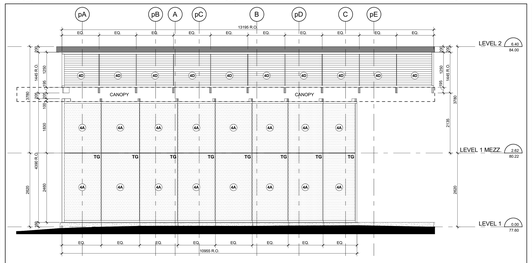

ELEVATION VIEW



West Elevation - Part 4 - Level 1 10 A4-06
Scale: 1 : 50



West Elevation - Part 3 9 A4-06
Scale: 1 : 50



West Elevation - Part 2 8 A4-06
Scale: 1 : 50



West Elevation - Part 7-8 7A A4-06
Scale: 1 : 50

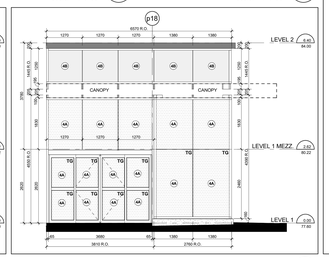

West Elevation - Part 1 7 A4-06
Scale: 1 : 50

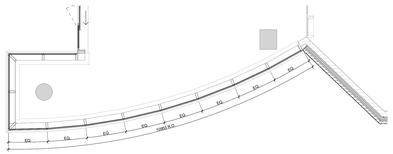

FLOOR PLAN VIEW

South Elevation - Part 6 6 A4-06
Scale: 1 : 50



South Elevation - Part 5 5 A4-06
Scale: 1 : 50

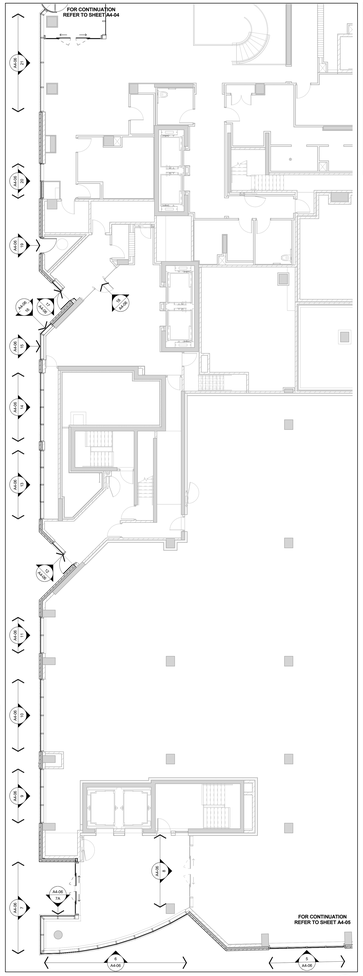

Window Schedule Partial Floor Plan - Level 1 4 A4-06
Scale: 1 : 100

Window Schedule Key Plan - Level 1 2 A4-06
NTS

WINDOW SCHEDULE LEGEND

13148 - AQUAVISTA
UPDATED: FEBRUARY 16, 2016

3	**PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN54 ON SURFACE 2
3A	**PREFINISHED ALUMINUM WINDOW WALL: VISION PANEL FRIT PATTERN**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN54 ON SURFACE 2 WHITE FRIT SM4 DIAMETER DOTS IN 150M SQUARE PATTERN ON SURFACE 2
3B	**PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AINNING**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN54 ON SURFACE 2
3C	**PREFINISHED ALUMINUM WINDOW WALL: OPERABLE AINNING FRIT PATTERN**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN54 ON SURFACE 2 WHITE FRIT SM4 DIAMETER DOTS IN 150M SQUARE PATTERN ON SURFACE 2
3D	**PREFINISHED ALUMINUM WINDOW WALL: GLASS SPANDREL PANEL**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR FLOAT COLOUR: SOLID FRIT VIRACON SUBDUED GRAY VM3 ON SURFACE 2
3E	**PREFINISHED ALUMINUM WINDOW WALL: METAL SPANDREL PANEL**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE METAL PANEL: PRO UC702 MF DURANAR GREY VELVET
3F	**PREFINISHED ALUMINUM WINDOW WALL: METAL LOUVER**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE METAL LOUVER: PRO UC702 MF DURANAR GREY VELVET
3G1	**PREFINISHED ALUMINUM WINDOW WALL: METAL SLAB COVER - PROFILE 40x420mm**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE SLAB COVER: PRO UC106TS5SL DURANAR XL STEEL SILVER CITY
3G2	**PREFINISHED ALUMINUM WINDOW WALL: METAL SLAB COVER - PROFILE 105x420mm**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE SLAB COVER: PRO UC106TS5SL DURANAR XL STEEL SILVER CITY
3G3	**PREFINISHED ALUMINUM WINDOW WALL: METAL SLAB COVER - PROFILE 220x420mm**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE SLAB COVER: PRO UC106TS5SL DURANAR XL STEEL SILVER CITY
3H	**PREFINISHED ALUMINUM WINDOW WALL: OPERABLE WINDOW - VISION PANEL**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN54 ON SURFACE 2
3J	**PREFINISHED ALUMINUM WINDOW WALL: OPERABLE WINDOW - GLASS SPANDREL PANEL**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE GLASS TYPE: CLEAR FLOAT COLOUR: SOLID FRIT VIRACON SUBDUED GRAY VM3 ON SURFACE 2
3K	**PREFINISHED ALUMINUM WINDOW WALL: OPERABLE WINDOW - METAL LOUVER**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - K126 DURACRON WHITE METAL LOUVER: PRO UC702 MF DURANAR GREY VELVET
4	**PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN68 ON SURFACE 2
4A	**PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL FRIT PATTERN (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN68 ON SURFACE 2 WHITE FRIT SM4 DIAMETER DOTS IN 150M SQUARE PATTERN ON SURFACE 3
4B	**PREFINISHED STOREFRONT CURTAINWALL: SHADOW BOX (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN68 ON SURFACE 2 COLOUR: WHITE COLOUR PAINT ON ALUMINUM PAN BEHIND SURFACE 4
4C	**PREFINISHED STOREFRONT CURTAINWALL: GLASS SPANDREL PANEL (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN68 ON SURFACE 2 COLOUR: SOLID FRIT GREY VELVET ON SURFACE 4
4D	**PREFINISHED STOREFRONT CURTAINWALL: METAL LOUVER (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET METAL LOUVER: PRO UC702 MF DURANAR GREY VELVET
4E	**PREFINISHED STOREFRONT CURTAINWALL: METAL SPANDREL PANEL (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET METAL PANEL: PRO UC702 MF DURANAR GREY VELVET
4F	**PREFINISHED STOREFRONT CURTAINWALL: VISION PANEL FRIT PATTERN (GROUND FLOOR)**	ALUM COLOUR: EXTERIOR - PRO UC702 MF DURANAR GREY VELVET INTERIOR - PRO UC702 MF DURANAR GREY VELVET GLASS TYPE: CLEAR INNER & OUTER LITE, GUARDIAN SUNGUARD - SUPERNEUTRAL SN68 ON SURFACE 3 GREY VELVET HORIZONTAL FRIT PATTERN ON SURFACE 2

LEGEND

BBQ	BBQ GAS CONNECTION - REFER TO MECHANICAL DRAWINGS
NFHB	NON FREEZE HOSE BIBB - REFER TO MECHANICAL DRAWINGS
WDR	WEATHERPROOF DUPLEX RECEPTACLE - REFER TO ELECTRICAL DRAWINGS
LF	LIGHT FIXTURE - REFER TO ELECTRICAL DRAWINGS
TG	TEMPERED GLASS

Window Schedule Legend 1 A4-06
NTS

Typical Window Schedule Notes 3 A4-06
NTS

Contractor Must Check And Verify All Dimensions On The Job.
Do Not Scale The Drawings.
All Drawings, Specifications And Related Documents Are The Copyright Of The Architect And Must Be Returned Upon Request.
Reproduction Of Drawings, Specifications And Related Documents In Part Or Whole Is Forbidden Without The Architects Written Permission.
The Drawing Is Not To Be Used For Construction Until Signed By The Architect.

Date: November 4, 2016

CAMILLO ASSOCIATES
ONTARIO
1992
SEAL MUST BE SIGNED TO BE VALID
Construction

KIRKOR ARCHITECTS + PLANNERS
20 Martin Ross Avenue, Toronto, Ontario, M3J 2K8
Tel 416 665-0050, Fax 416 665-1234, www.kirkorarchitects.com

No.:	Revision	Date

No.	Issued For	Date
2	Construction	Nov. 4, 2016
1	Tender	Oct. 19, 2015

AQUAVISTA
AT BAYSIDE TORONTO

Drawing Title
Window Schedule - Level 1 - South & West Elevation

Project
Hines TRIDEL
AQUAVISTA
Block 3 - R3 & R4
263 Queens Quay East
Toronto, ON

Scale: As indicated
Drawn By: E.V. / M.N.
Checked By: C.A.
Project No.: 13148
Date: November 4, 2016
Drawing No.: A4-06

Plot Date: 11/2/2016 11:50:23 AM File Path: C:\Users\jacobsck\Documents\REVIT 2015 WORKING FILES\13148FCD-Model-Building R3-R4_rjacobsck.rvt