

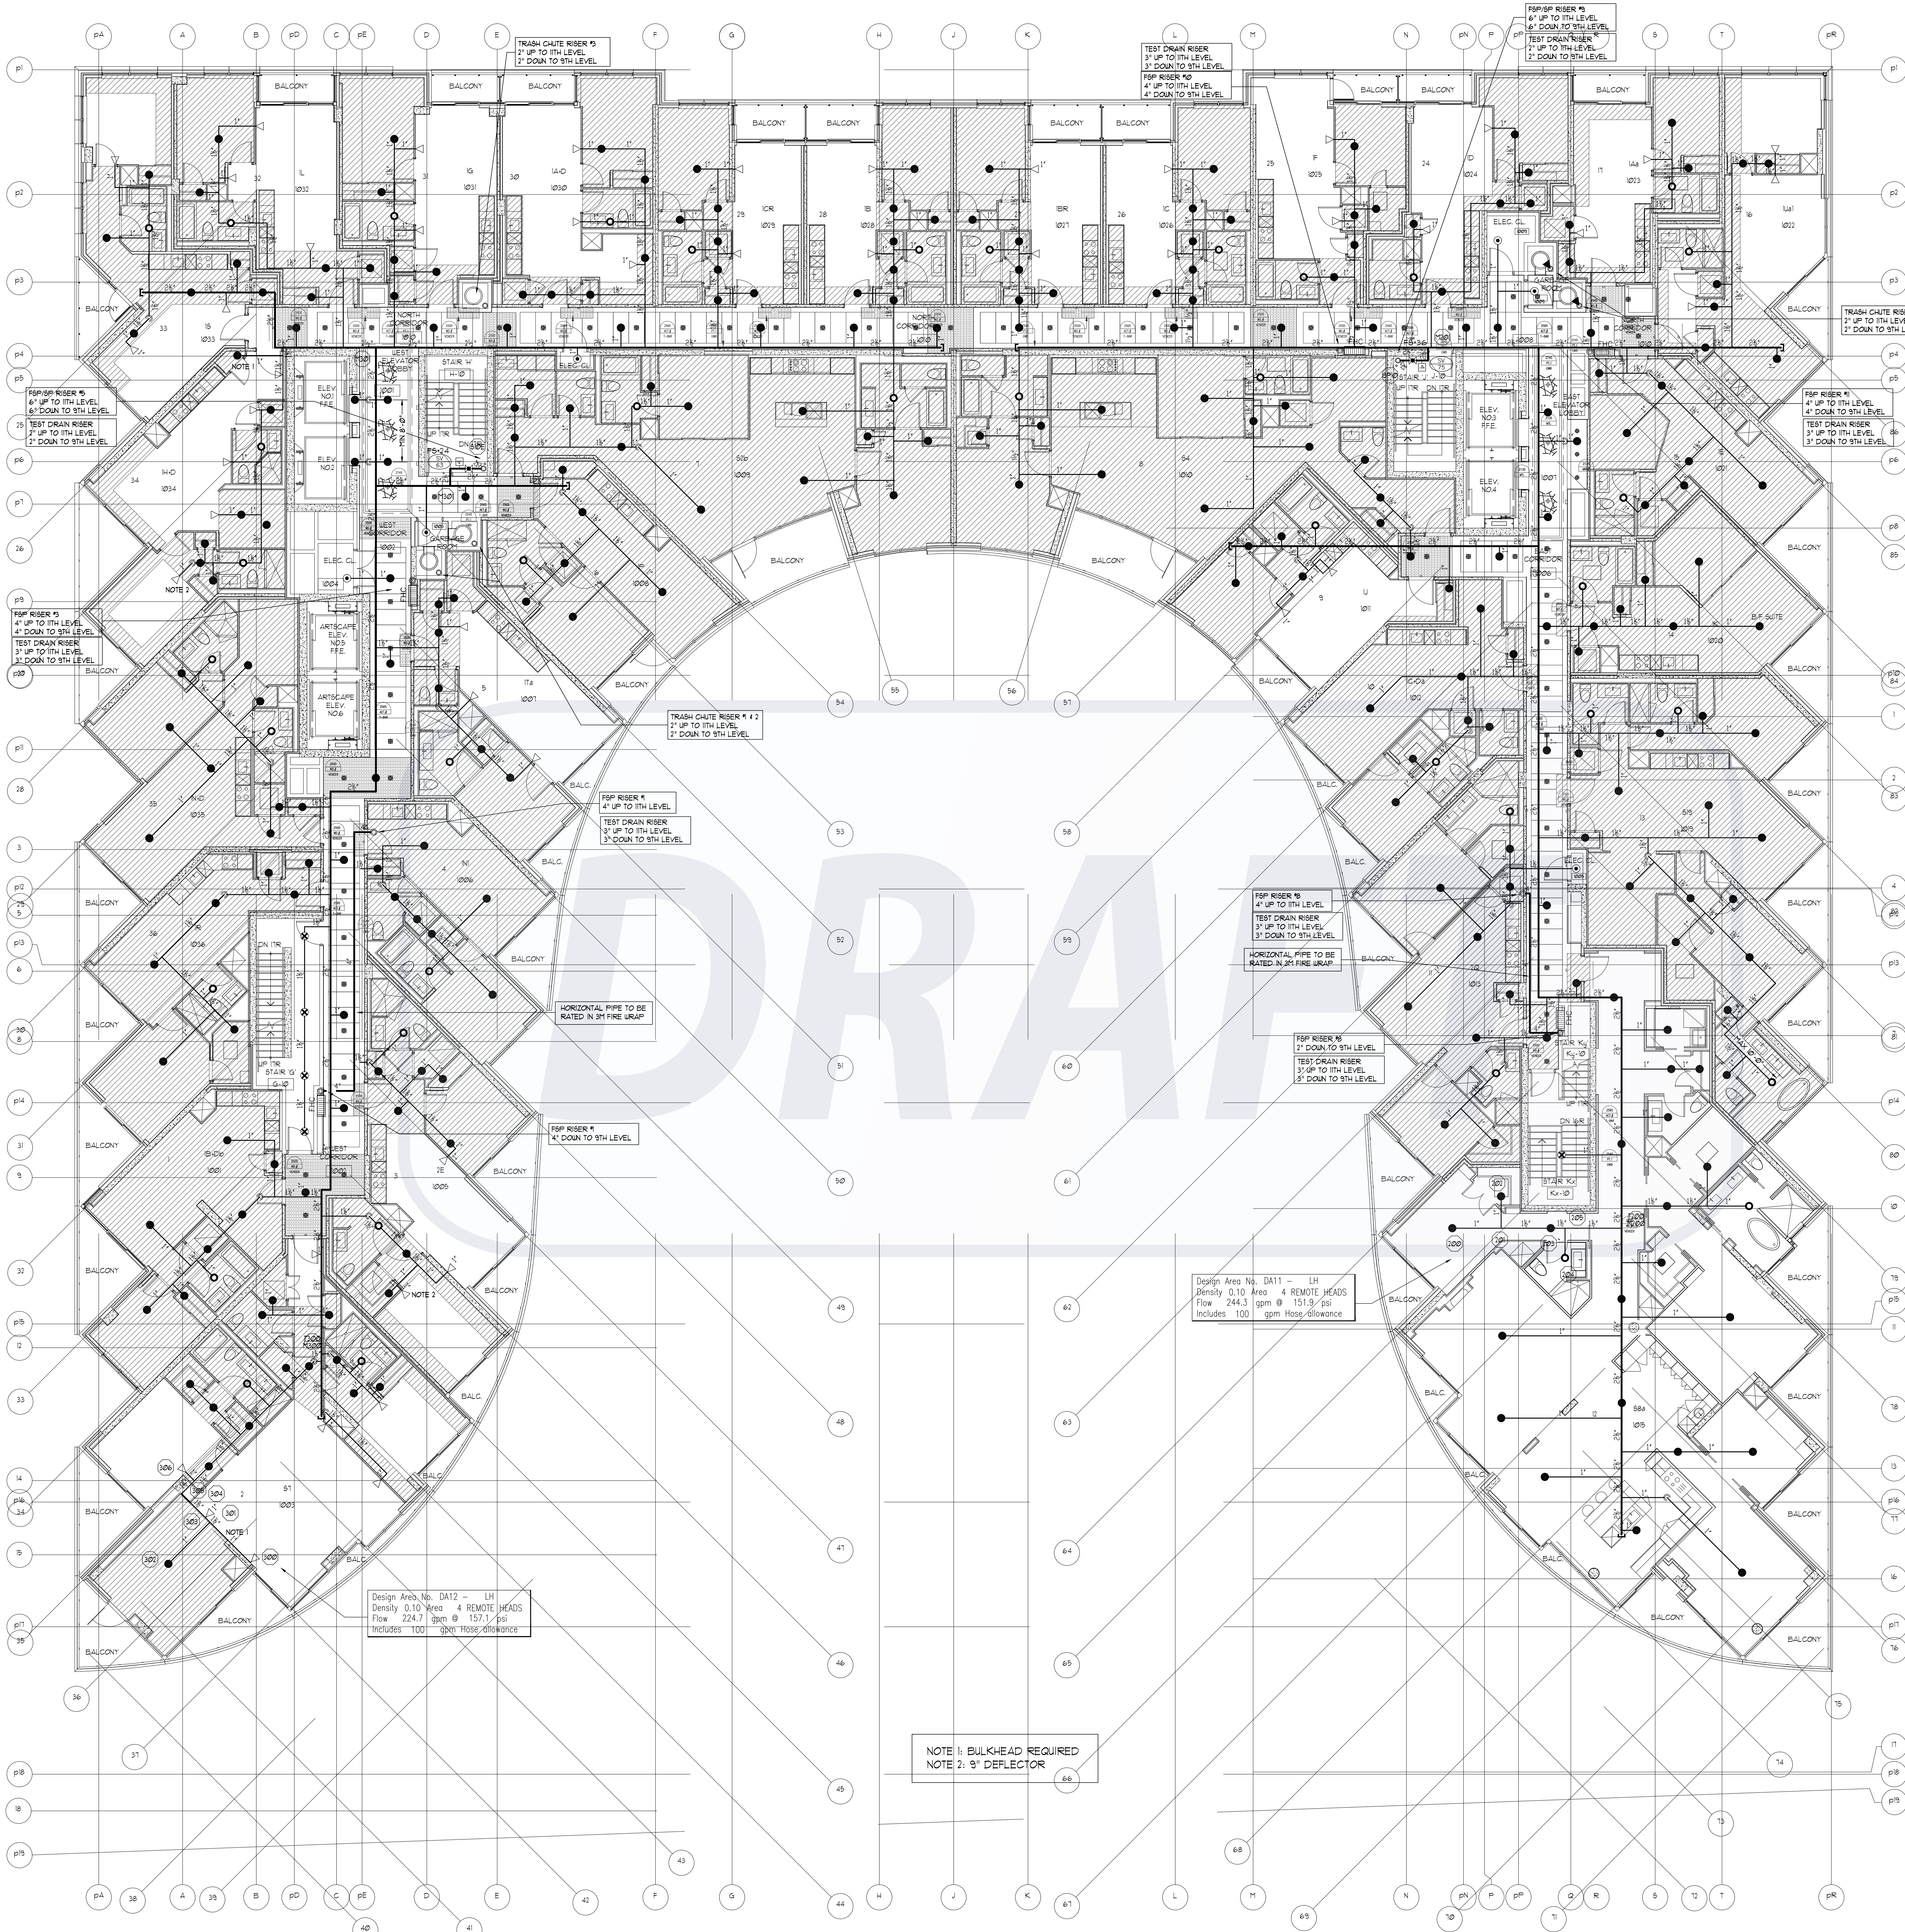
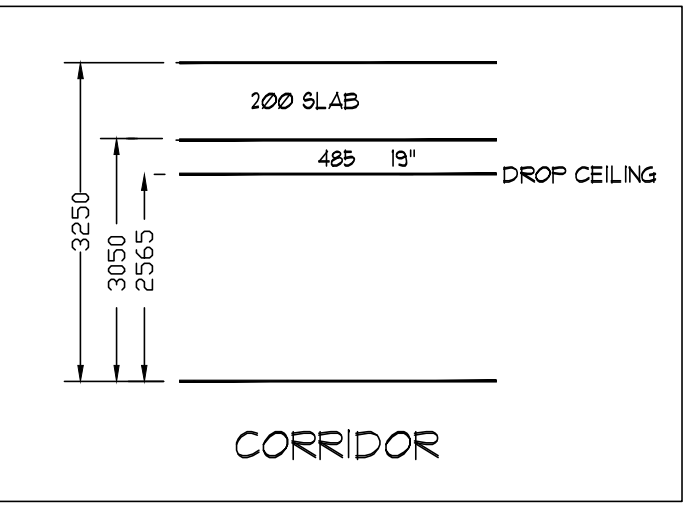


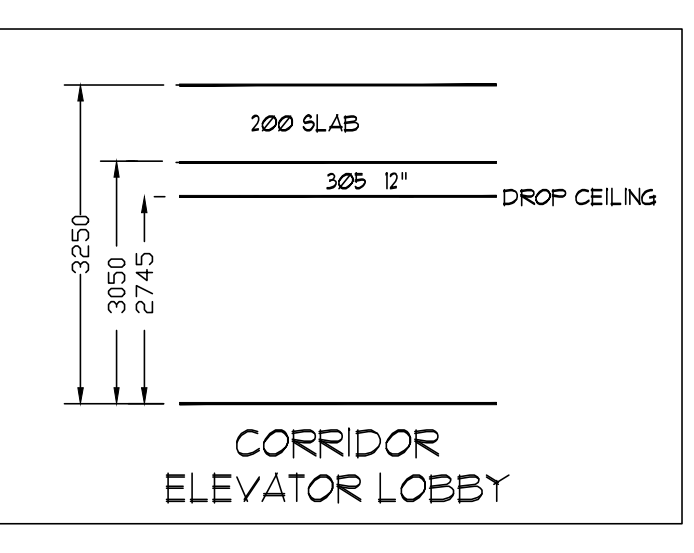

10TH LEVEL SPRINKLER LAYOUT
SCALE: 1/8"=1'-0"

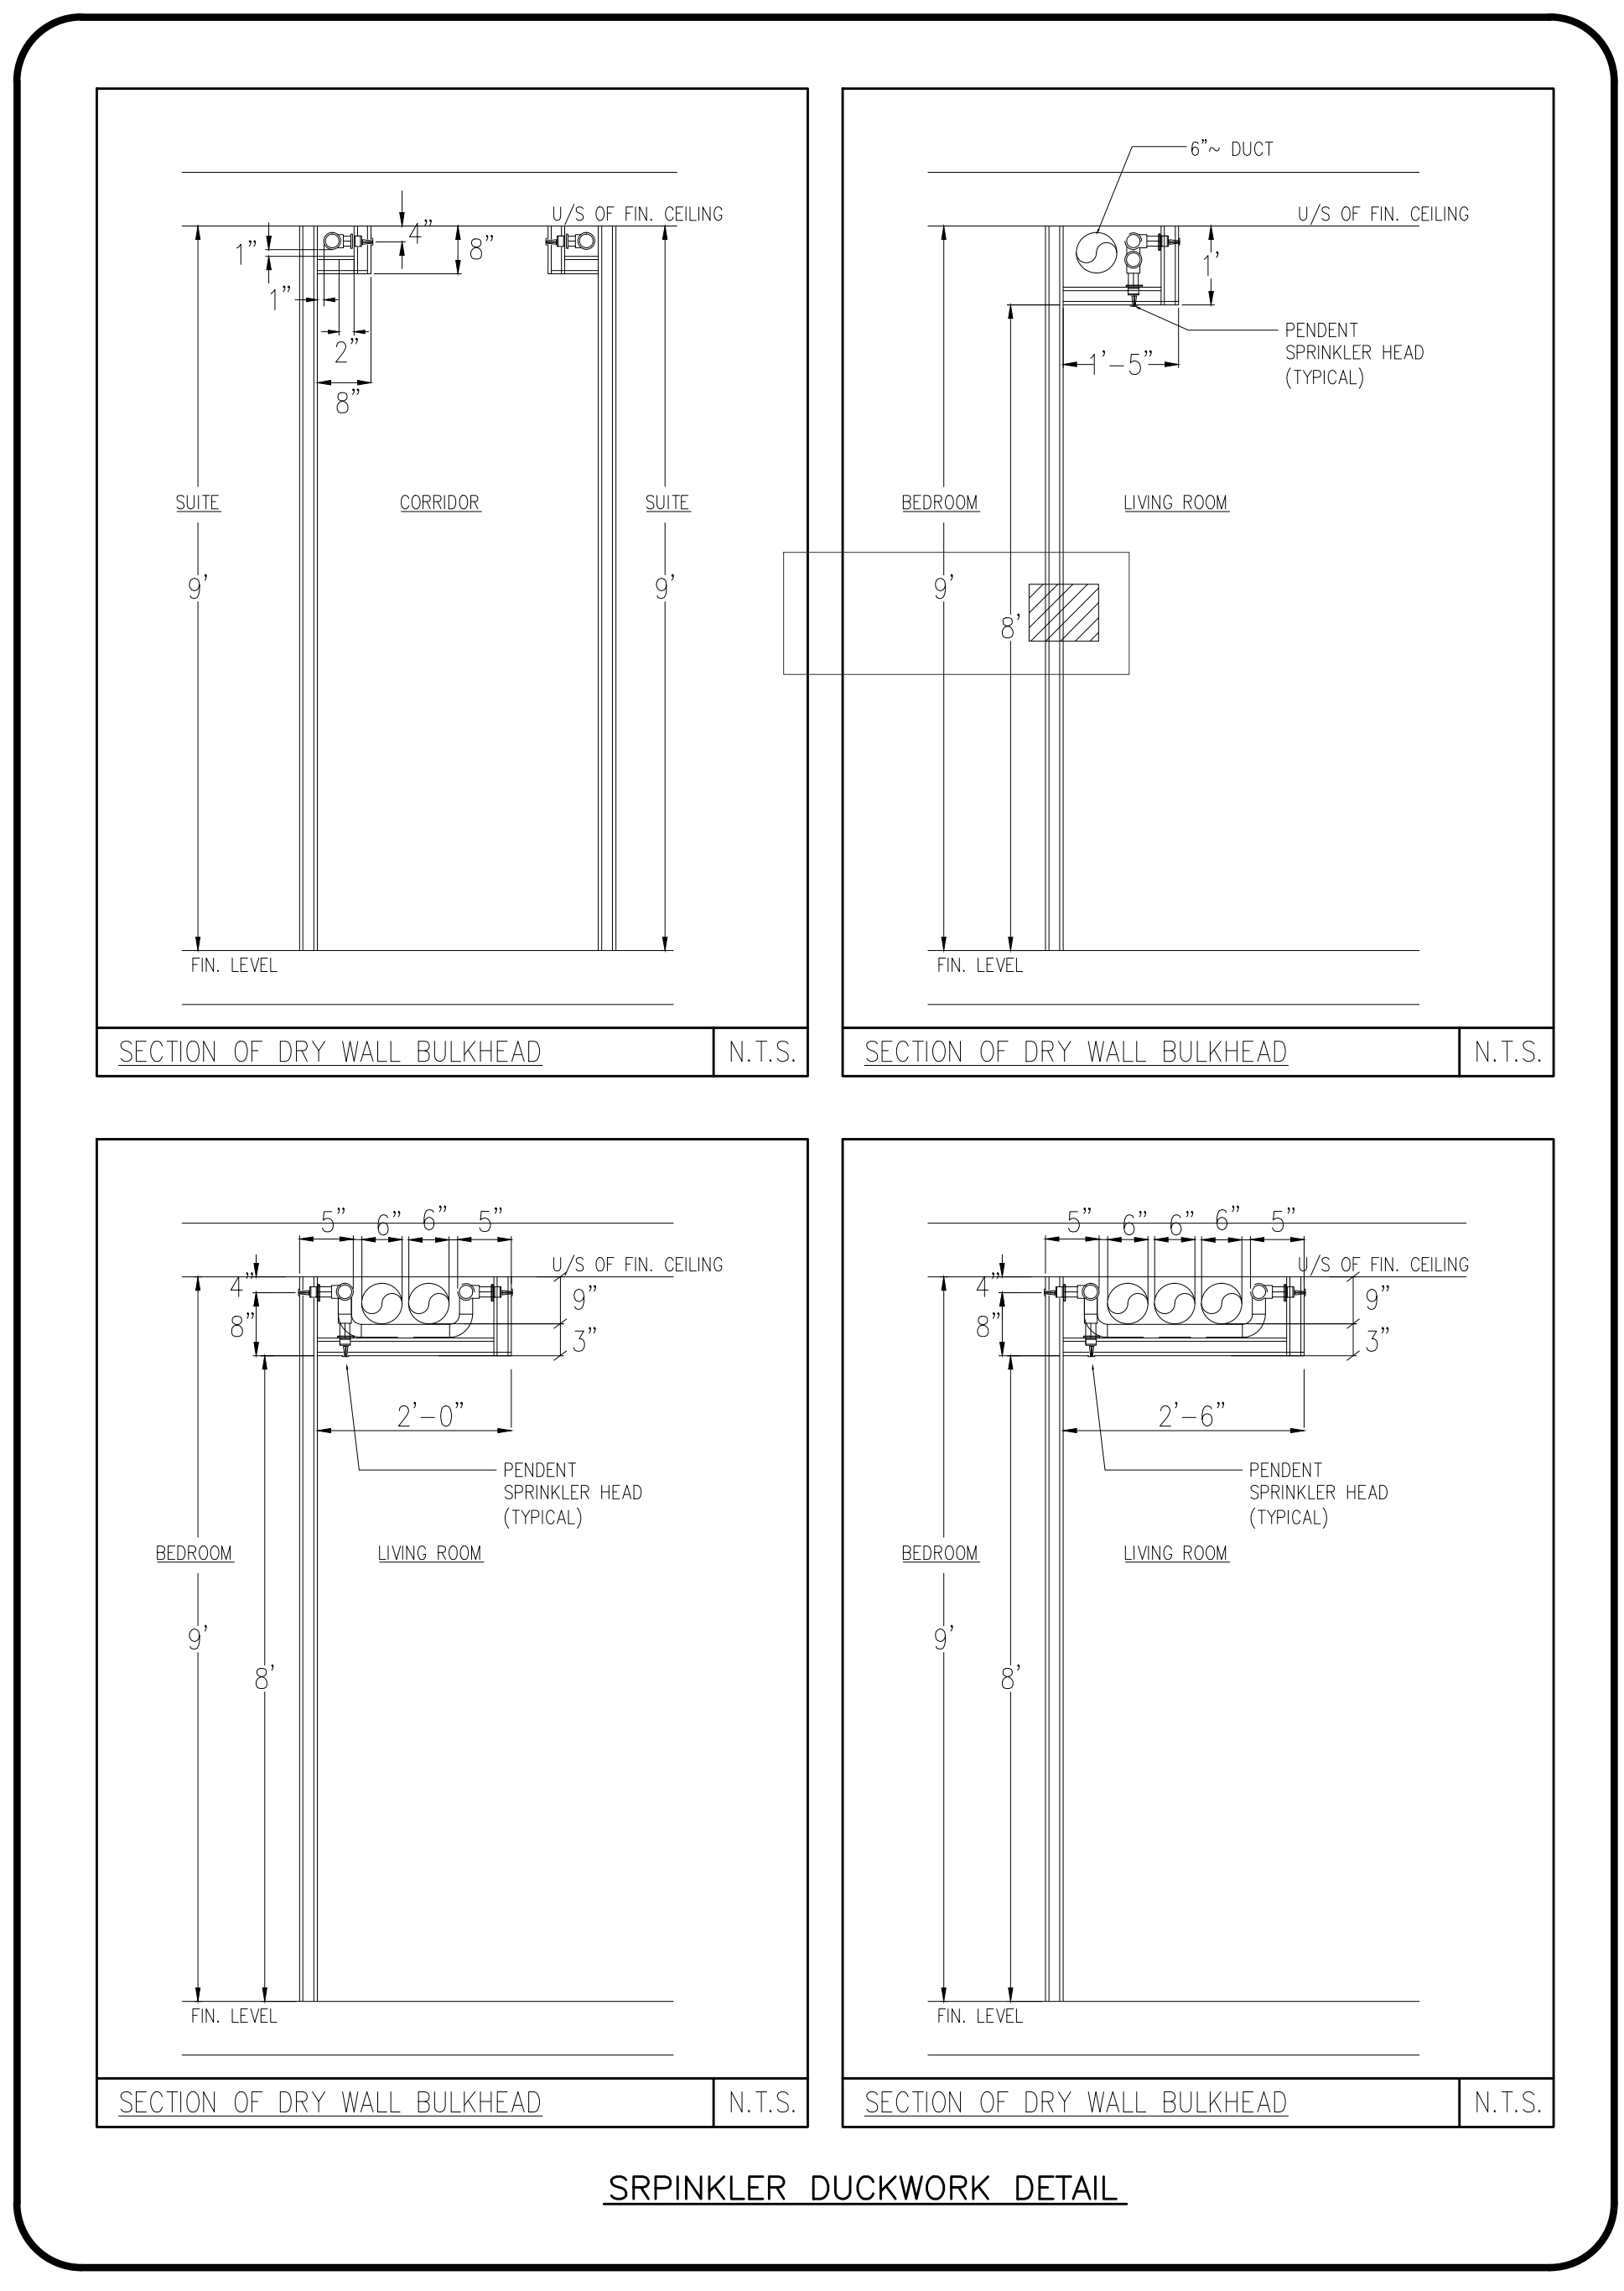

- NOTES - RESIDENTIAL SIDEWALL SPRINKLERS:
1. MAXIMUM COVERAGE FOR RESIDENTIAL SIDEWALL SPRINKLERS NOT TO EXCEED 16 x 16.
 2. MINIMUM DISTANCE BETWEEN SPRINKLERS TO BE 8'-0".
 3. MAXIMUM DISTANCE FROM ANY SIDE WALL TO SPRINKLER NOT TO EXCEED 8'-0".
 4. SIDEWALL SPRINKLERS SHALL BE LOCATED AT LEAST 5'-0" FROM OBSTRUCTIONS SUCH AS CEILING FANS AND LIGHT FIXTURES.
 5. SEE OBSTRUCTION TABLE ON DRAWING SP1.
- NOTES - RESIDENTIAL PENDENT SPRINKLERS:
1. MAXIMUM COVERAGE FOR RESIDENTIAL PENDENT SPRINKLERS NOT TO EXCEED 350 FT².
 2. MINIMUM DISTANCE BETWEEN SPRINKLERS TO BE 8'-0".
 3. MAXIMUM DISTANCE FROM ANY SIDE WALL TO SPRINKLER NOT TO EXCEED 10'-0".
 4. PENDENT SPRINKLERS SHALL BE LOCATED AT LEAST 3'-0" FROM OBSTRUCTIONS SUCH AS CEILING FANS AND LIGHT FIXTURES.
 5. SEE OBSTRUCTION TABLE ON DRAWING SP1.

REVISIONS	
1.0	ISSUED FOR TENDER 10/15/15
2.0	ISSUED FOR TENDER ADDENDUM #1 10/23/15
3.0	ISSUED FOR CONSTRUCTION 11/27/15

NOTES	

SPRINKLER LEGEND	
1/2" 165°F SC OR BRASS UPRIGHT SPRINKLER K= 5.6	4
1/2" 165°F SC OR BRASS UPRIGHT SPRINKLER K= 5.6 OH	6
VIKING MODEL VK457 FREEDOM RESIDENTIAL CONCEALED PENDENT SPRINKLER C/W WHITE 3-5/16" COVER PLATE K=4.9 165°F	277
VIKING MODEL VK457 FREEDOM RESIDENTIAL CONCEALED PENDENT SPRINKLER C/W WHITE 3-5/16" COVER PLATE K=4.9 165°F	40
VIKING MODEL VK480 FREEDOM RESIDENTIAL HORIZONTAL WHITE SIDEWALL SPRINKLER C/W WHITE ESCUTCHION PLATE 1/2" K=4.0 165°F 8" DEFLECTOR U.N.O. (MAXIMUM COVERAGE 16'X18' U.N.O.)	48
1/2" 165°F SC SR SIDEWALL SPRINKLER K= 5.6 OH	2
FIRE HOSE CABINET SEE DETAIL SHEET SP1	5

TRIDEL
BUILT FOR LIFE

4800 Dufferin St
Toronto, Ontario M3H 5S9
(tel): 416-661-9290

MIRENDA
INCORPORATED

15171 Yonge Street Suite 202
Aurora Ontario L4G 1M1
(tel): 905-727-0092
(fax): 905-727-5517

NORTH	

STAMP	

PROJECT	
AQUAVISTA	
MERCHANTS WHARF TORONTO, ONTARIO	
DWG TITLE	
10TH LEVEL SPRINKLER LAYOUT	

DATE	PROJECT NO.
11/27/2015	15-678

SCALE	DWG NO.
1/8"=1'-0"	SP15

DWN BY	ISSUED FOR REVISION NO.
JL	3.0

OF SP21