

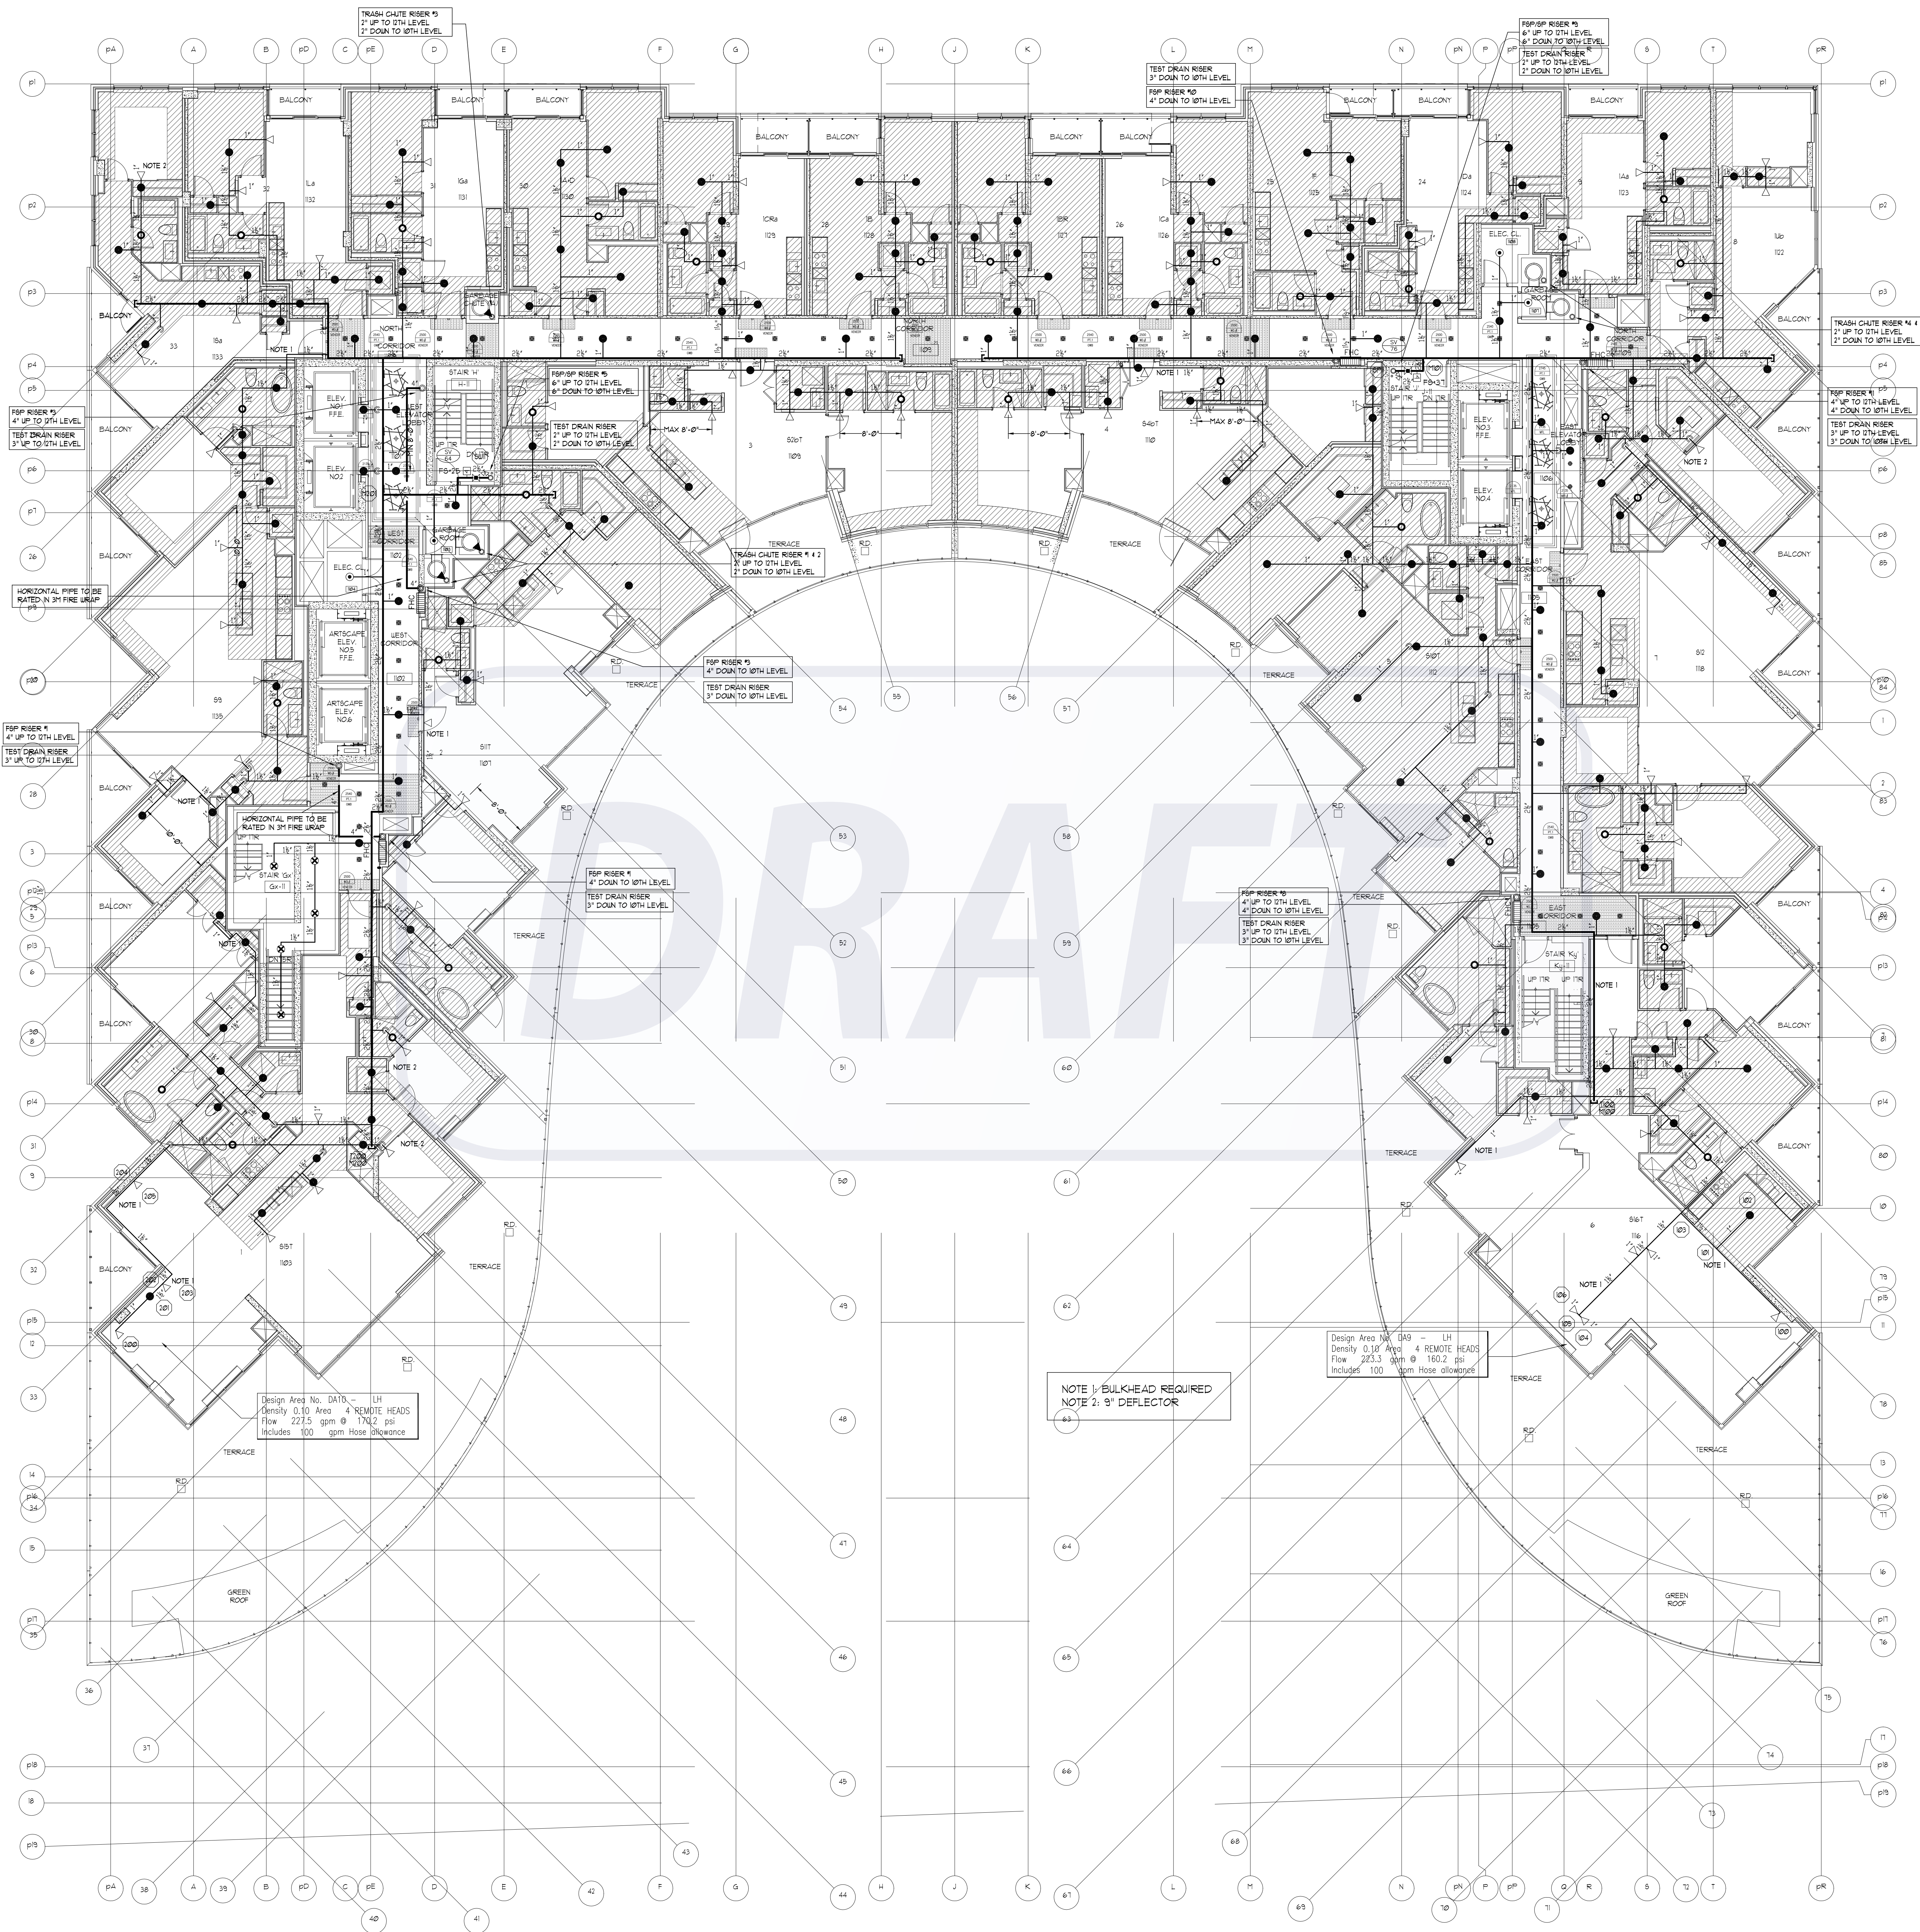


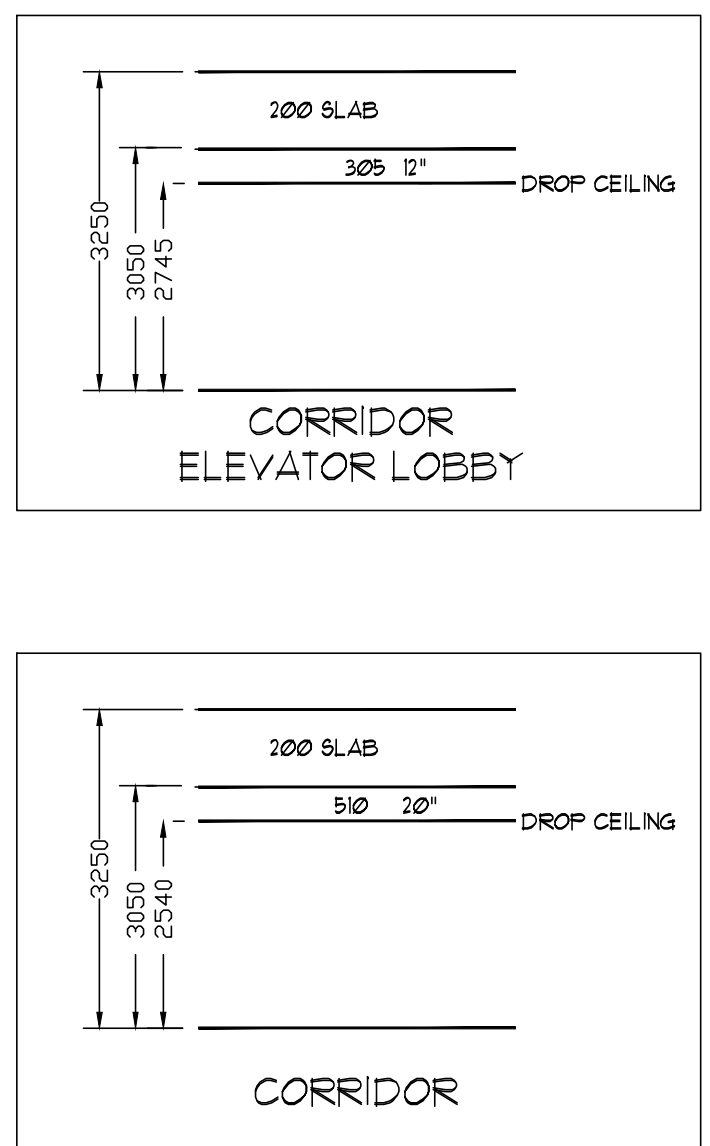

11TH LEVEL SPRINKLER LAYOUT
SCALE: 1/8" = 1'-0"

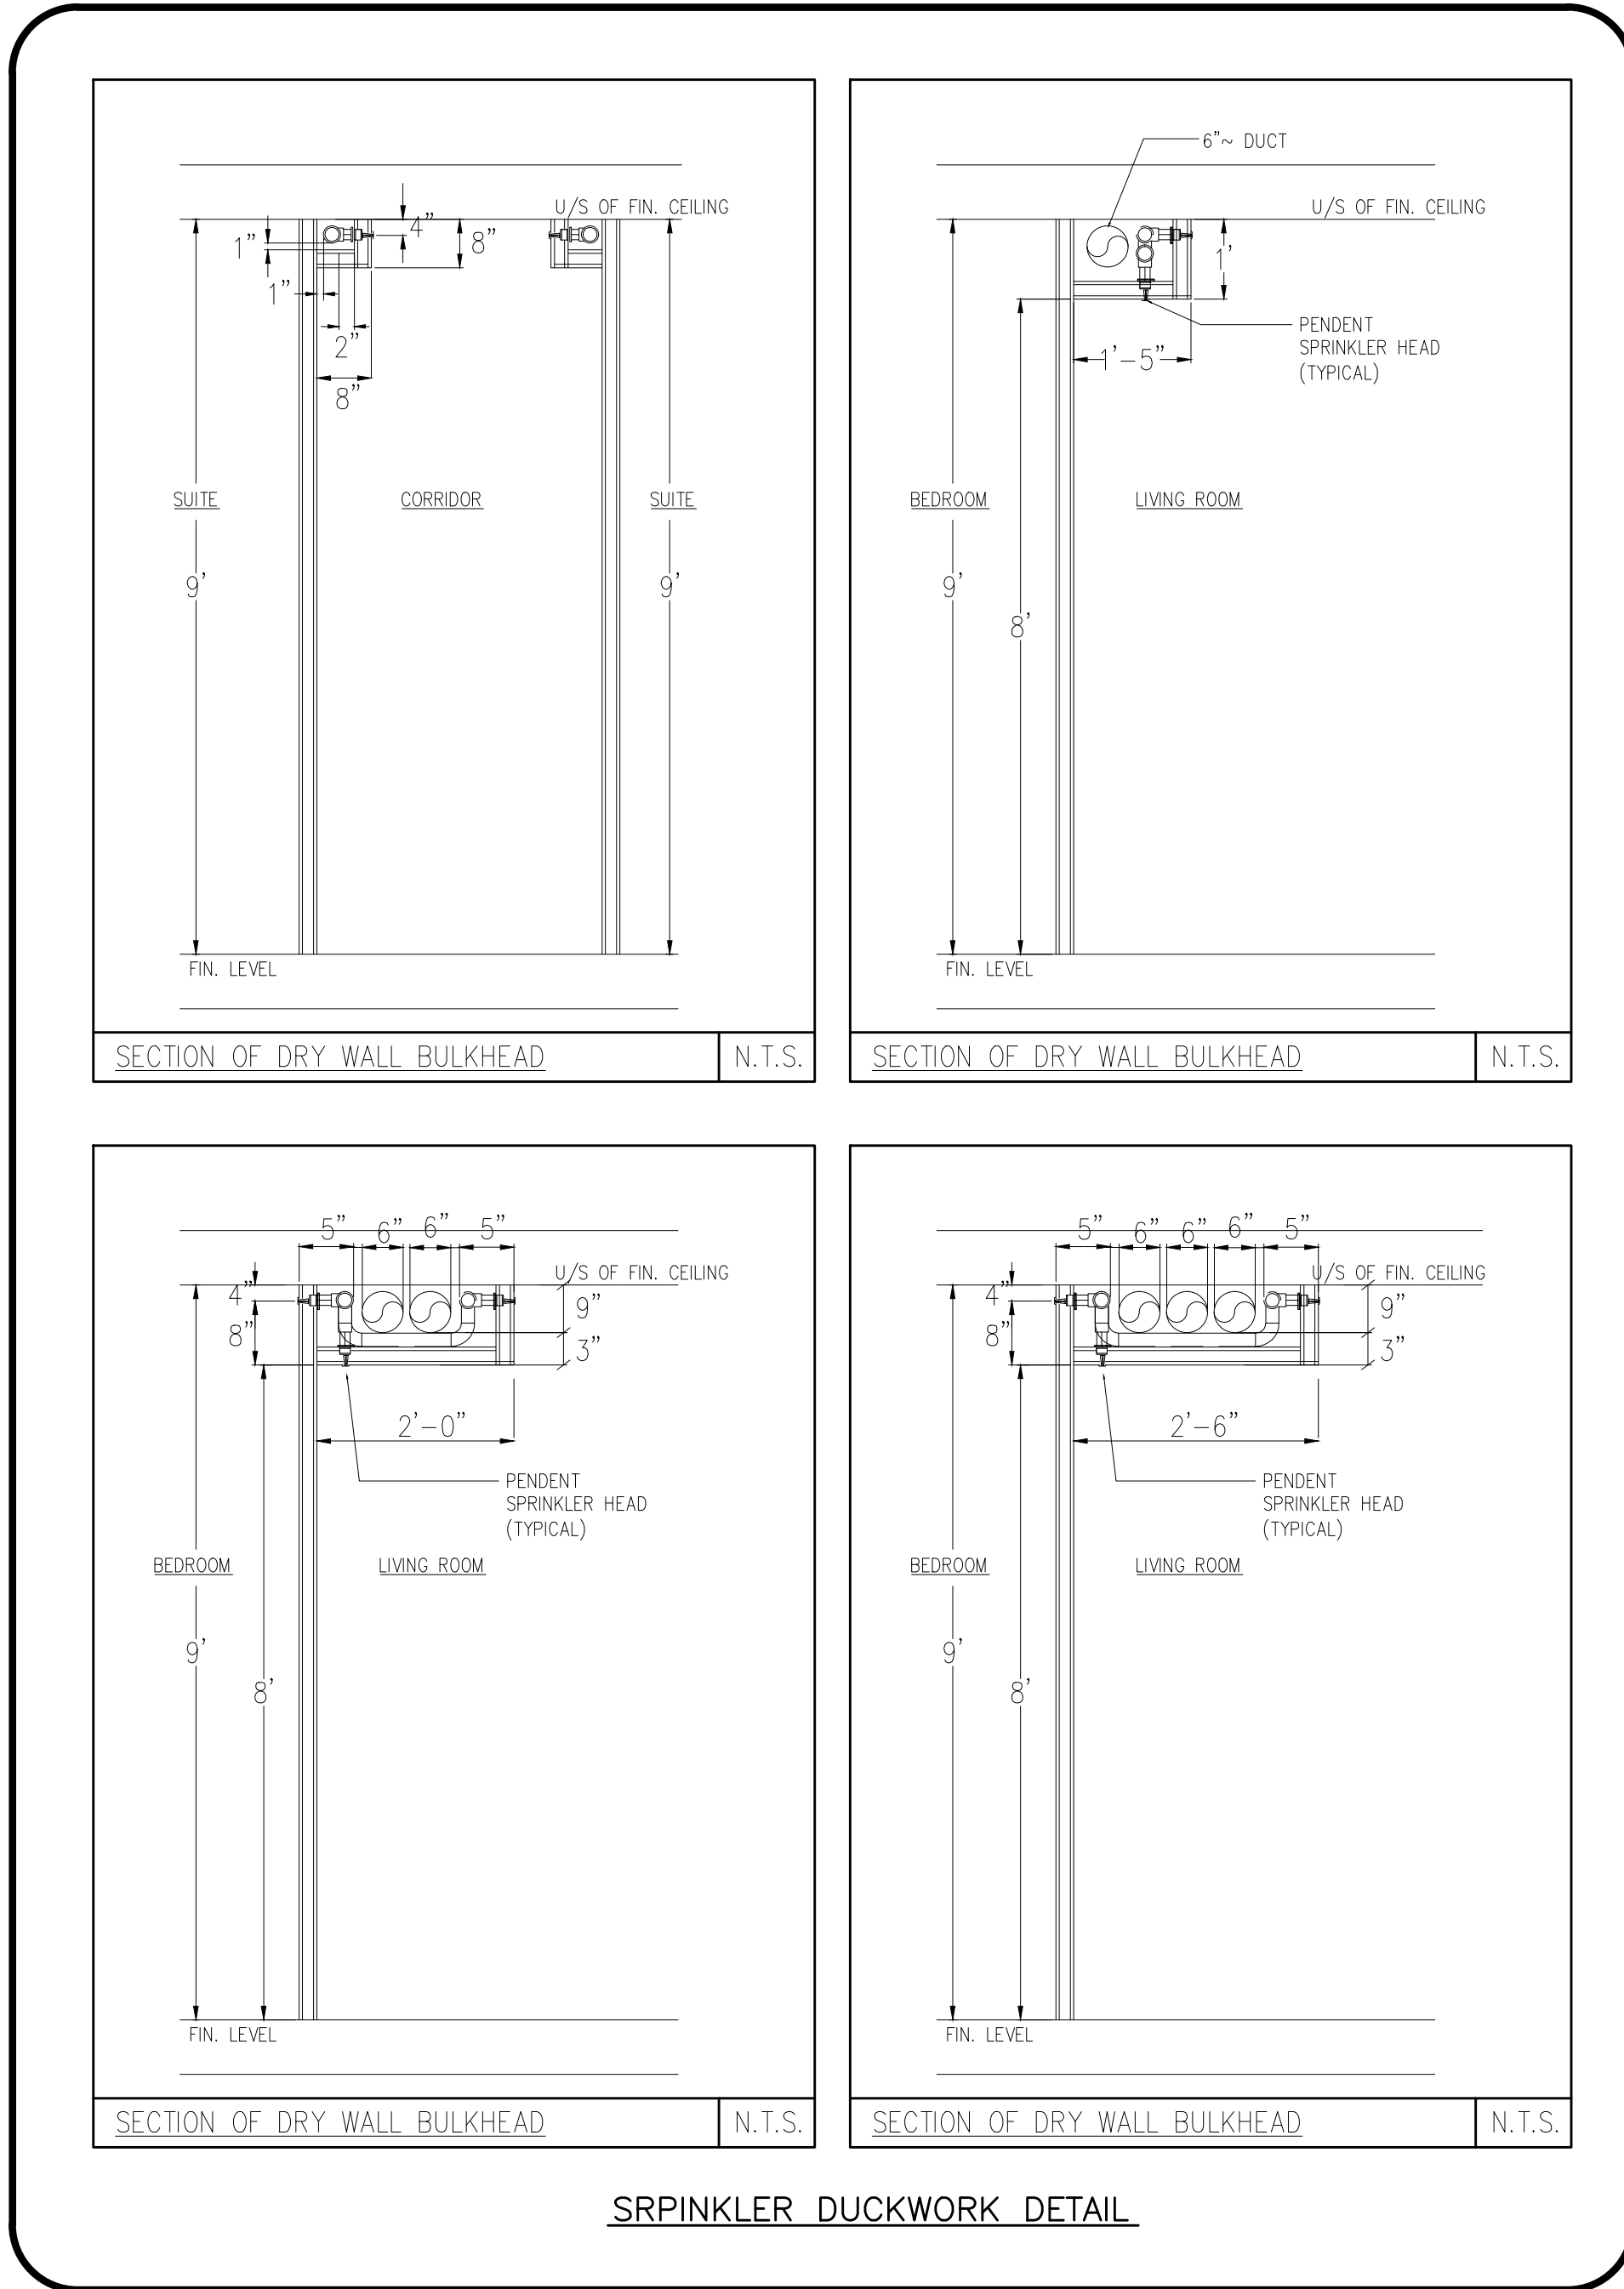

- NOTES - RESIDENTIAL SIDEWALL SPRINKLERS:
1. MAXIMUM COVERAGE FOR RESIDENTIAL SIDEWALL SPRINKLERS NOT TO EXCEED 16' x 16'.
 2. MINIMUM DISTANCE BETWEEN SPRINKLERS TO BE 8'-0".
 3. MAXIMUM DISTANCE FROM ANY SIDE WALL TO SPRINKLER NOT TO EXCEED 8'-0".
 4. SIDEWALL SPRINKLERS SHALL BE LOCATED AT LEAST 5'-0" FROM OBSTRUCTIONS SUCH AS CEILING FANS AND LIGHT FIXTURES.
 5. SEE OBSTRUCTION TABLE ON DRAWING SP1.
- NOTES - RESIDENTIAL PENDENT SPRINKLERS:
1. MAXIMUM COVERAGE FOR RESIDENTIAL PENDENT SPRINKLERS NOT TO EXCEED 360 FT².
 2. MINIMUM DISTANCE BETWEEN SPRINKLERS TO BE 8'-0".
 3. MAXIMUM DISTANCE FROM ANY SIDE WALL TO SPRINKLER NOT TO EXCEED 10'-0".
 4. PENDENT SPRINKLERS SHALL BE LOCATED AT LEAST 3'-0" FROM OBSTRUCTIONS SUCH AS CEILING FANS AND LIGHT FIXTURES.
 5. SEE OBSTRUCTION TABLE ON DRAWING SP1.

REVISIONS	
1.0	ISSUED FOR TENDER 10/15/15
2.0	ISSUED FOR TENDER ADDENDUM #1 10/23/15
3.0	ISSUED FOR CONSTRUCTION 11/27/15

NOTES

SPRINKLER LEGEND	
1/2" 165°F SC OR BRASS UPRIGHT SPRINKLER K= 5.6	5
1/2" 165°F SC SR SIDEWALL SPRINKLER K= 5.6 OH	3
1/2" 165°F SC SR BRASS UPRIGHT SPRINKLER K= 5.6 OH	4
VIKING MODEL VK457 FREEDOM RESIDENTIAL CONCEALED PENDENT SPRINKLER C/W WHITE 3-5/16" COVER PLATE K=4.9 165°F	195
VIKING MODEL VK457 FREEDOM RESIDENTIAL CONCEALED PENDENT SPRINKLER C/W WHITE 3-5/16" COVER PLATE K=4.9 165°F ENT(CORROSION RESISTANT COATING)	32
VIKING MODEL VK480 FREEDOM RESIDENTIAL HORIZONTAL WHITE SIDEWALL SPRINKLER C/W WHITE SCUTCHCOON PLATE 1/2" K=4.0 165°F 8" DEFLECTOR U.N.O. (MAXIMUM COVERAGE 16'X18' U.N.O.)	68
FIRE HOSE CABINET SEE DETAIL SHEET SP1	5




4800 Dufferin St.
Toronto, Ontario M3H 5S9
(tel): 416-661-9290



15171 Yonge Street Suite 202
Aurora Ontario L4G 1M1
(tel): 905-727-0092
(fax): 905-727-5517

NORTH

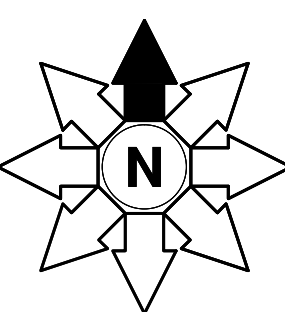

STAMP



PROJECT AQUAVISTA

MERCHANTS WHARF TORONTO, ONTARIO

DWG TITLE

11TH LEVEL SPRINKLER LAYOUT

DATE 11/27/2015 PROJECT NO.

SCALE 1/8"=1'-0" 15-678

DWN BY JL DWG NO.

ISSUED FOR REVISION NO. 3.0 SP16

OF SP21