
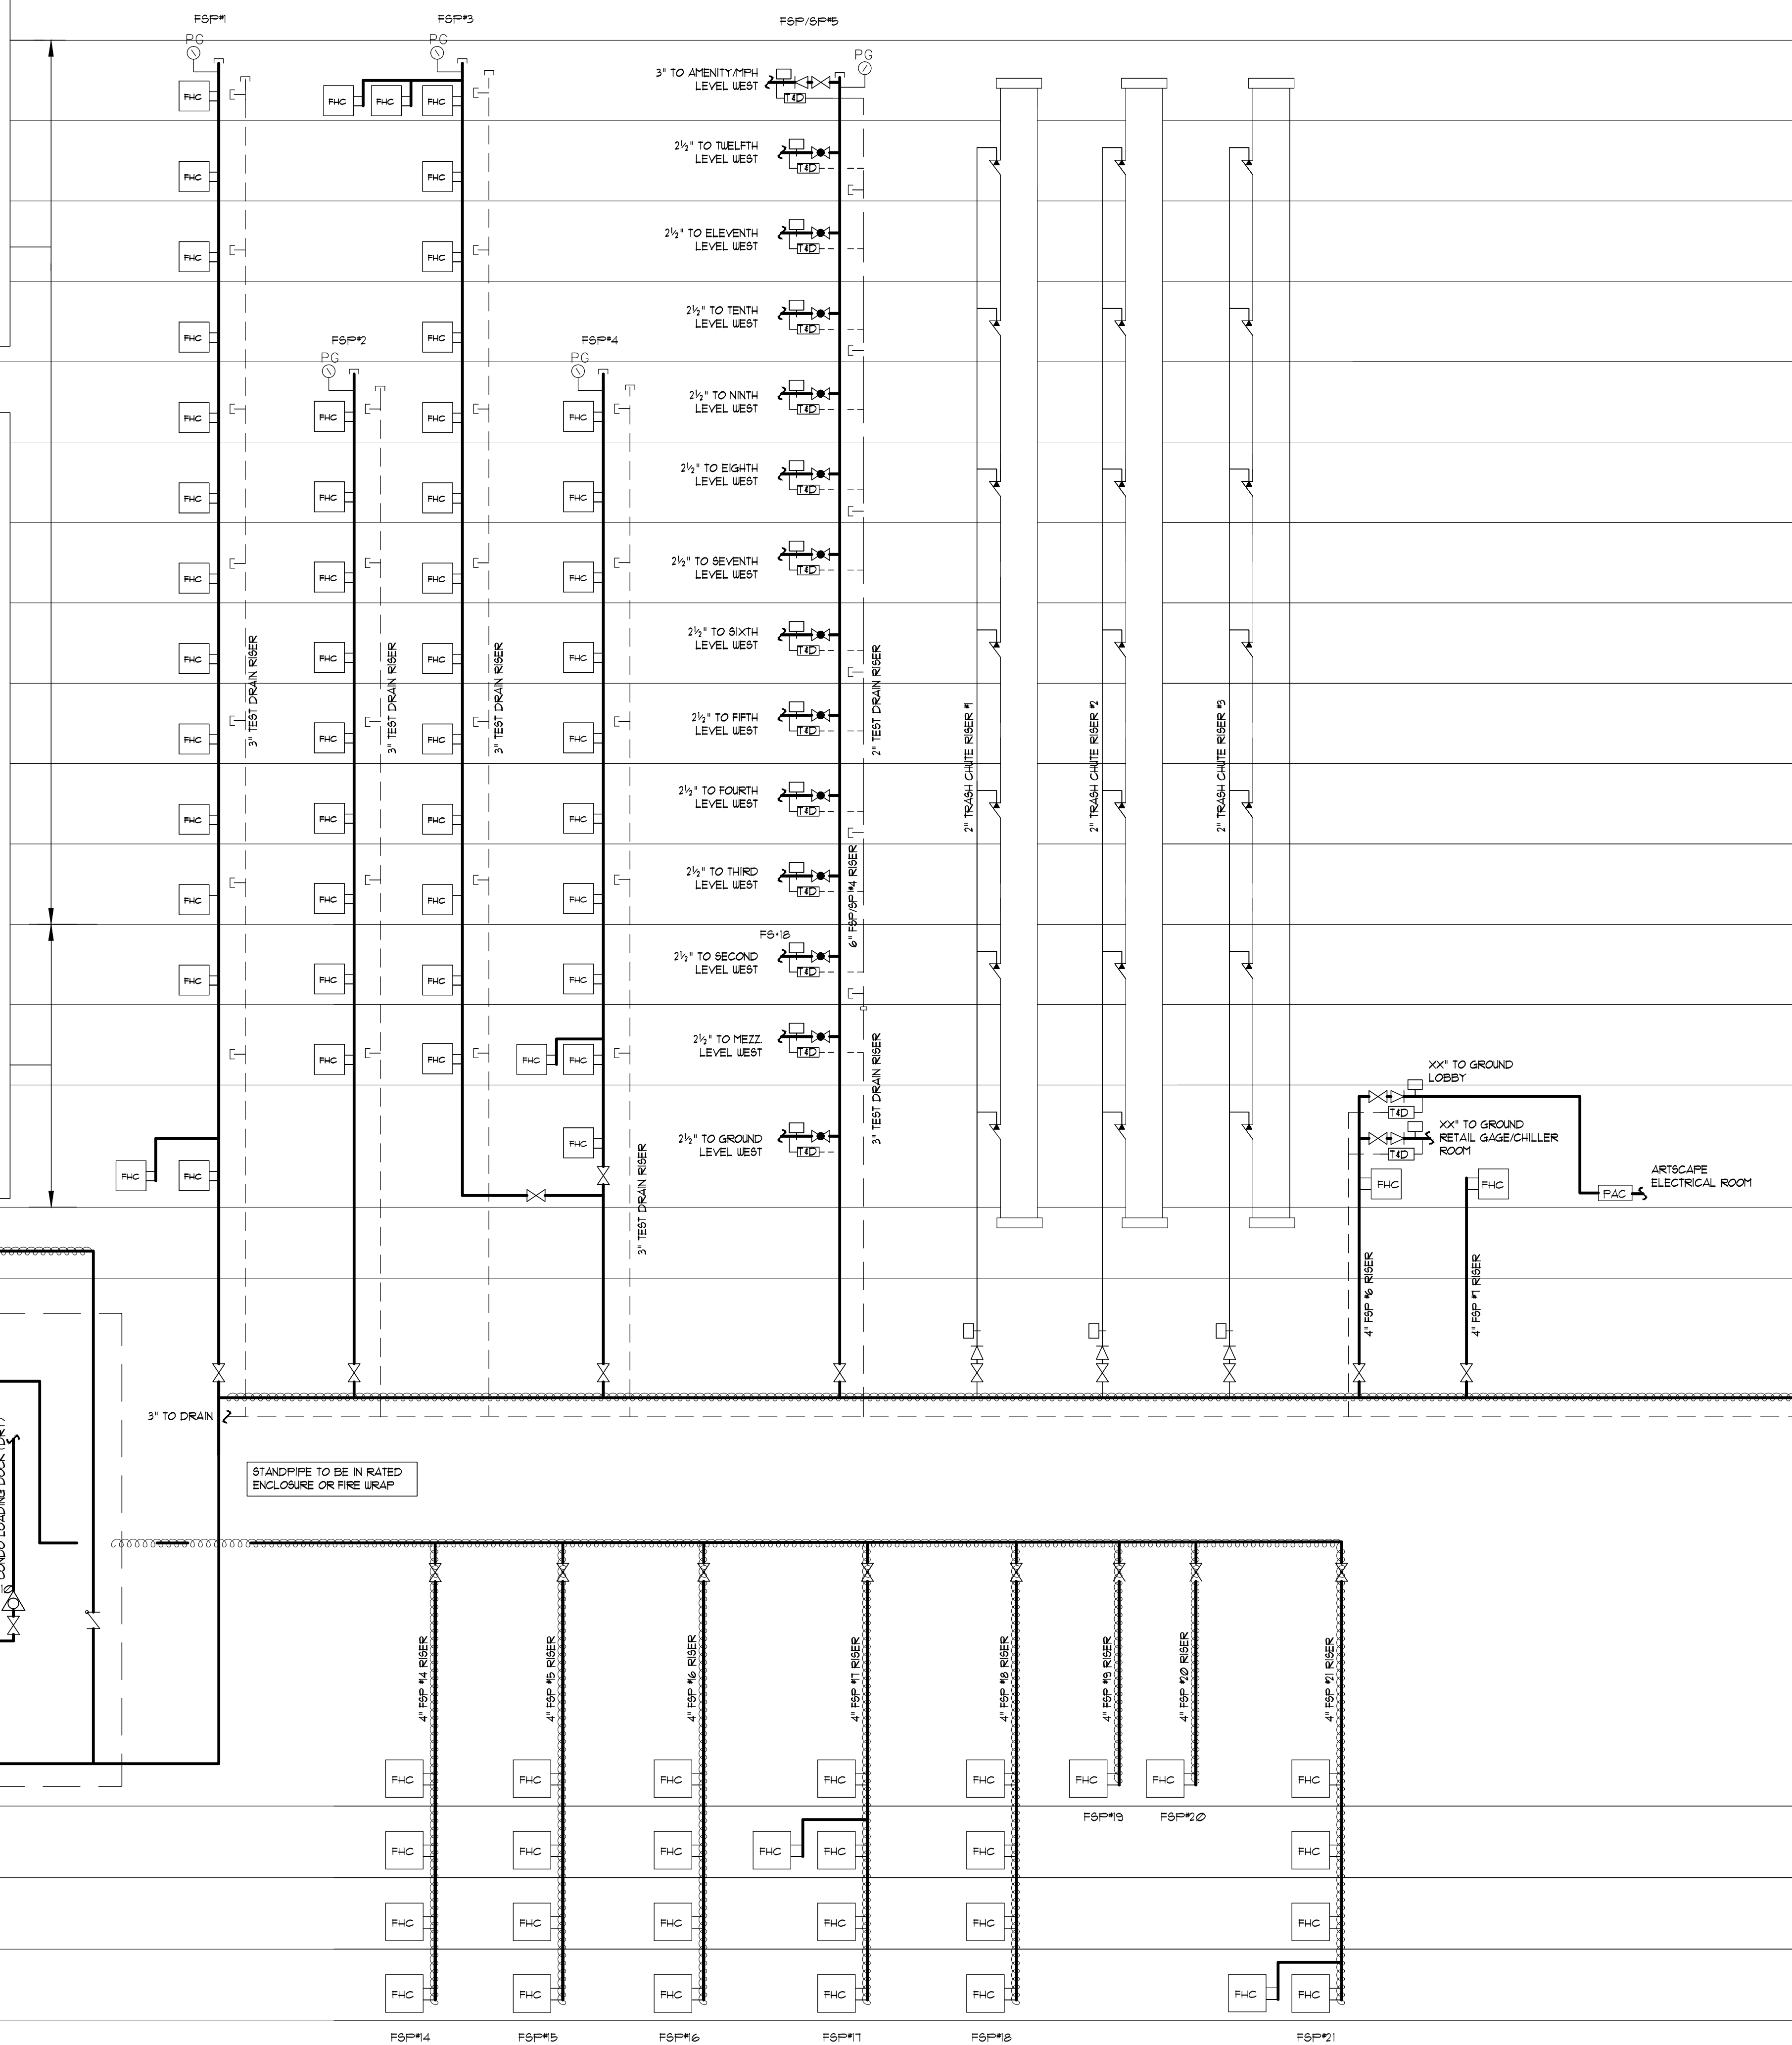
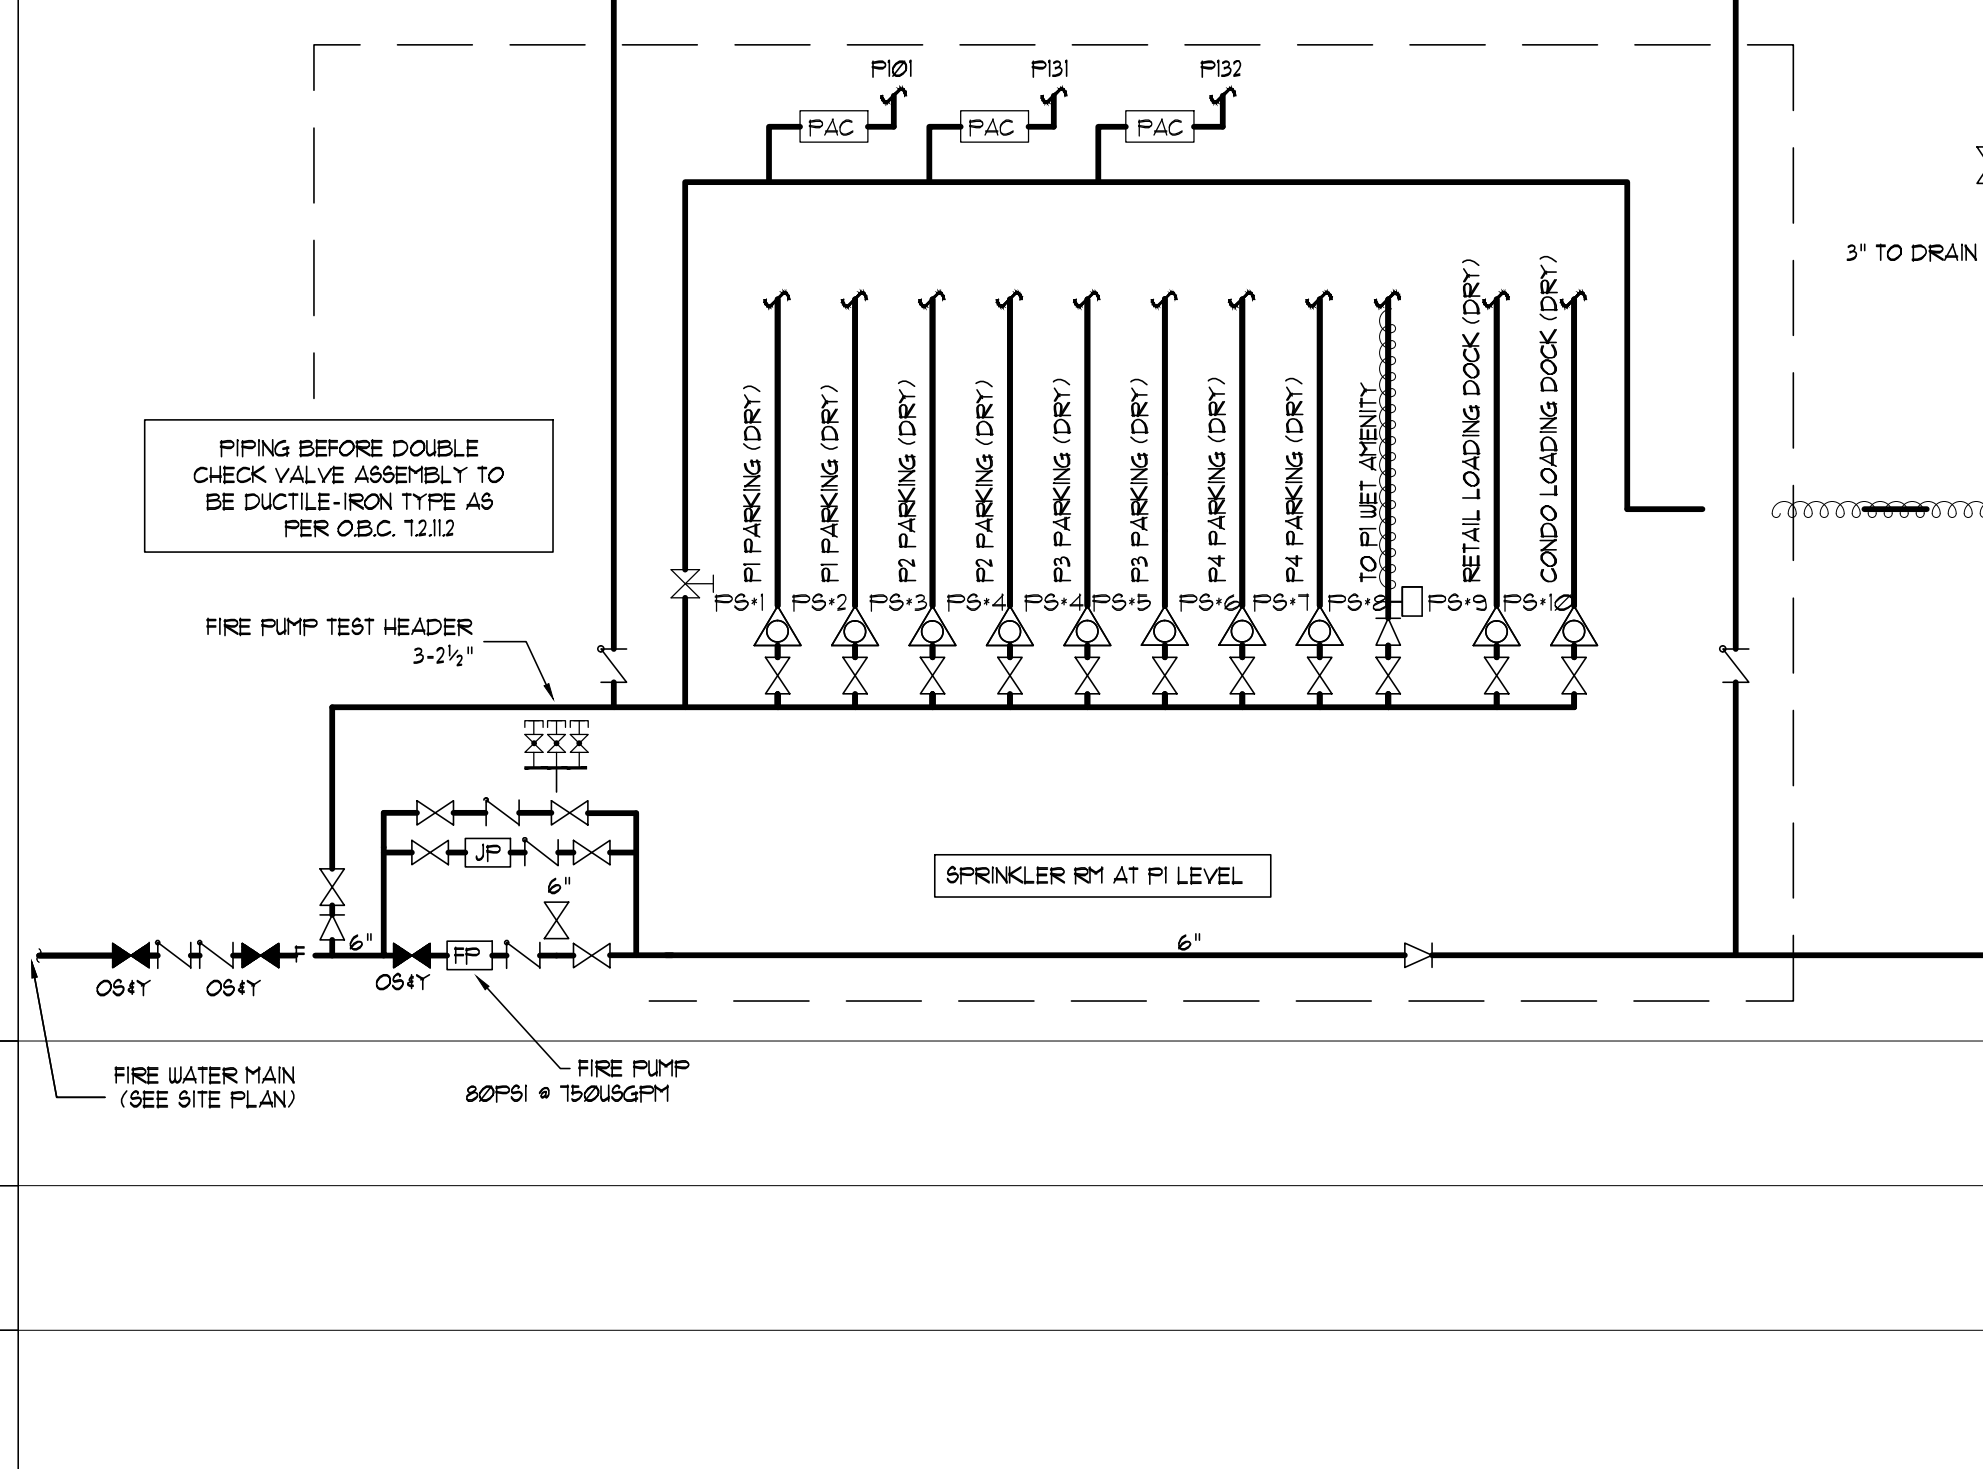
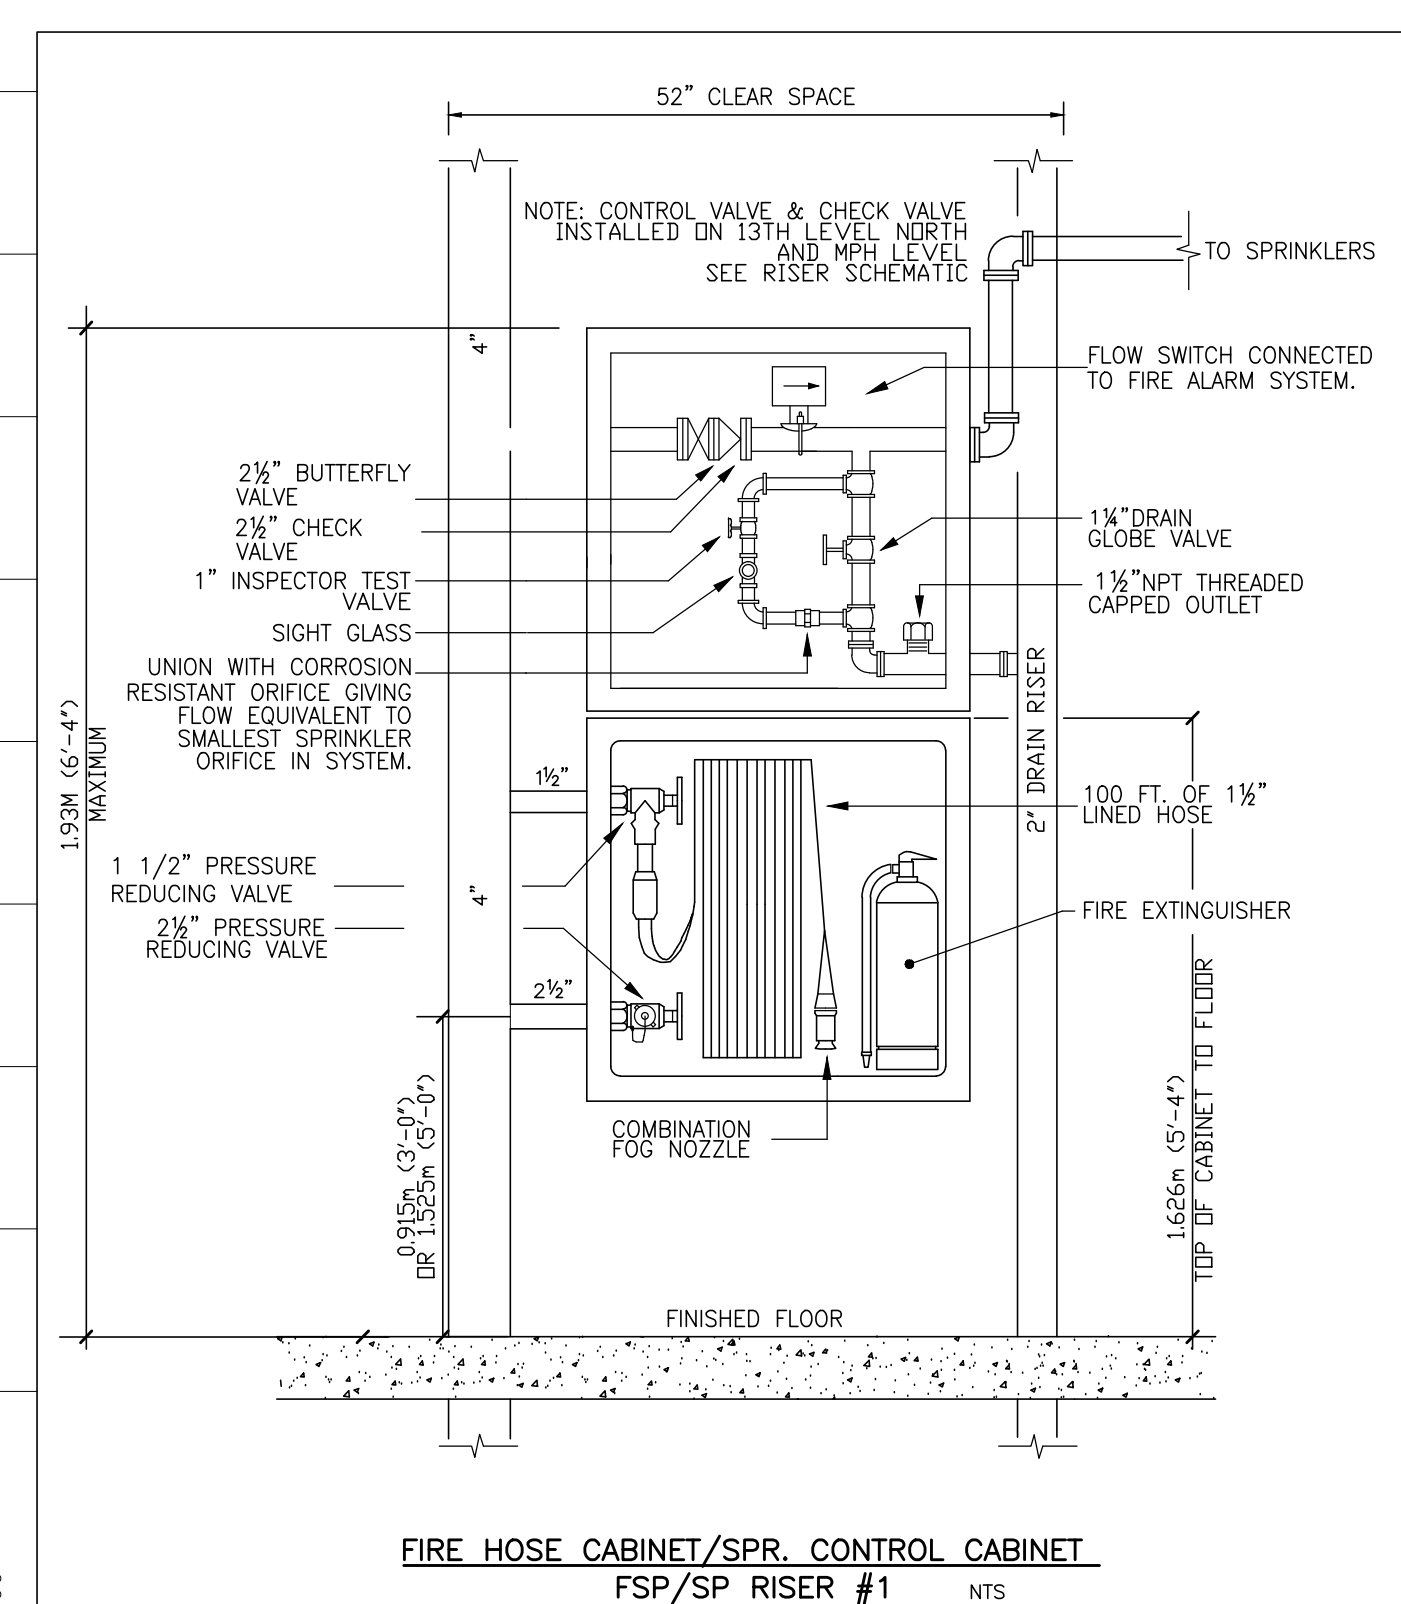



REVISIONS		
0	ISSUED FOR TENDER ADDENDUM #1	10/23/15

OTES

AQUAVISTA WEST	
PSF PRESSURE	Level
	ROOF
	15th LEVEL
	20th LEVEL
	10th LEVEL
	10th LEVEL
	9th LEVEL
	8th LEVEL
	7th LEVEL
	6th LEVEL
	5th LEVEL
	4th LEVEL
	3rd LEVEL
	2nd LEVEL
	LEVEL 1 MEZZ
	LEVEL 1
	F1 MEZZ
CITY WATER SUPPLY STATIC = 68 PSF CITY WATER SUPPLY STATIC AT INLET = 91 PSF PUMP COLUMN = 30 PSF STATIC PRESSURE AT PUMP DISCHARGE (81 PSF) HYDRANT FLOW TEST IS TO BE PERFORMED PRIOR TO ISSUING FOR CONSTRUCTION	
	F1 LEVEL
	F2 LEVEL
	F3 LEVEL
	F4 LEVEL

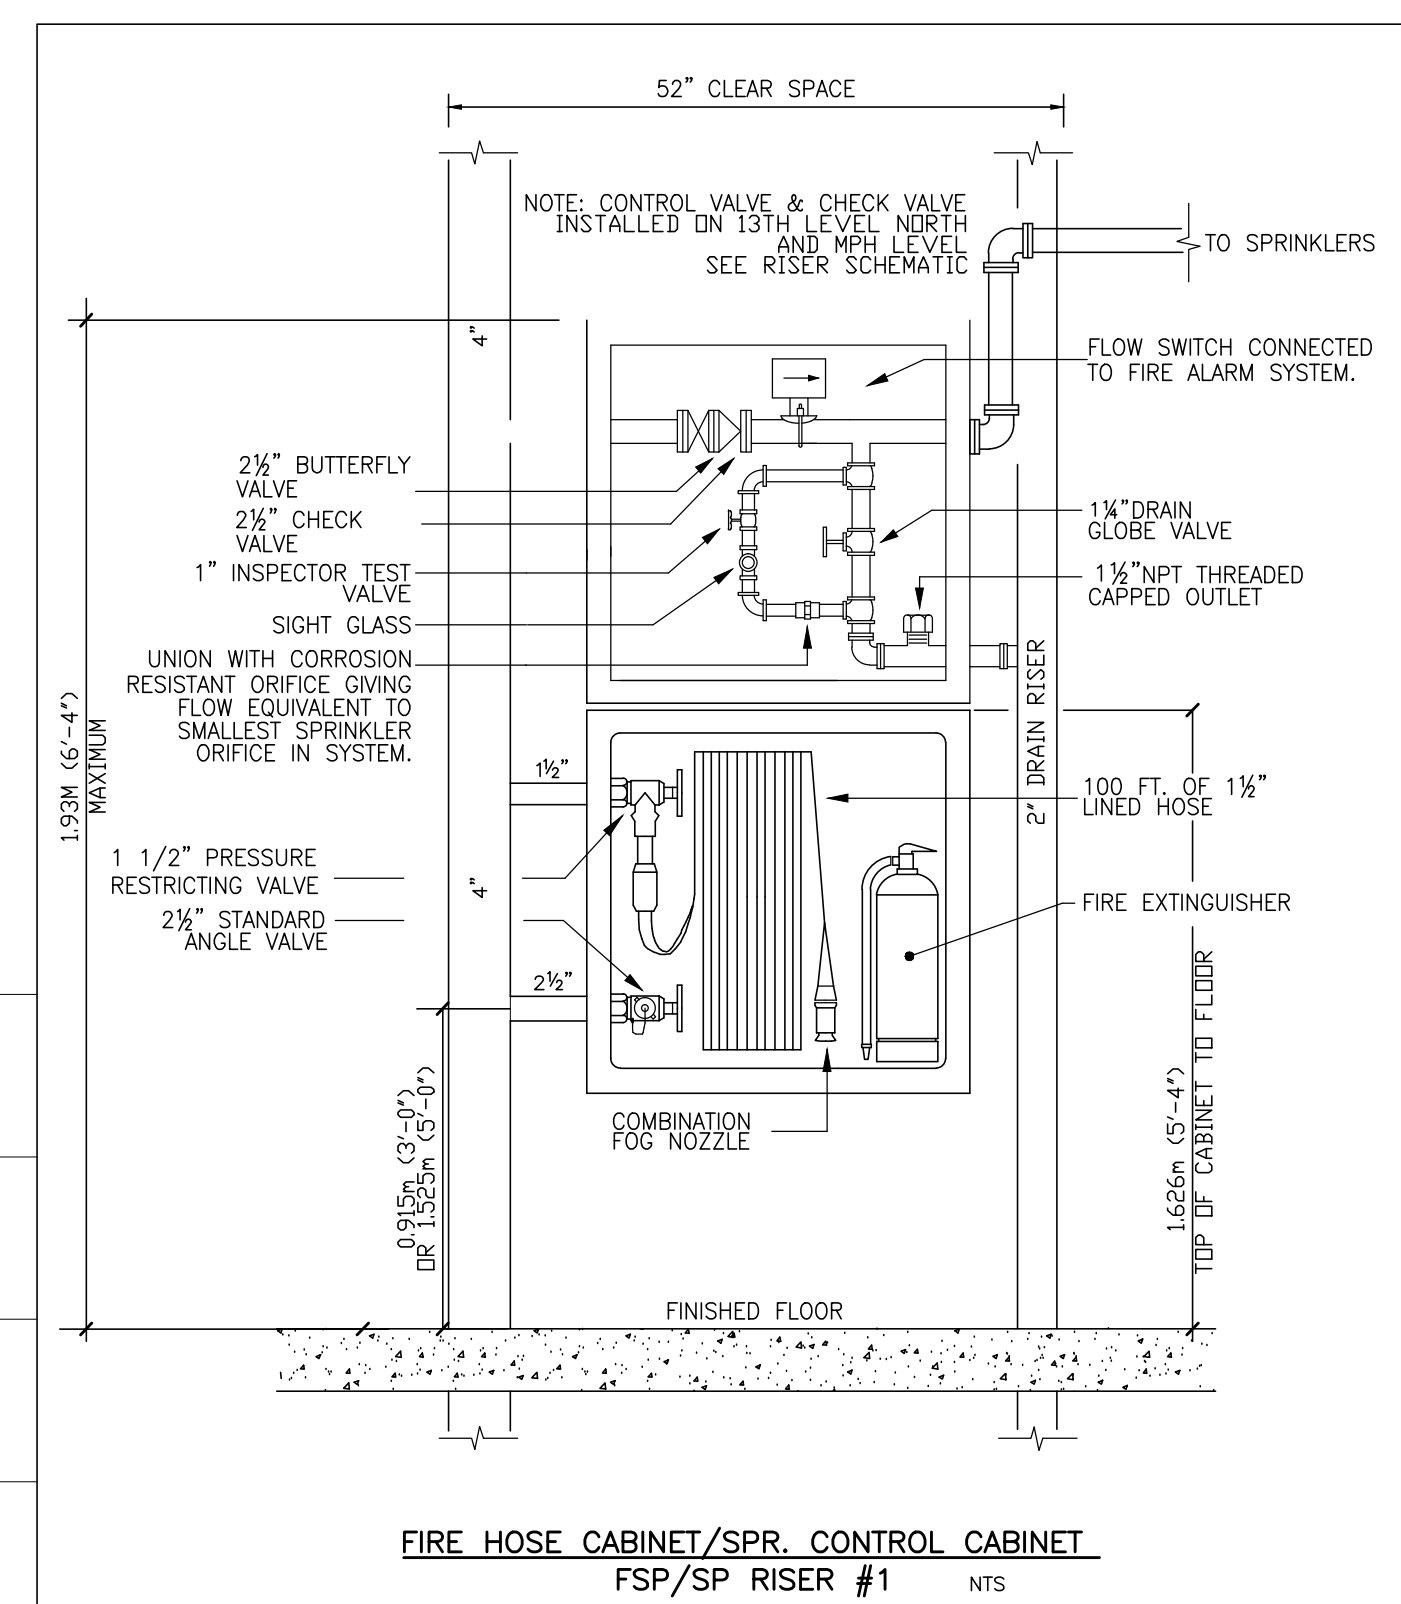

SEE WEST RISER ON SPX FOR CONTINUATION

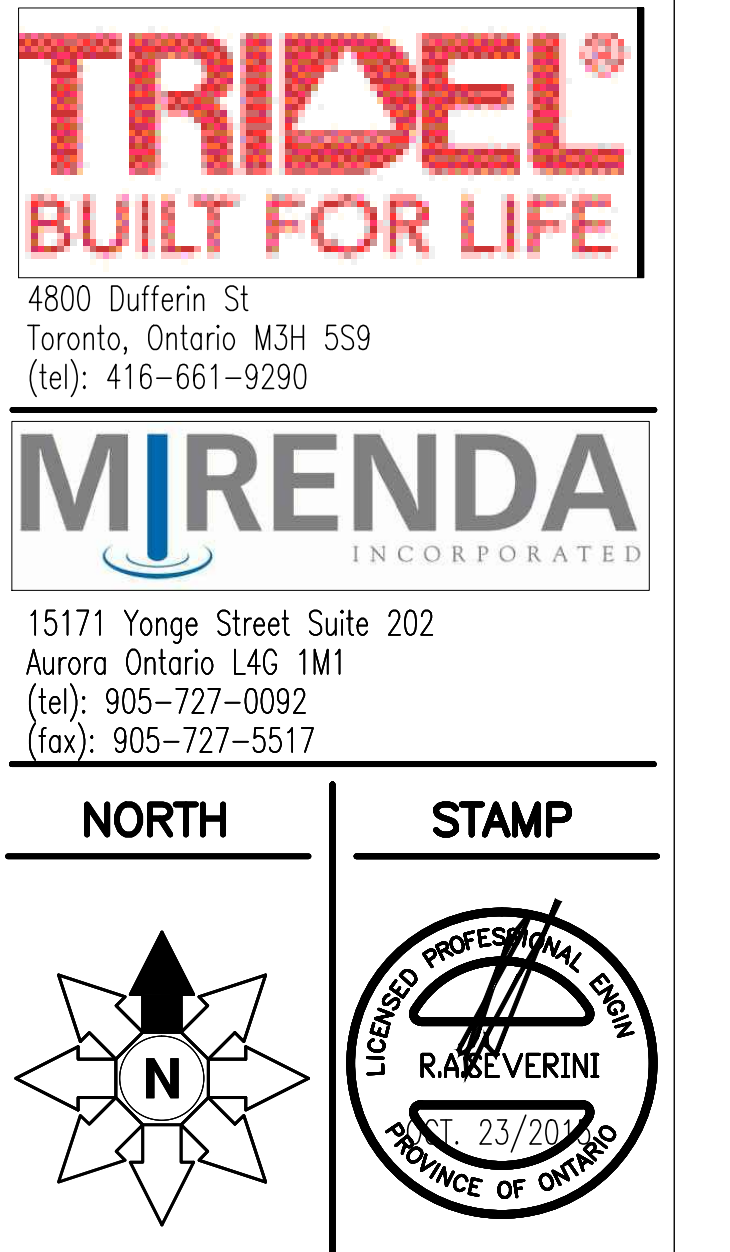

PROJECT

AQUAVISTA

MERCHANTS WHARF
TORONTO, ONTARIO

DWG TITLE

EAST RISER

DATE	10/23/2015	PROJECT NO.	
SCALE	1/8"=1'-0"		15-678
DWN BY	JL	DWG NO.	
ISSUED FOR REVISION NO.	1.0		SP19
		OF SP21	