
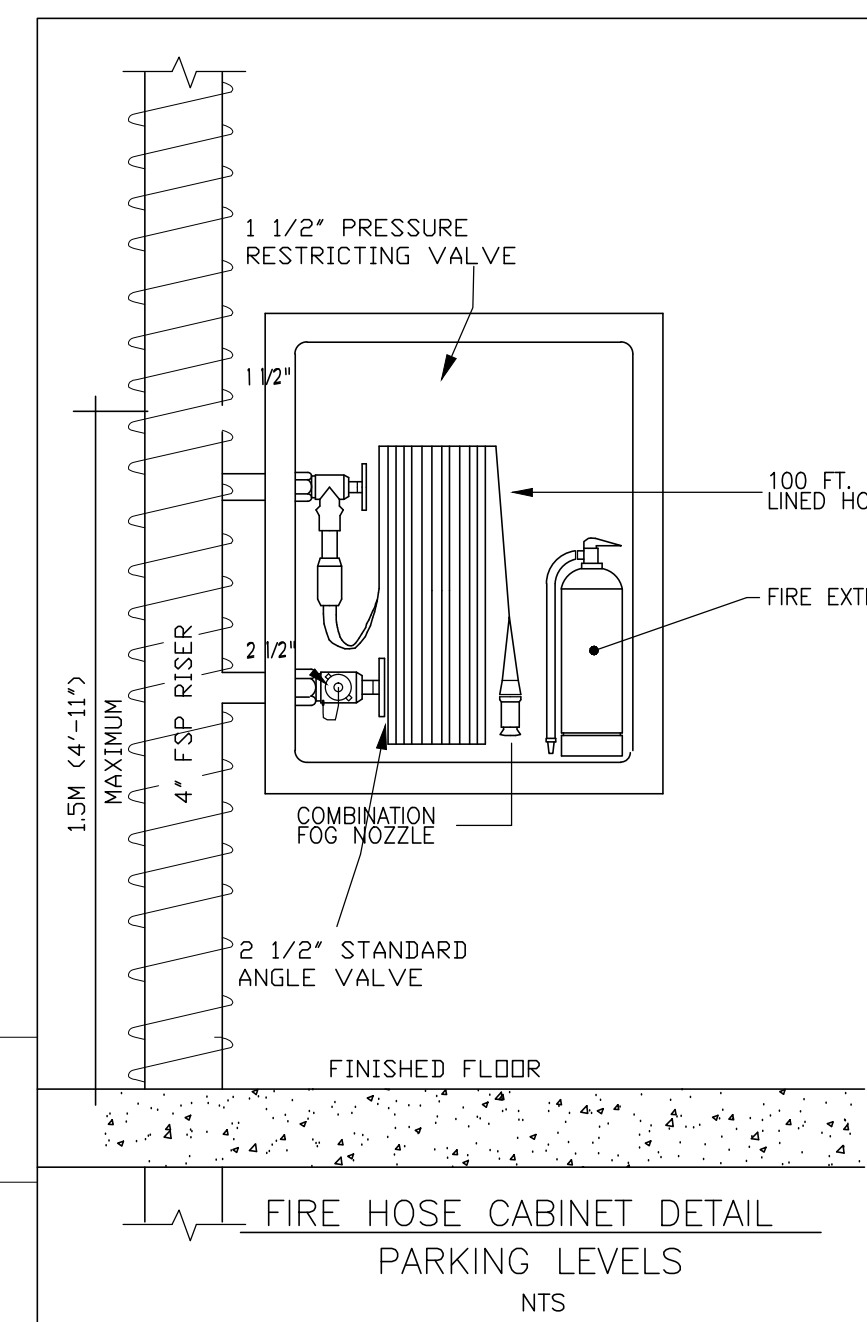


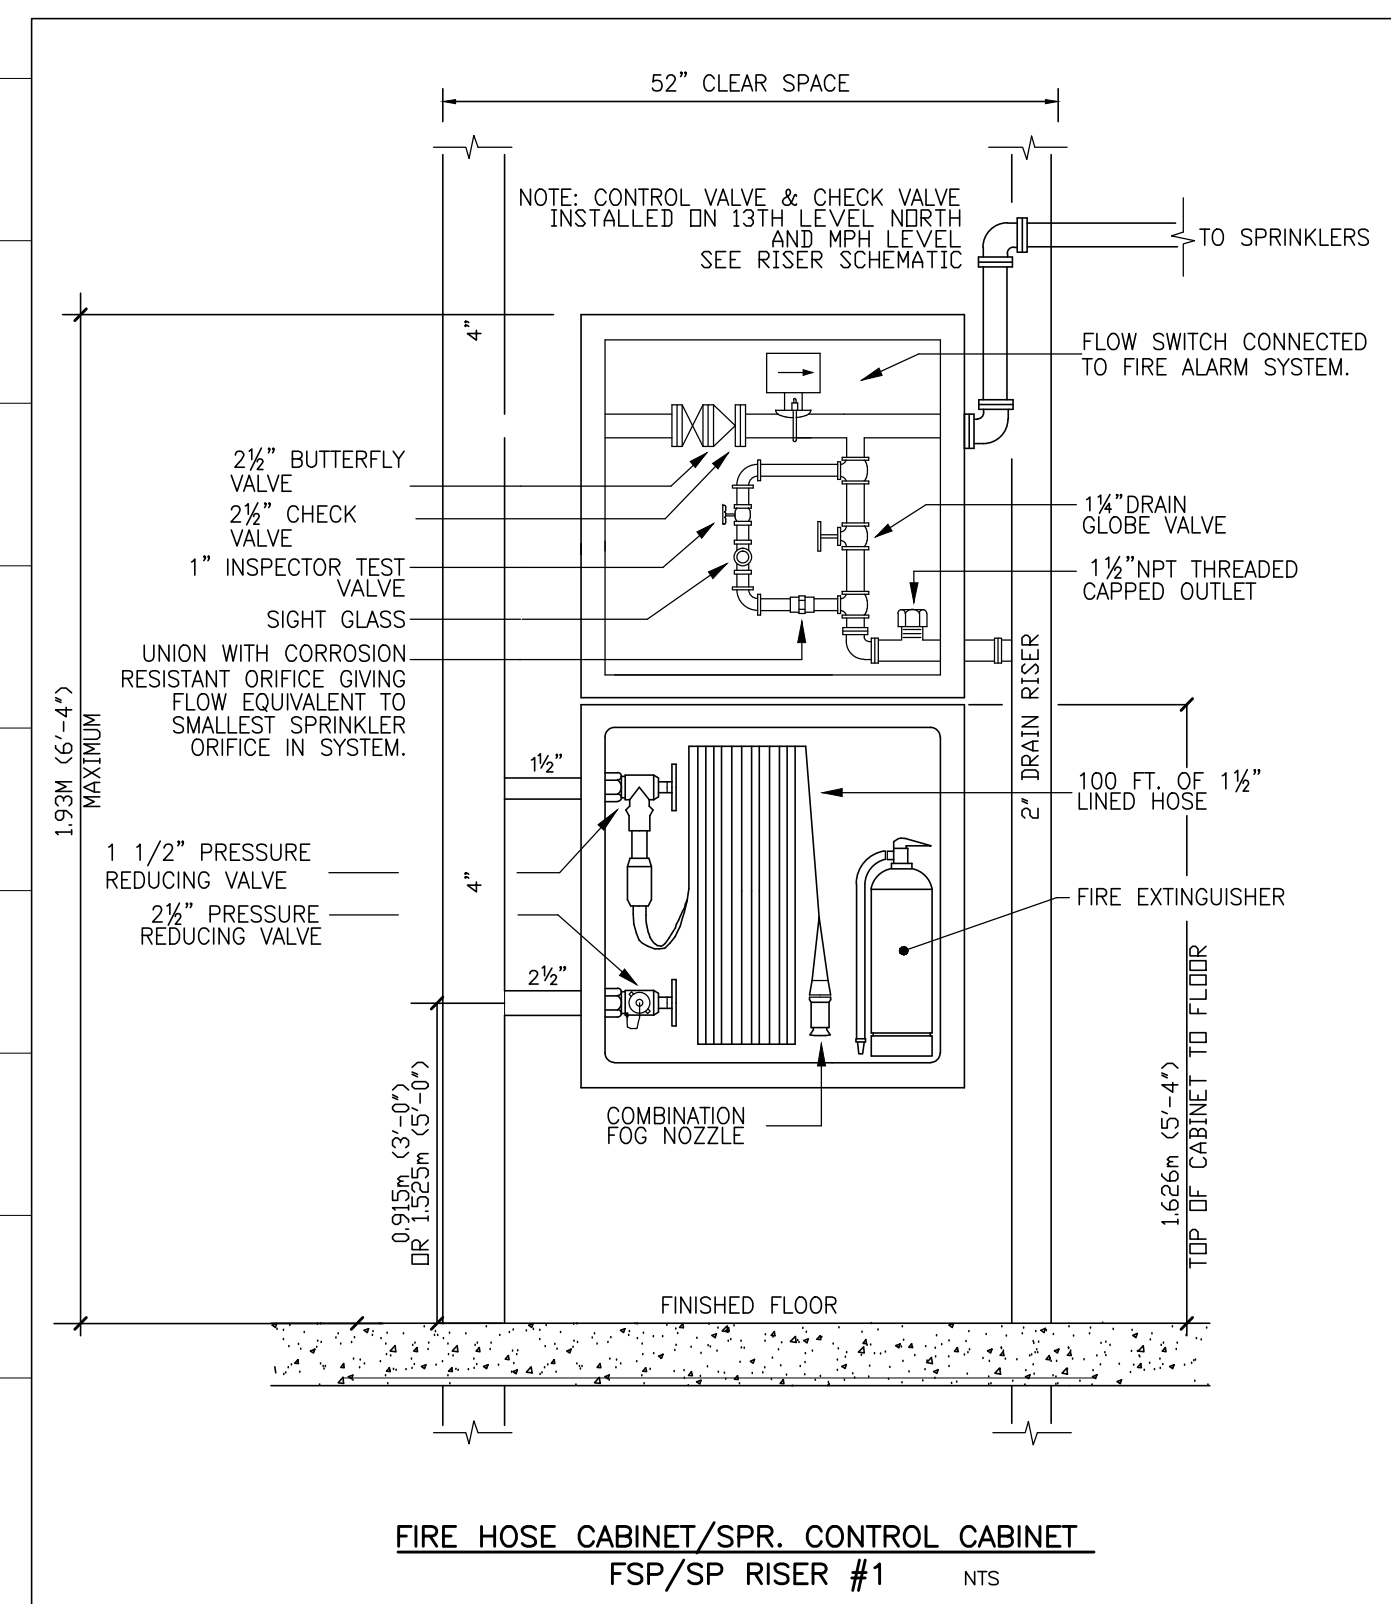

AQUAVISTA EAST	
FSP PRESS.	Level
133.0 PSI 51'-3"	
120.0 PSI 39'-8"	ROOF
106.0 PSI 32'-0"	10th LEVEL
92.0 PSI 27'-0"	10th LEVEL
78.0 PSI 21'-0"	10th LEVEL
64.0 PSI 16'-0"	10th LEVEL
50.0 PSI 12'-0"	8th LEVEL
36.0 PSI 9'-0"	7th LEVEL
22.0 PSI 6'-0"	6th LEVEL
8.0 PSI 3'-0"	5th LEVEL
14.0 PSI 4'-4"	4th LEVEL
30.0 PSI 11'-0"	3rd LEVEL
46.0 PSI 17'-0"	2nd LEVEL
62.0 PSI 23'-0"	LEVEL 1 MEZZ
78.0 PSI 29'-0"	LEVEL 1
94.0 PSI 35'-0"	PI MEZZ
CITY WATER SUPPLY STATIC = 88 PSI CITY WATER SUPPLY STATIC AT INLET = 91 PSI PUMP CHURN = 16 PSI STATIC PRESSURE AT PUMP DISCHARGE 181 PSI HYDRANT FLOW TEST IS TO BE PERFORMED PRIOR TO BIDDING FOR CONSTRUCTION	
100.0 PSI 37'-0"	P1 LEVEL 88 PSI
116.0 PSI 43'-0"	P2 LEVEL 93 PSI
132.0 PSI 49'-0"	P3 LEVEL 98 PSI
148.0 PSI 55'-3"	P4 LEVEL 100 PSI

[illegible]

PROJECT	AQUAVISTA
MERCHANTS' WHARF TORONTO, ONTARIO	
DWG TITLE	WEST RISER

DATE	10/23/2015	PROJECT NO.	15-678
SCALE	1/8"=1'-0"	DWG NO.	SP20
DWN BY	JL	OF SP21	
ISSUED FOR REVISION NO.	1.0		