



LEVEL 12 FRAMING PLAN - WITH BLL AND TUL
1:100

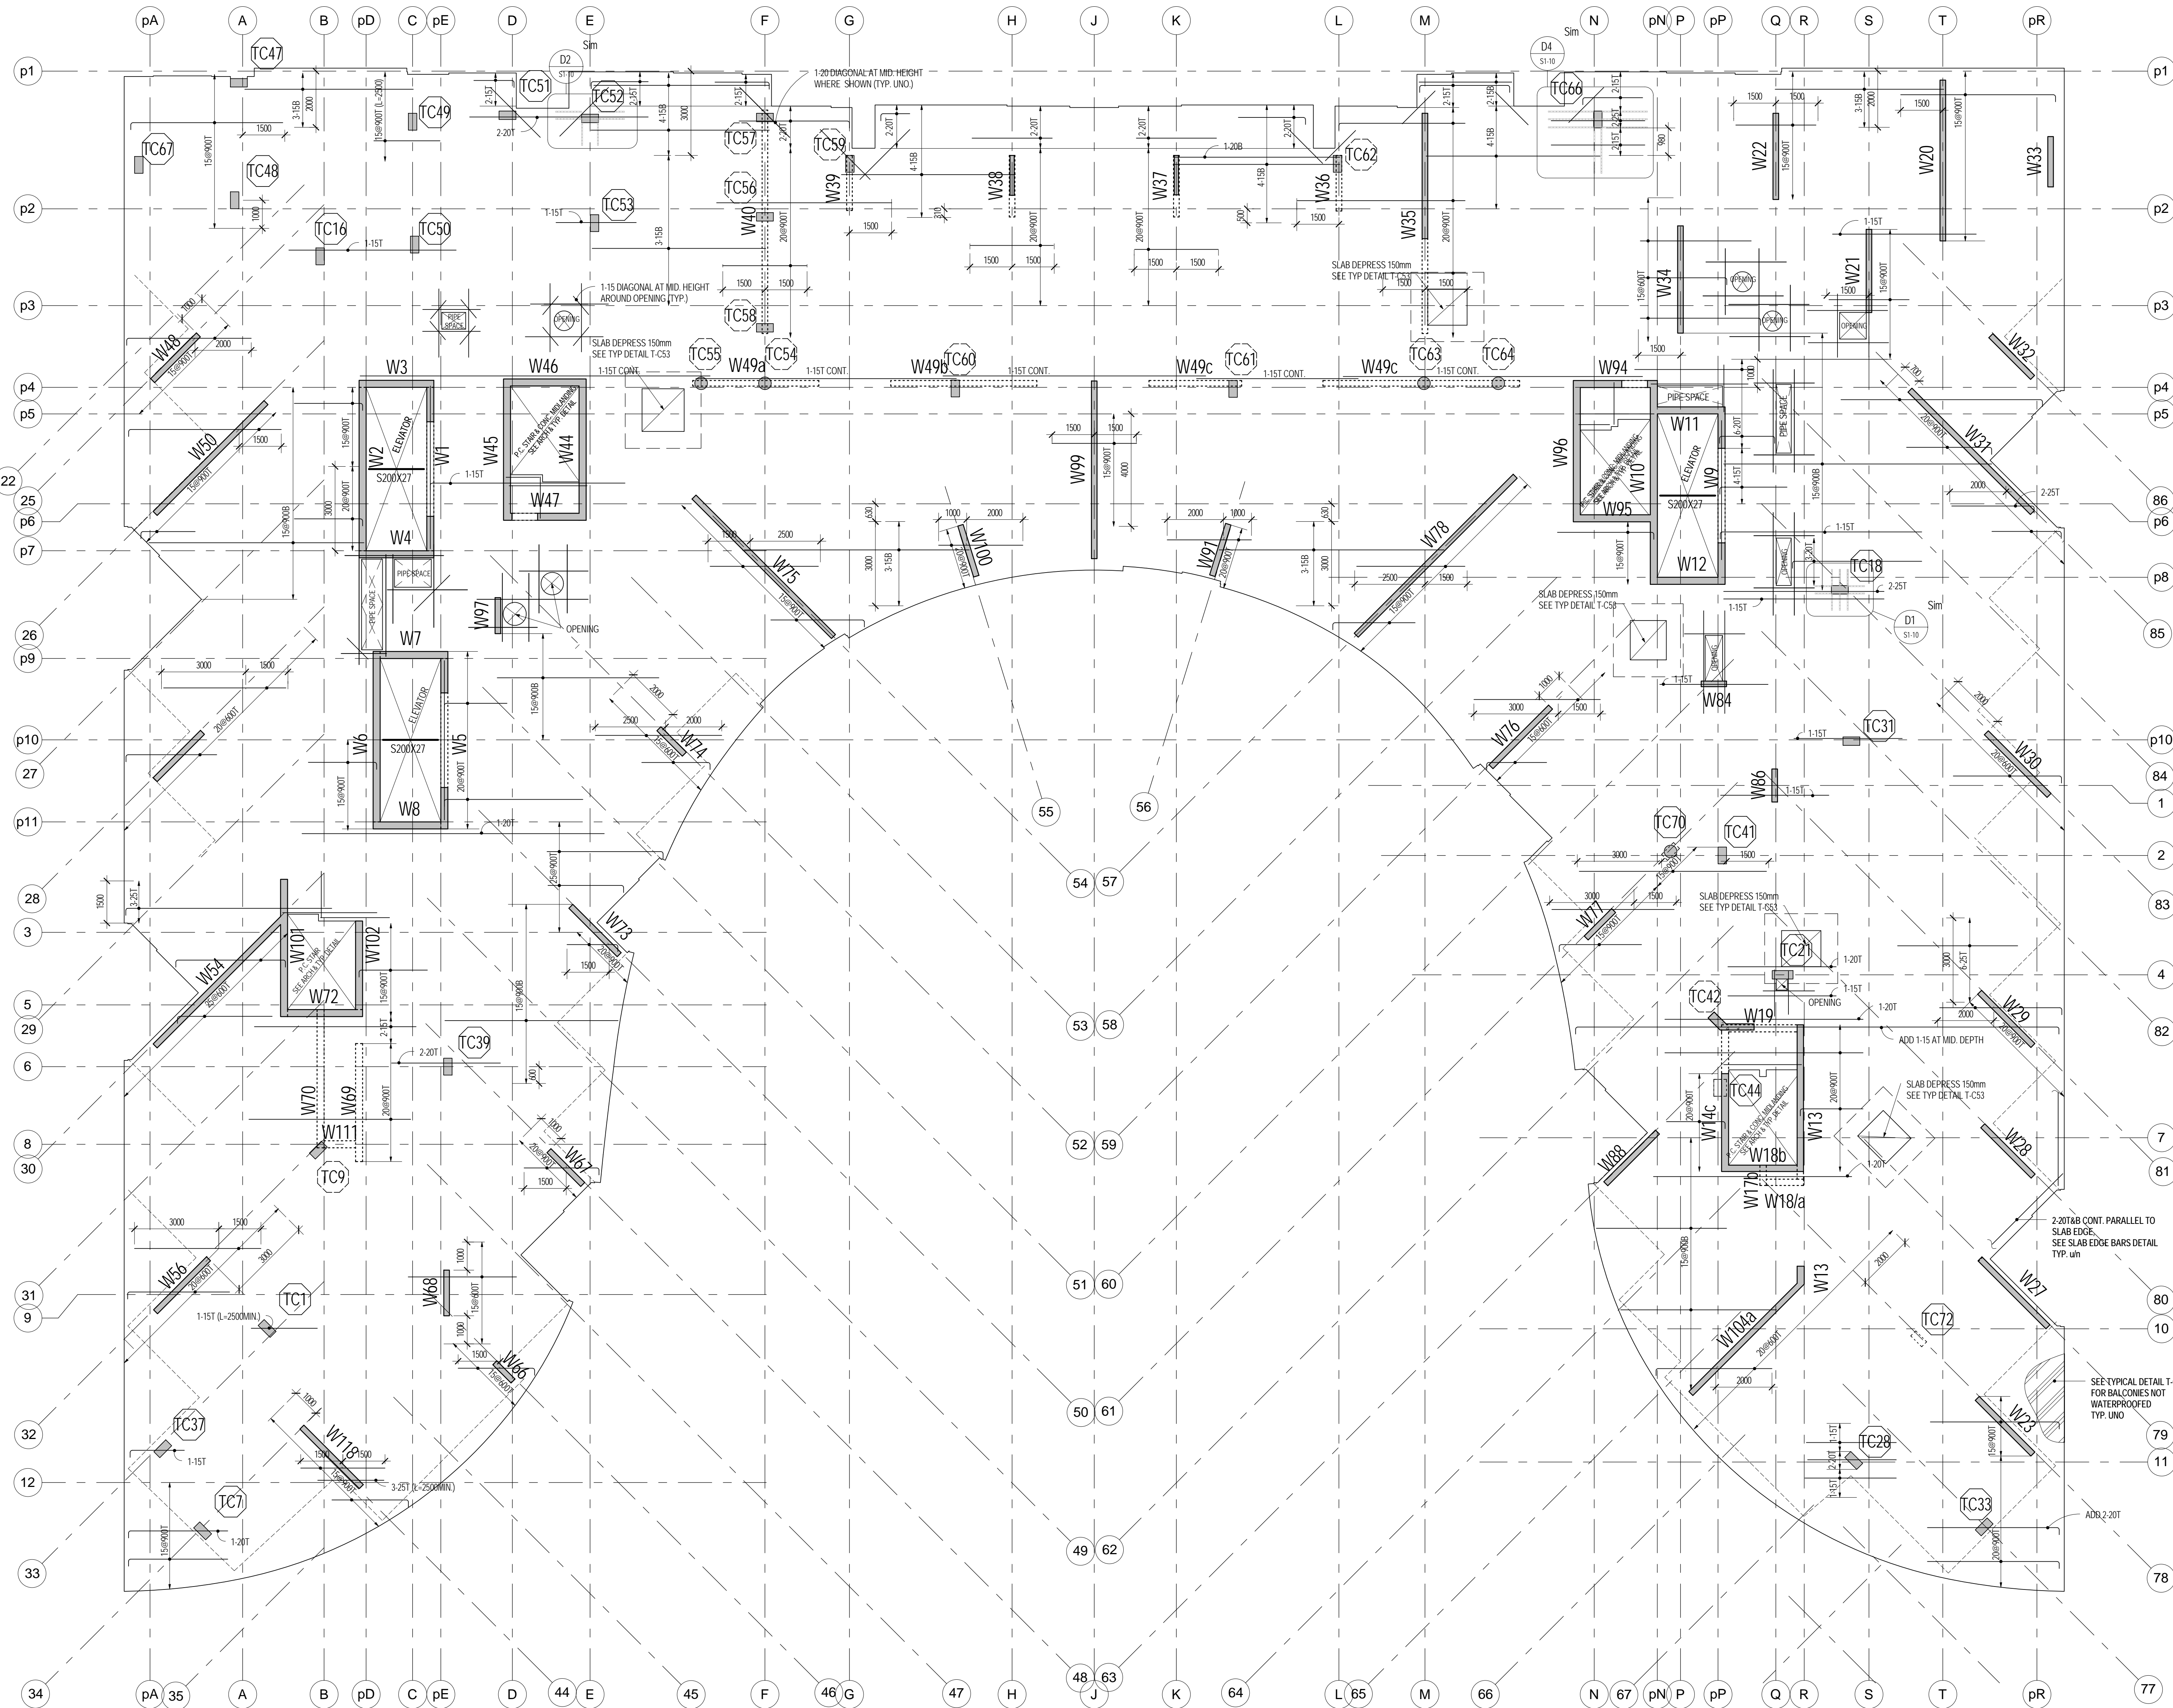

LEVEL 12 FRAMING PLAN - WITH BUL AND TLL
1:100

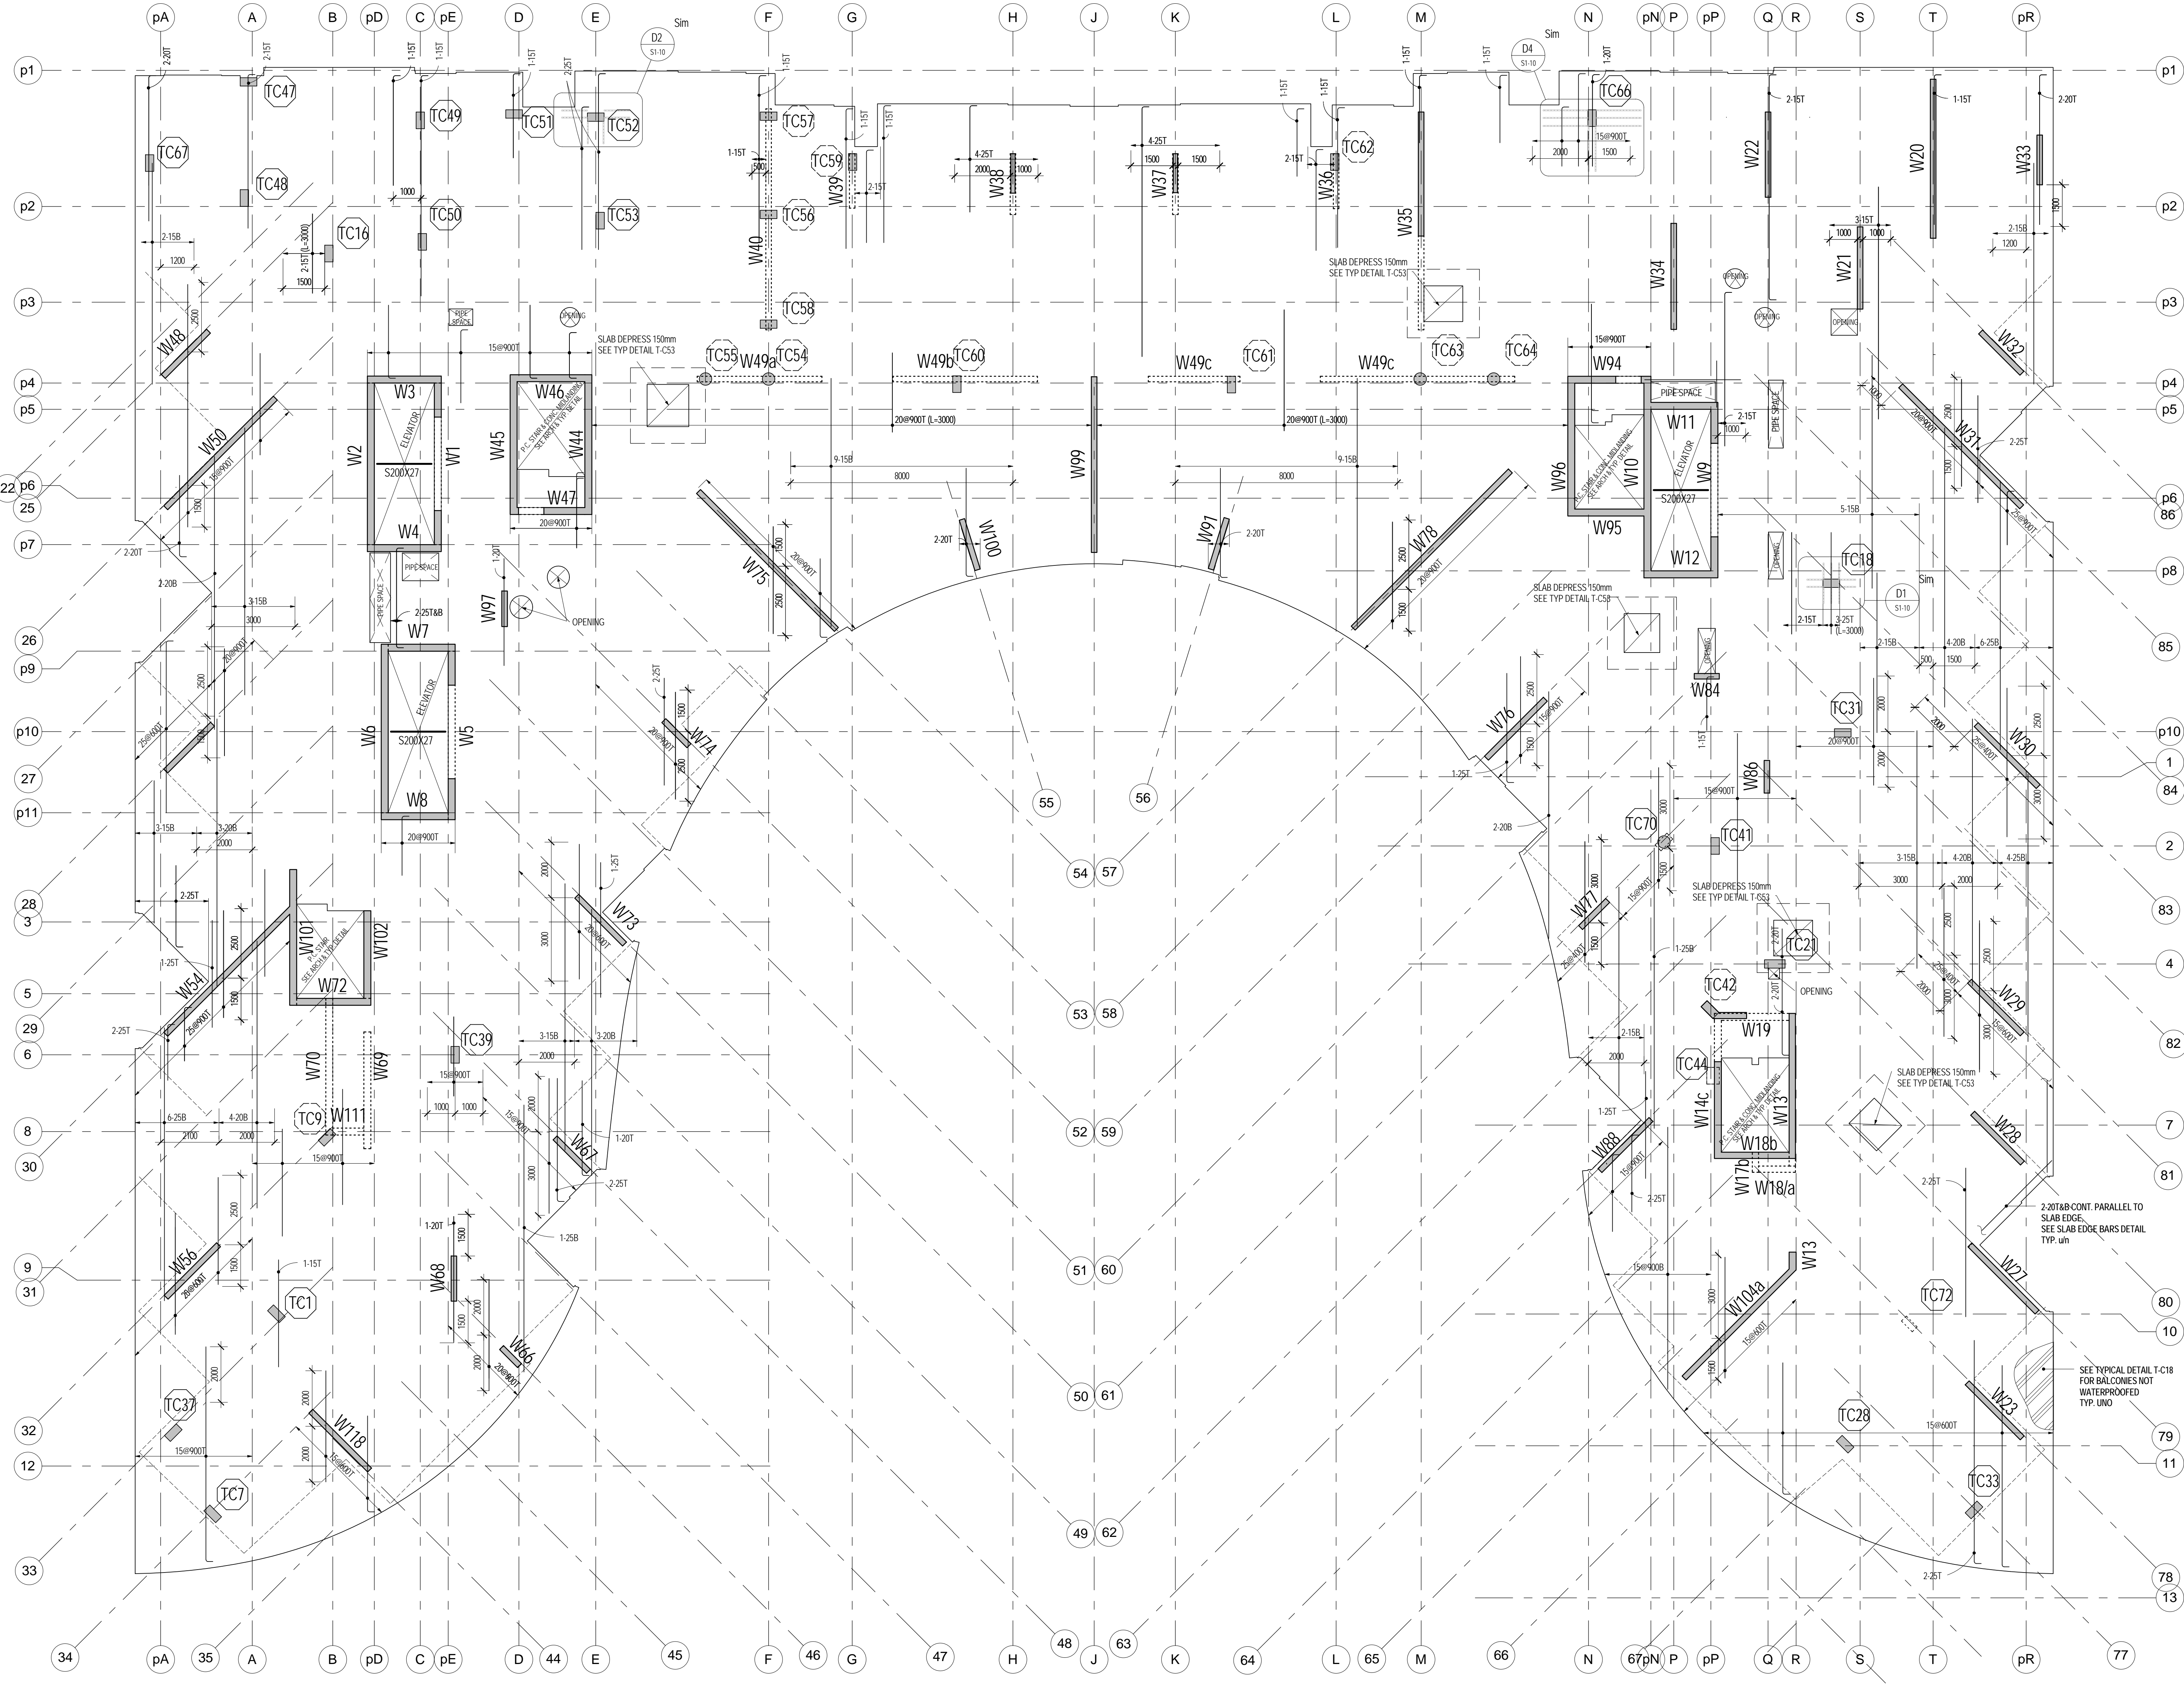

SLAB EDGE BARS DETAIL
1:10

REINFORCEMENT PLACEMENT DIAGRAM

SLAB:	200MM UNO
W/STAY BARS:	2.20M UNO
CONCRETE STRENGTH:	25MPA
TEMP. STEEL:	150000 UNO

SEE PLAN FOR ADDITIONAL REINFORCEMENT

- NOTES:
- TOP OF STRUCTURAL SLAB TO BE 6.0m BELOW FINISHED FLOOR DATA ELEVATION. EXCEPT AS CROSSED AND NOTED. SEE ARCHITECTURAL DRAWINGS FOR DATA ELEVATION.
 - THE STRUCTURAL SLAB HAS BEEN DESIGNED FOR THE FOLLOWING LOADS (ALL UNO) AND SUPERIMPOSED DEAD LOADS (SLL) IN ADDITION TO THE SELF WEIGHT:

SURF.	20
LIVE	1.20
WIND	0.80
SEISMIC	0.10
RAILROAD	0.10
 - ALL ALLOWANCE FOR SLAB DEFLECTION AND CRACKING.
 - CONCRETE COVER FOR TOP AND BOTTOM BARS TO BE 20mm.
 - APPROVAL MUST BE OBTAINED FROM ENGINEER FOR ALL OPENINGS OTHER THAN THOSE SHOWN UNO.
 - THE PROJECT SUPERINTENDENT MUST CONTACT THIS OFFICE 24 HOURS PRIOR TO PLACING STRUCTURAL CONCRETE FOR A SCHEDULE OF PREPARATIONS.
 - SEE ALSO TYPICAL NOTES AND DETAILS.
 - PROVIDE CONTINUOUS TEMPERATURE STEEL TOP AND BOTTOM HOOKED AT EDGE OF SLAB AND OPENINGS. IN ADDITION TO REINFORCEMENT SHOWN ON PLAN.
 - PROVIDE TIES FOR ALL SLAB REINFORCEMENT.
 - ADD 2.20M CONT. AT PERIMETER BARS TO SLAB EDGE. SEE SLAB EDGE BARS DETAIL.

4	BUILDING PERMIT	SEPT 21 2015
3	BUILDING PERMIT	JULY 22 2015
2	BUILDING PERMIT SUBMISSION	JUNE 12 2015
1	ISSUED FOR REVIEW	MAY 01 2015

LEVEL 12 / PH1 FLOOR
FRAMING PLAN